


HP	CATALOG NO	--rH ±20%	--AMPS(A)	APPROX WT-LBS
15	KDRF1T	3.50	21	25

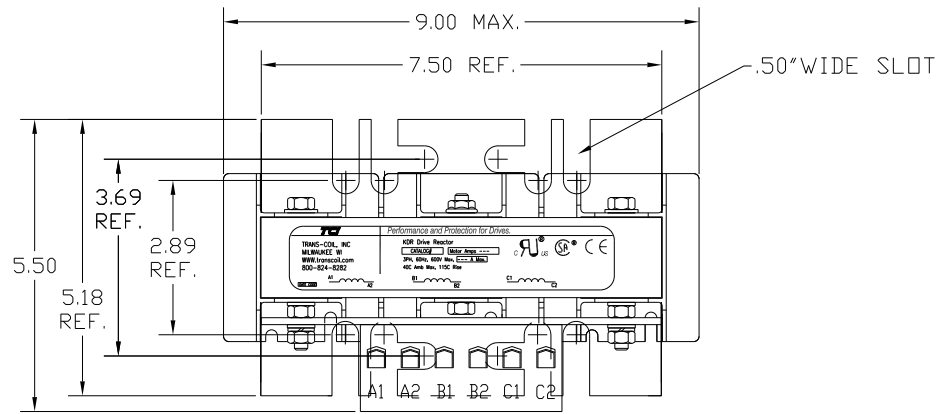


TCI Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282



KDR Drive Reactor
CATALOG# [Motor Amps ---]
3PH, 60Hz, 600V Max, [--- A Max.]
40C Amb Max, 115C Rise

UL US CSA CE

A1 A2 B1 B2 C1 C2

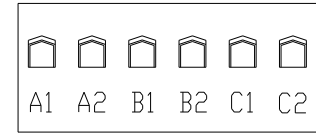


NOTE: A1, A2, B1, B2, C1, C2,
ON TERMINAL BLOCK
FOR REFERENCE ONLY.

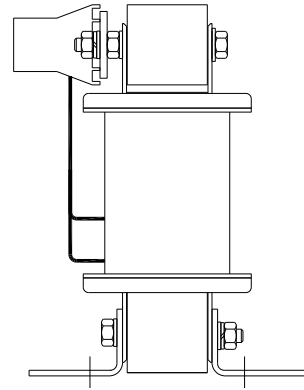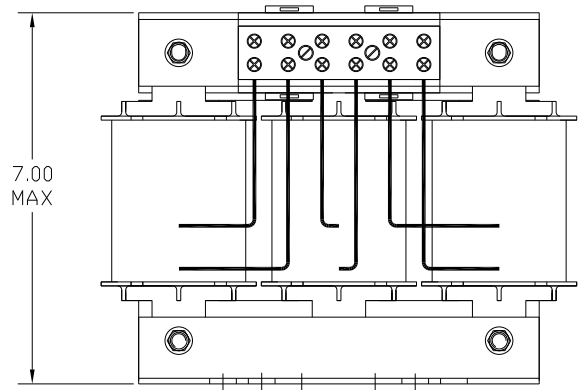

TORQUE(LB-IN)=CUSTOMER WIRE

35=1 AWG THRU 4 AWG
30=6 AWG THRU 14 AWG
25=16 AWG THRU 20 AWG
20=22 AWG

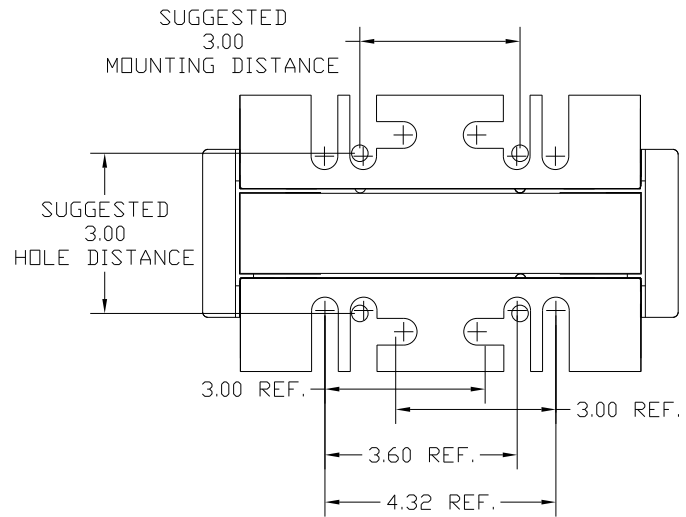

				TOLERANCES (EXCEPT AS NOTED): DECIMAL		TCI 7878 N. 86th STREET MILWAUKEE, WI 53224	
				.XX ± .03 .XXX ± .01			
				FRACTIONAL ± 1/32		KDRF1T, 15HP 480 Volts, 21 Amps	
				ANGULAR ± 1/2°		DRN BY DSW DATE 01/27/05 DWG NO 102420DG	
NO	REVISION	DATE	BY	SCALE TO FIT	APPRV	SHT. 1 OF 1	