

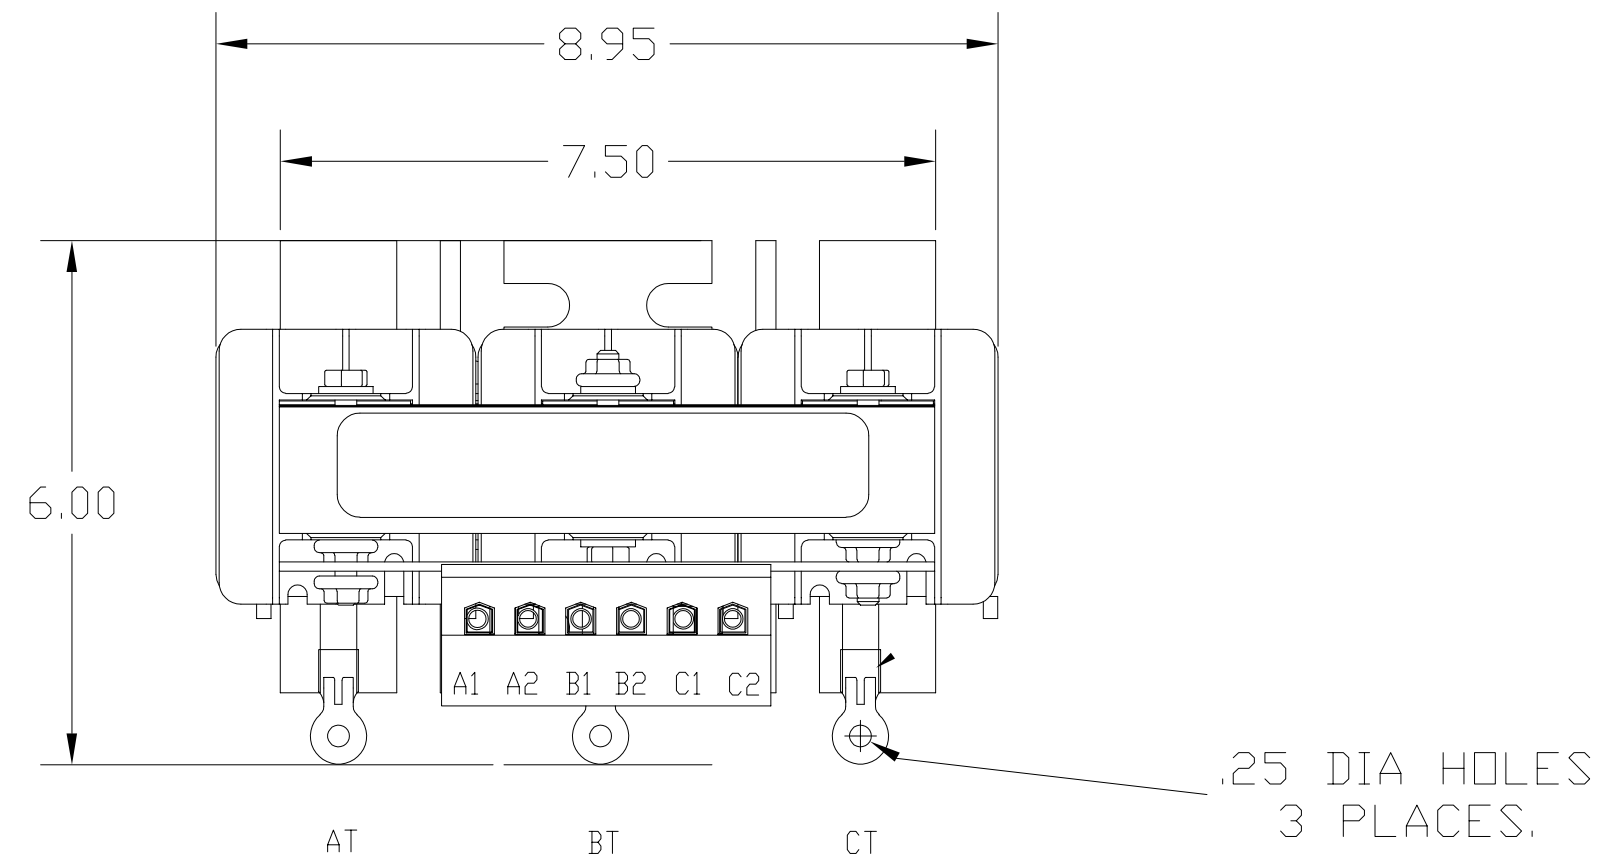



HP	CATALOG NO	RATED _ _ AMP(S)(A)	MAX. _ _ AMP(S)(A)	APPROX WT-LBS
20	KDRF2TT	19.3	27	29

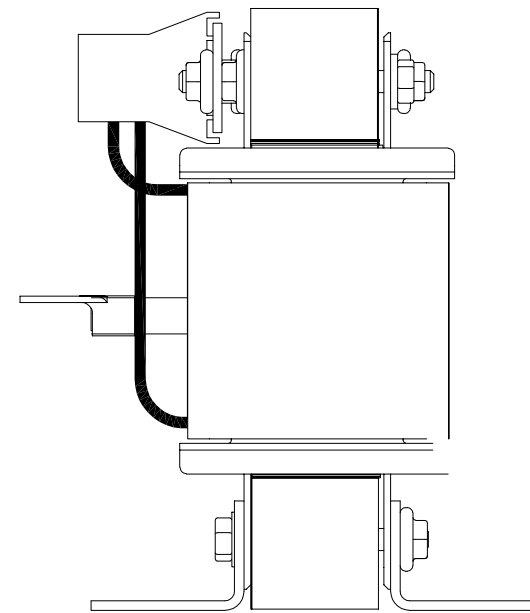

FRONT OF REACTOR
MARKINGS ON BLOCK FOR REF.
A1 AT A2 B1 BT B2 C1 CT C2

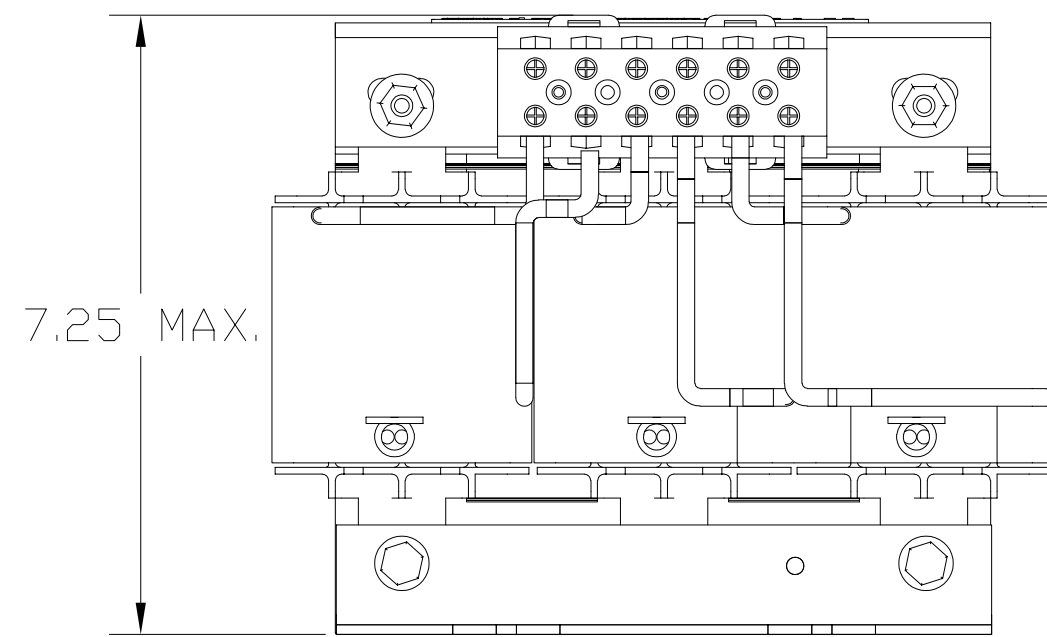

TORQUE(LB-IN)=CUSTOMER WIRE
 35=1 AWG THRU 4 AWG
 30=6 AWG THRU 14 AWG
 25=16 AWG THRU 20 AWG
 20=22 AWG

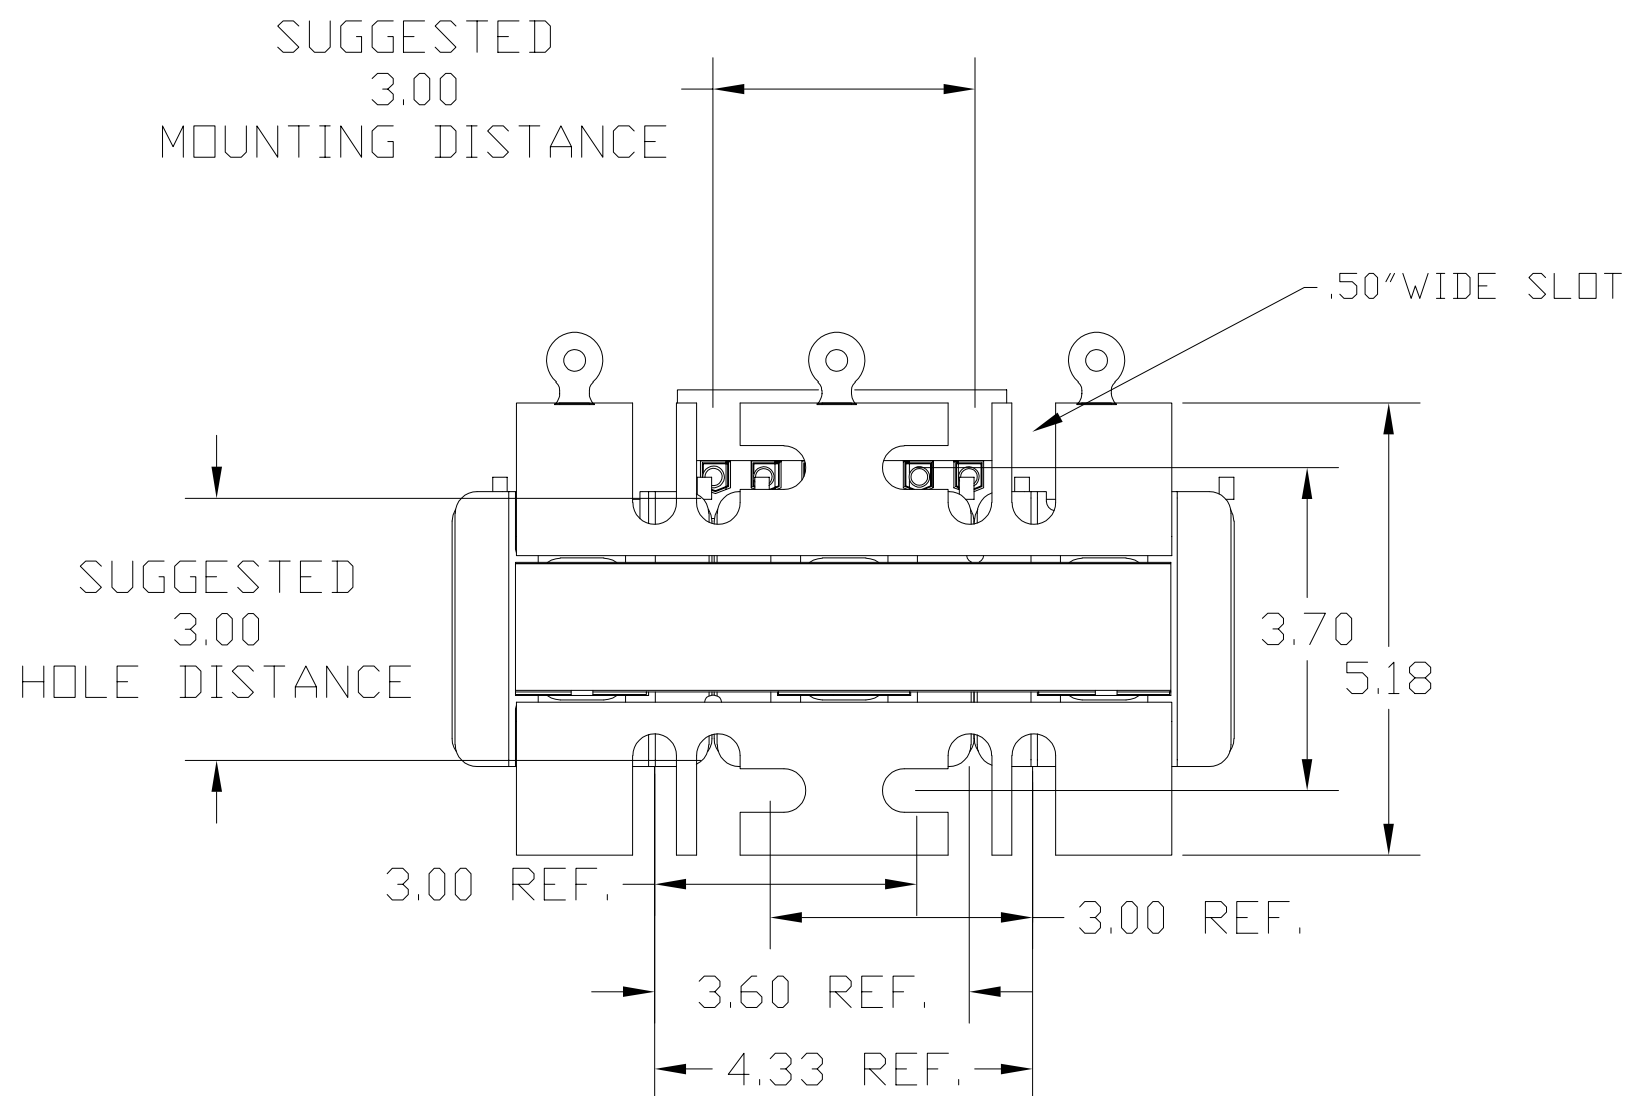

				TOLERANCES (EXCEPT AS NOTED)	TCI W132 N10611 Grant Drive Gerantown, WI 53022
				DECIMAL .XX ±.25 .XXX±.10	
				FRACTIONAL ± 1/32	KDRF2TT, 20HP HGP FILTER REACTOR
				ANGULAR ± 1/2°	
△	Height was 6.89	8/13/18	DSW	DRN. BY DSW	DATE 6/28/2013
NO	REVISION	DATE	BY	SCALE TO FIT	DWG. NO. 105305DG
					SHT. 1 of 1