

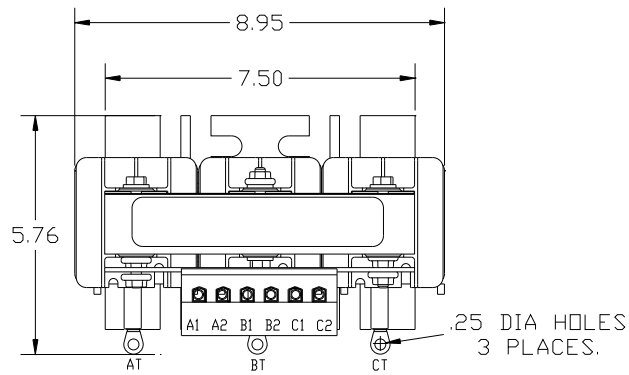



HP	CATALOG NO	RATED AMPS(A)	MAX. AMPS(A)	APPROX WT-LBS
15	KDRF41TT	11.59	17	26



FRONT OF REACTOR  
MARKINGS ON BLOCK FOR REF.  
A1 AT A2 B1 BT B2 C1 CT C2

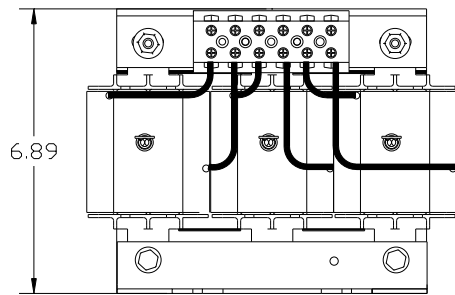

TORQUE(LB-IN)=CUSTOMER WIRE  
35=1 AWG THRU 4 AWG  
30=6 AWG THRU 14 AWG  
25=16 AWG THRU 20 AWG  
20=22 AWG

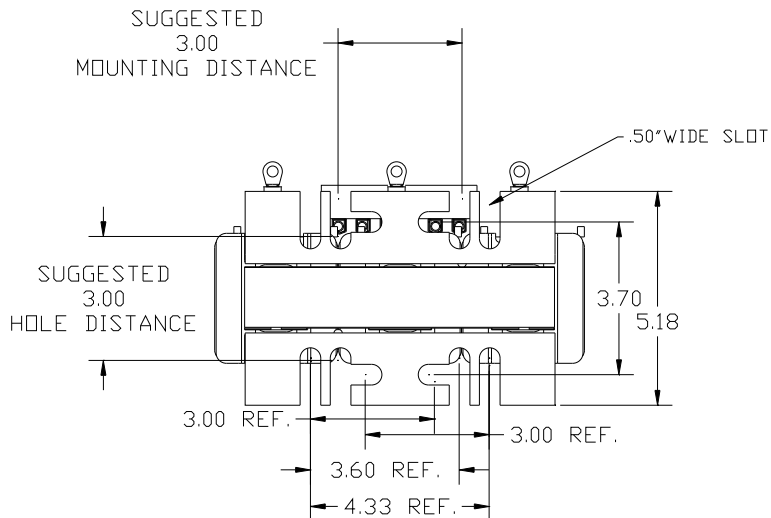

<p>TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.</p>					TOLERANCES (EXCEPT AS NOTED): DECIMAL	<p><b>TCL</b>® W132 N10611 Grant Drive Germanstown, WI 53022</p> <p>KDRF41TT, 600V, 15HP HGP FILTER REACTOR</p>	DRN. BY	DATE	DWG. NO.	
					.XX ±.03		DSW	5/29/14	105663DG	
					.XXX ±.01		SCALE	TO FIT	SIZE	C
					FRACTIONAL ± 1/32					
					ANGULAR ± 1/2°				SHT. 1 of 1	
NO	REVISION	DATE	BY							