

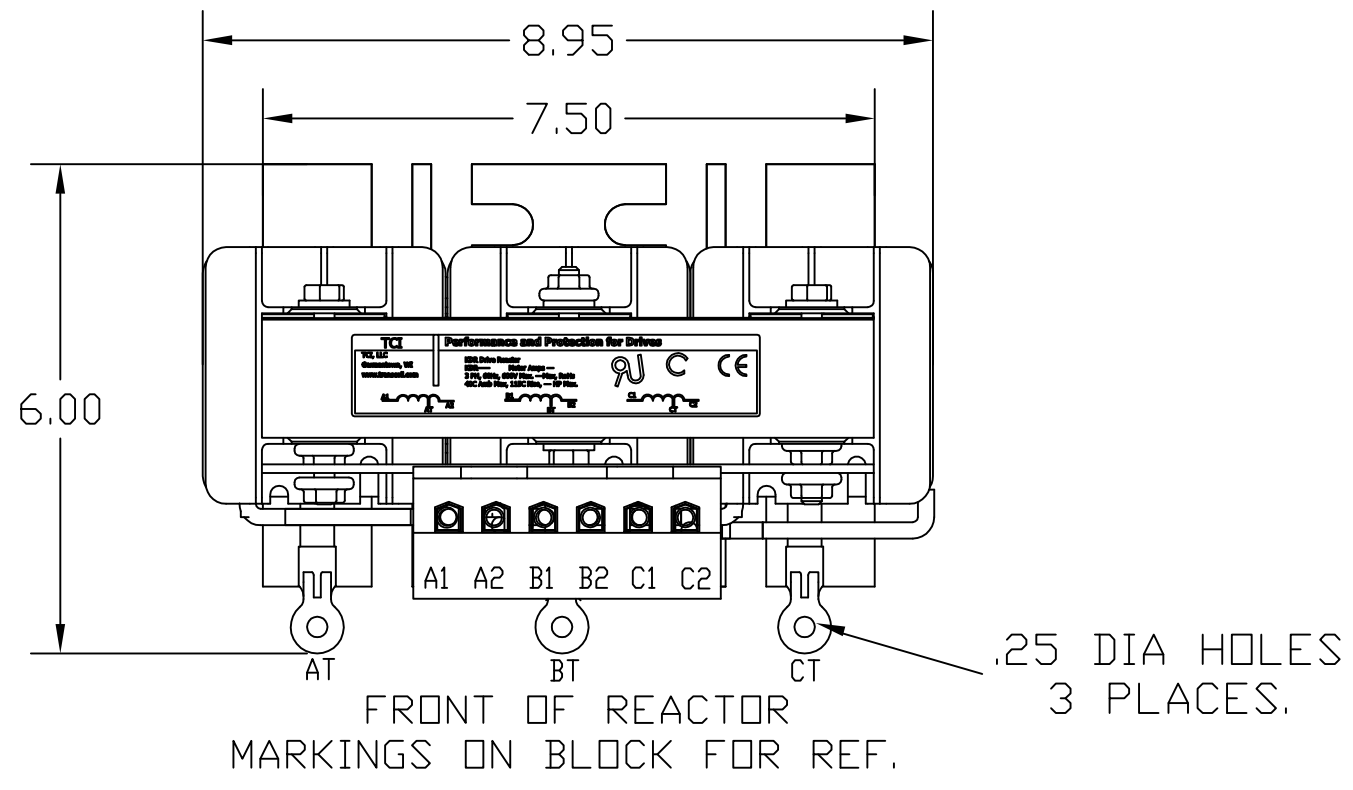
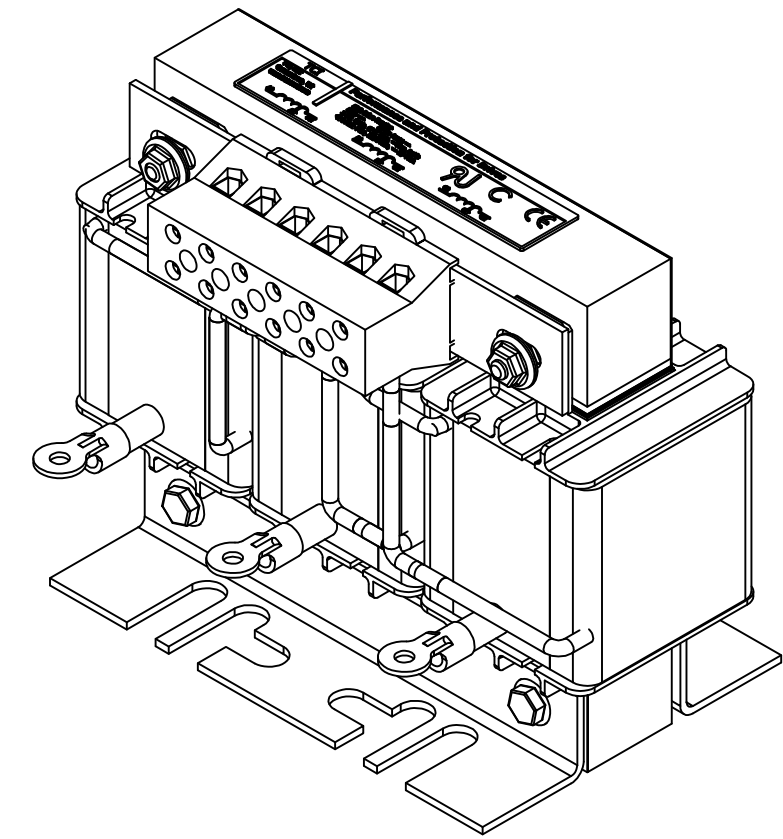



HP	CATALOG NO	RATED AMPS(A)	MAX. AMP(S)(A)	APPROX WT-LBS
25	KDRF7TT	24.3	34	30

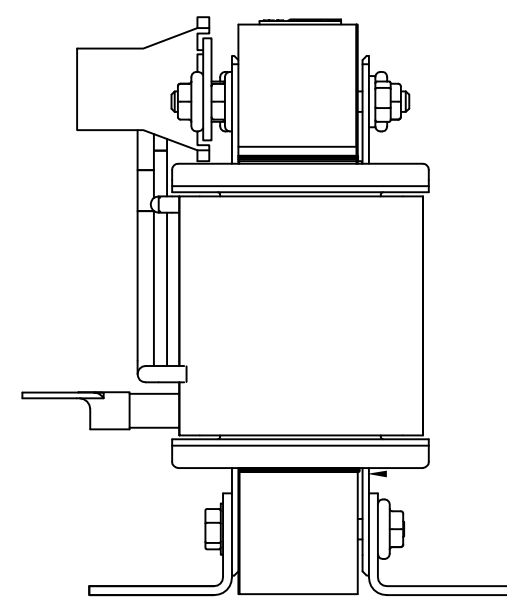

A1 AT A2 B1 BT B2 C1 CT C2

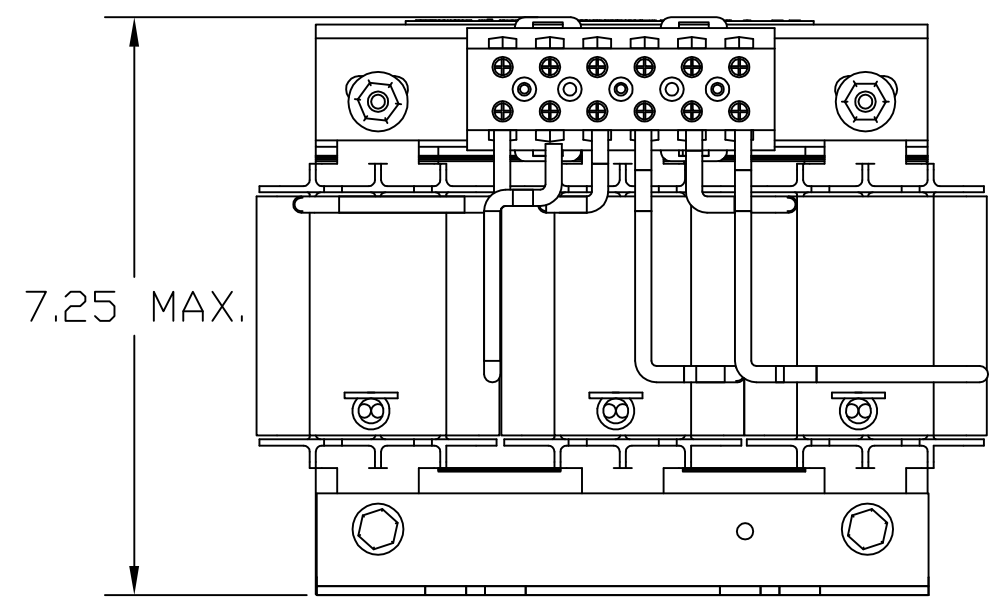

TORQUE(LB-IN)=CUSTOMER WIRE
 35=1 AWG THRU 4 AWG
 30=6 AWG THRU 14 AWG
 25=16 AWG THRU 20 AWG
 20=22 AWG

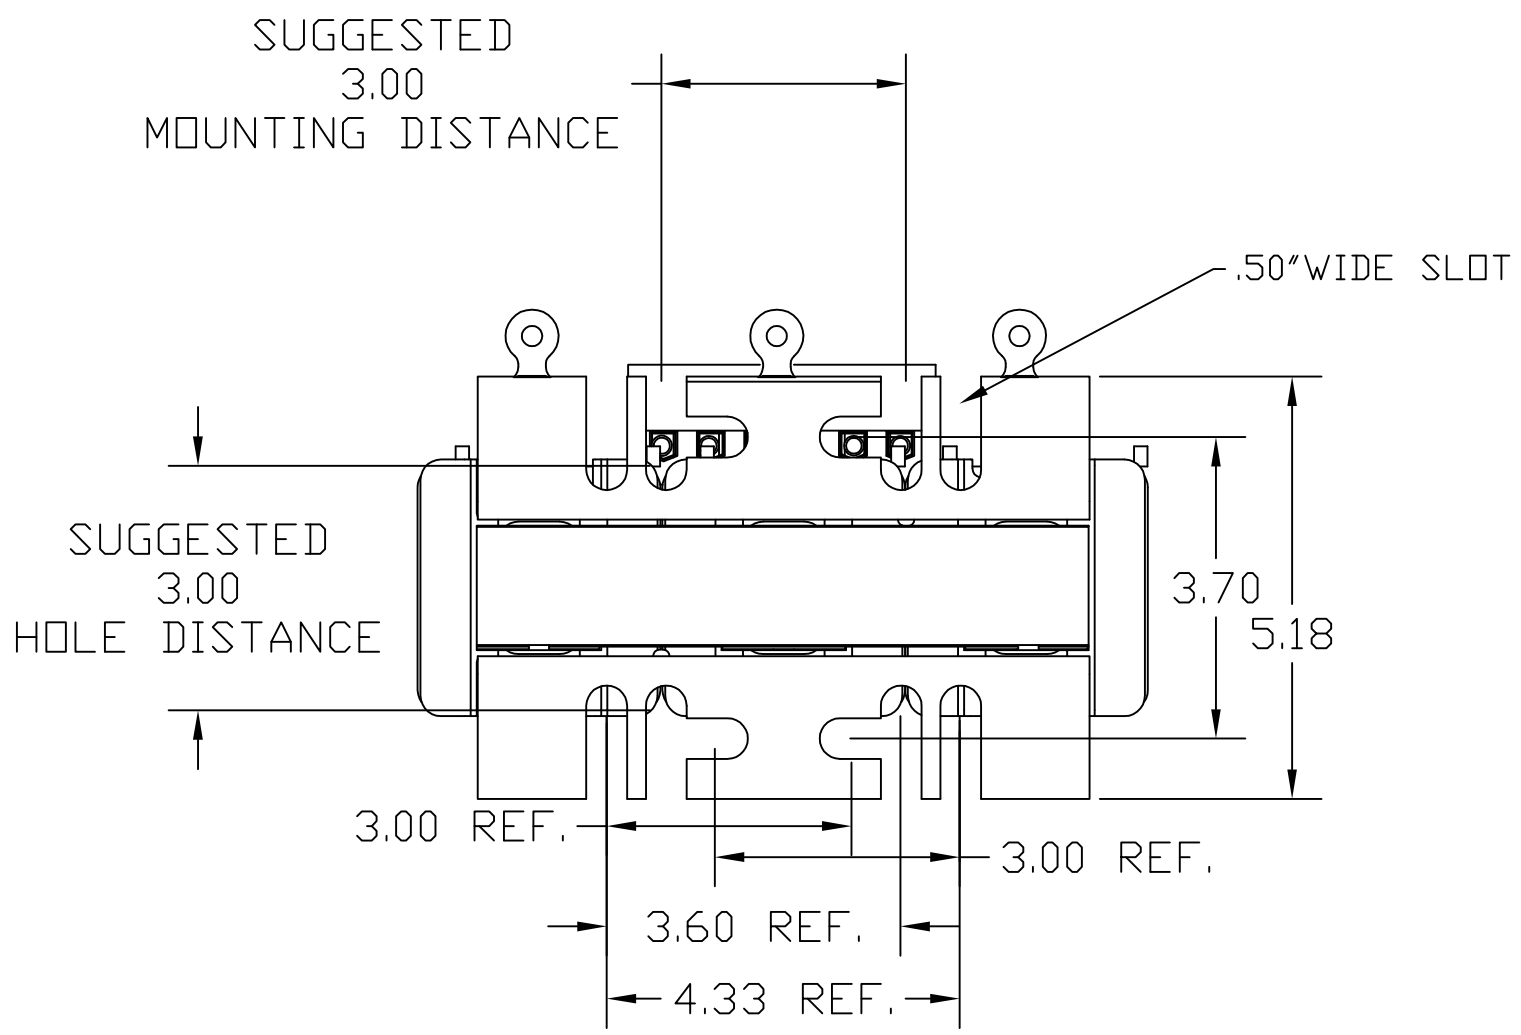

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	DECIMAL	ANGULAR	SCALE	DRN. BY	DATE	APRVD.	DWG. NO.	SHT.	OF
B	3600, 7.25 MAX WAS 6.89	5/4/16	DSW	.XX ± .05			TO FIT	DSW	6/20/2013		105301DG	1	1
A	3501, UPDATE RATING, WAS 25.3	2/15/16	DSW	.XXX ± .025									
				FRACTIONAL ± 1/16									
				± 1°									

TCL W132 N10611 Grant Drive
 Germantown, WI 53022

KDRF7TT, 25HP
 HGP FILTER REACTOR

SCALE TO FIT