


NOTE: A1, A2, B1, B2, C1, C2, TERMINAL BLOCK FOR REFERENCE ONLY.

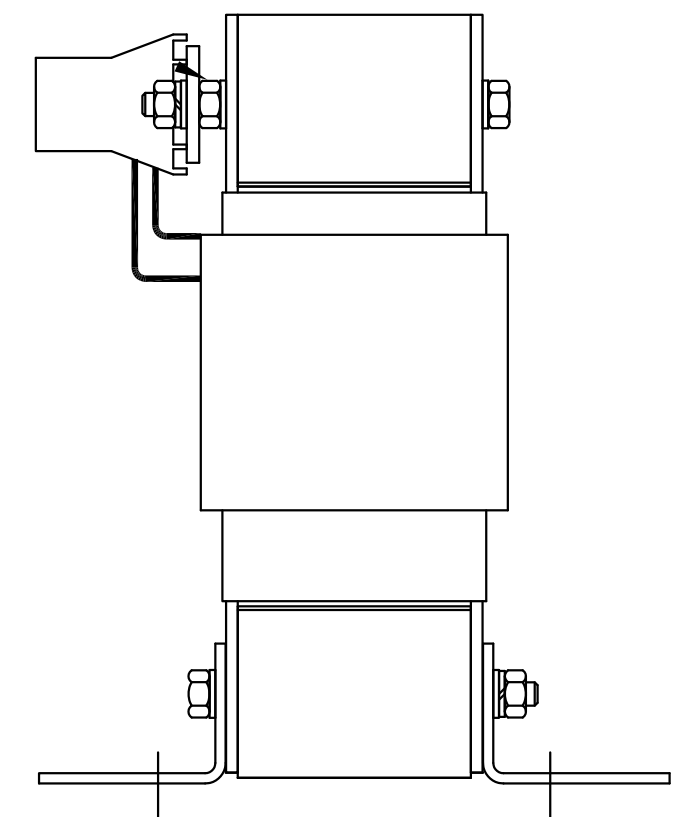

CATALOG NO	--mH ±10%	--AMPS(A)	APPROX WT-LBS
KDRG31T	1.23	60	55

TCI TRANS-COIL, INC MILWAUKEE WI WWW.transcoil.com 800-824-8282	Performance and Protection for Drives.		
	KDR Drive Reactor CATALOG# Motor Amps --- 3PH, 60Hz, 600V Max, --- A Max. 40C Amb Max, 155C Rise		

TERMINAL BLOCK
 TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
 30 = 6 AWG THRU 14 AWG
 25 = 16 AWG THRU 20 AWG
 20 = 22 AWG

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED):	W132 N10611 Grant Drive Germantown, WI 53022	
				DECIMAL		KDRG31T, LINE REACTOR 60A, 400V, 30kW.
					FRACTIONAL	
					ANGULAR	SCALE TO FIT SIZE C SHT. 1 OF 1