


HP	CATALOG NO	--mH ±20%	--AMPS(A)	APPROX WT-LBS
60	KDRG42T	1.48	62	60

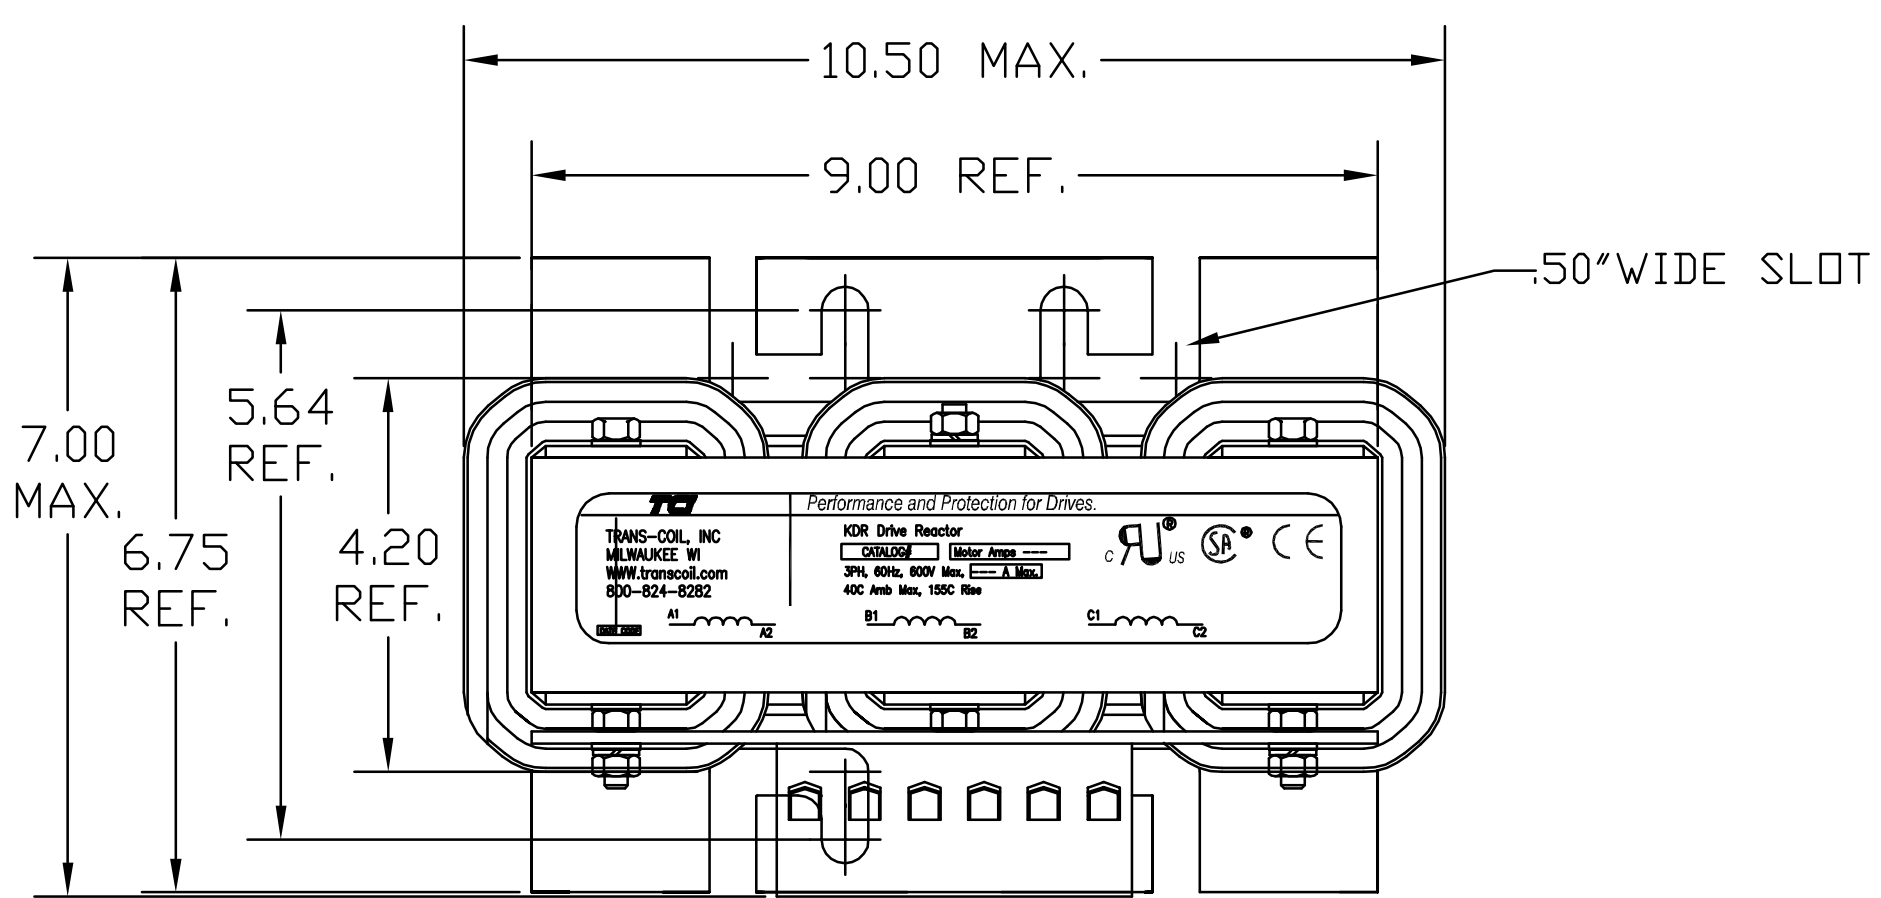



TCI Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282

KDR Drive Reactor
CATALOG# Motor Amps ---
3PH, 60Hz, 600V Max, --- A Max.
40C Amb Max, 155C Rise

UL[®] US SP[®] CE



A1 A2 B1 B2 C1 C2

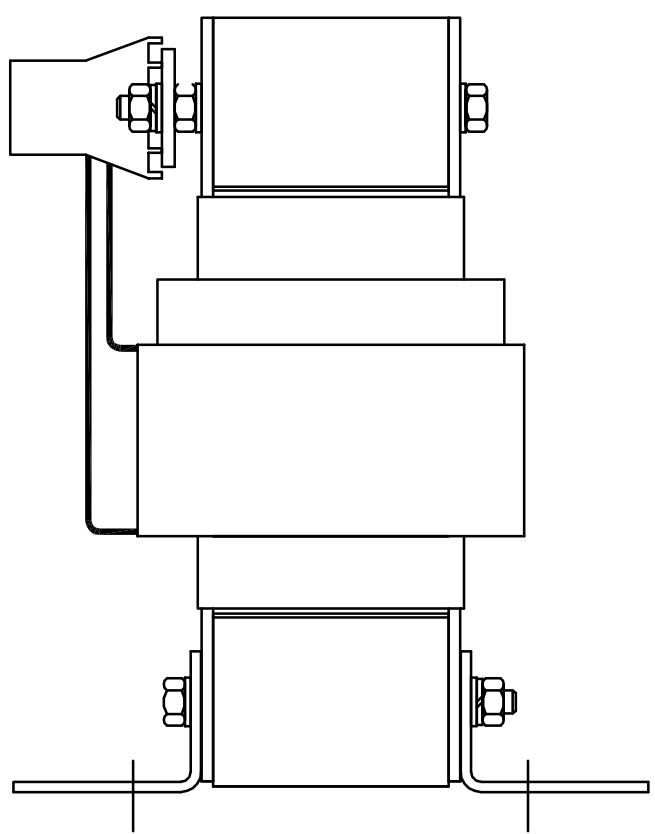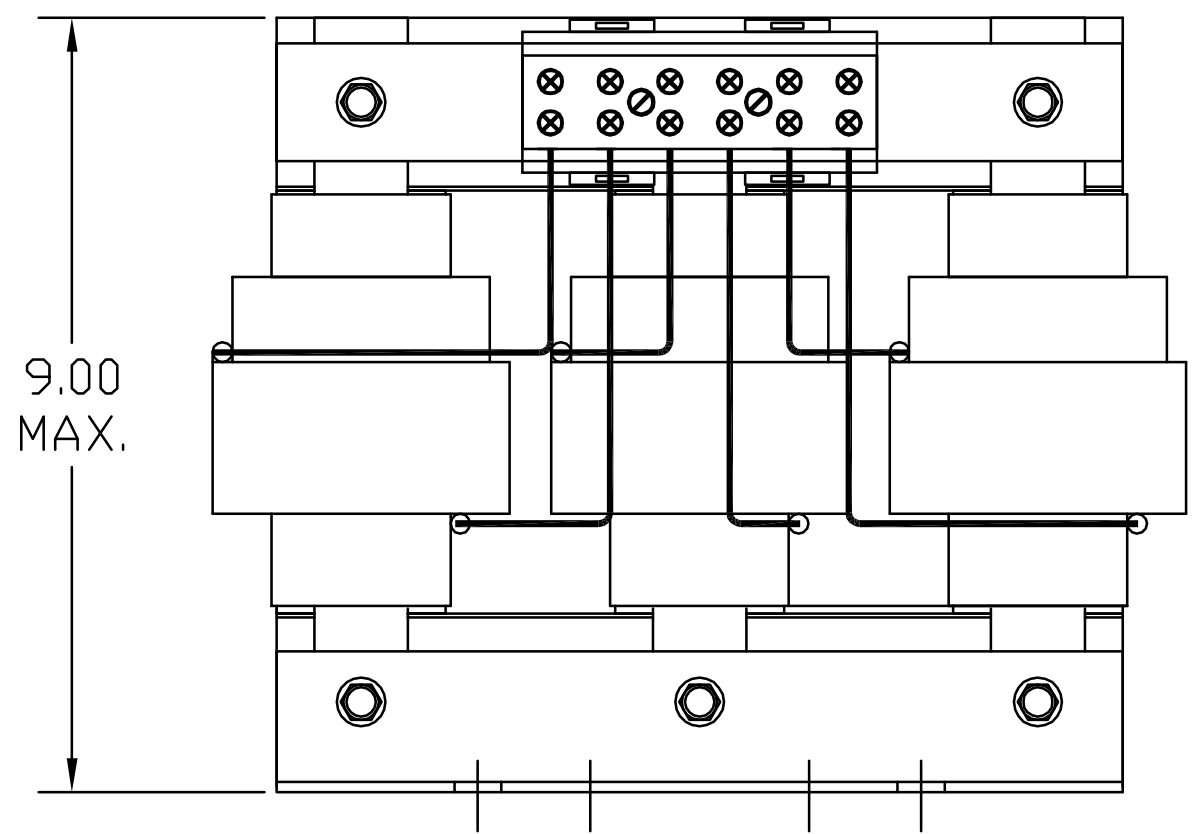

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 16 AWG

NOTE: A1, A2, B1, B2, C1, C2,
TERMINAL BLOCK
FOR REFERENCE ONLY.

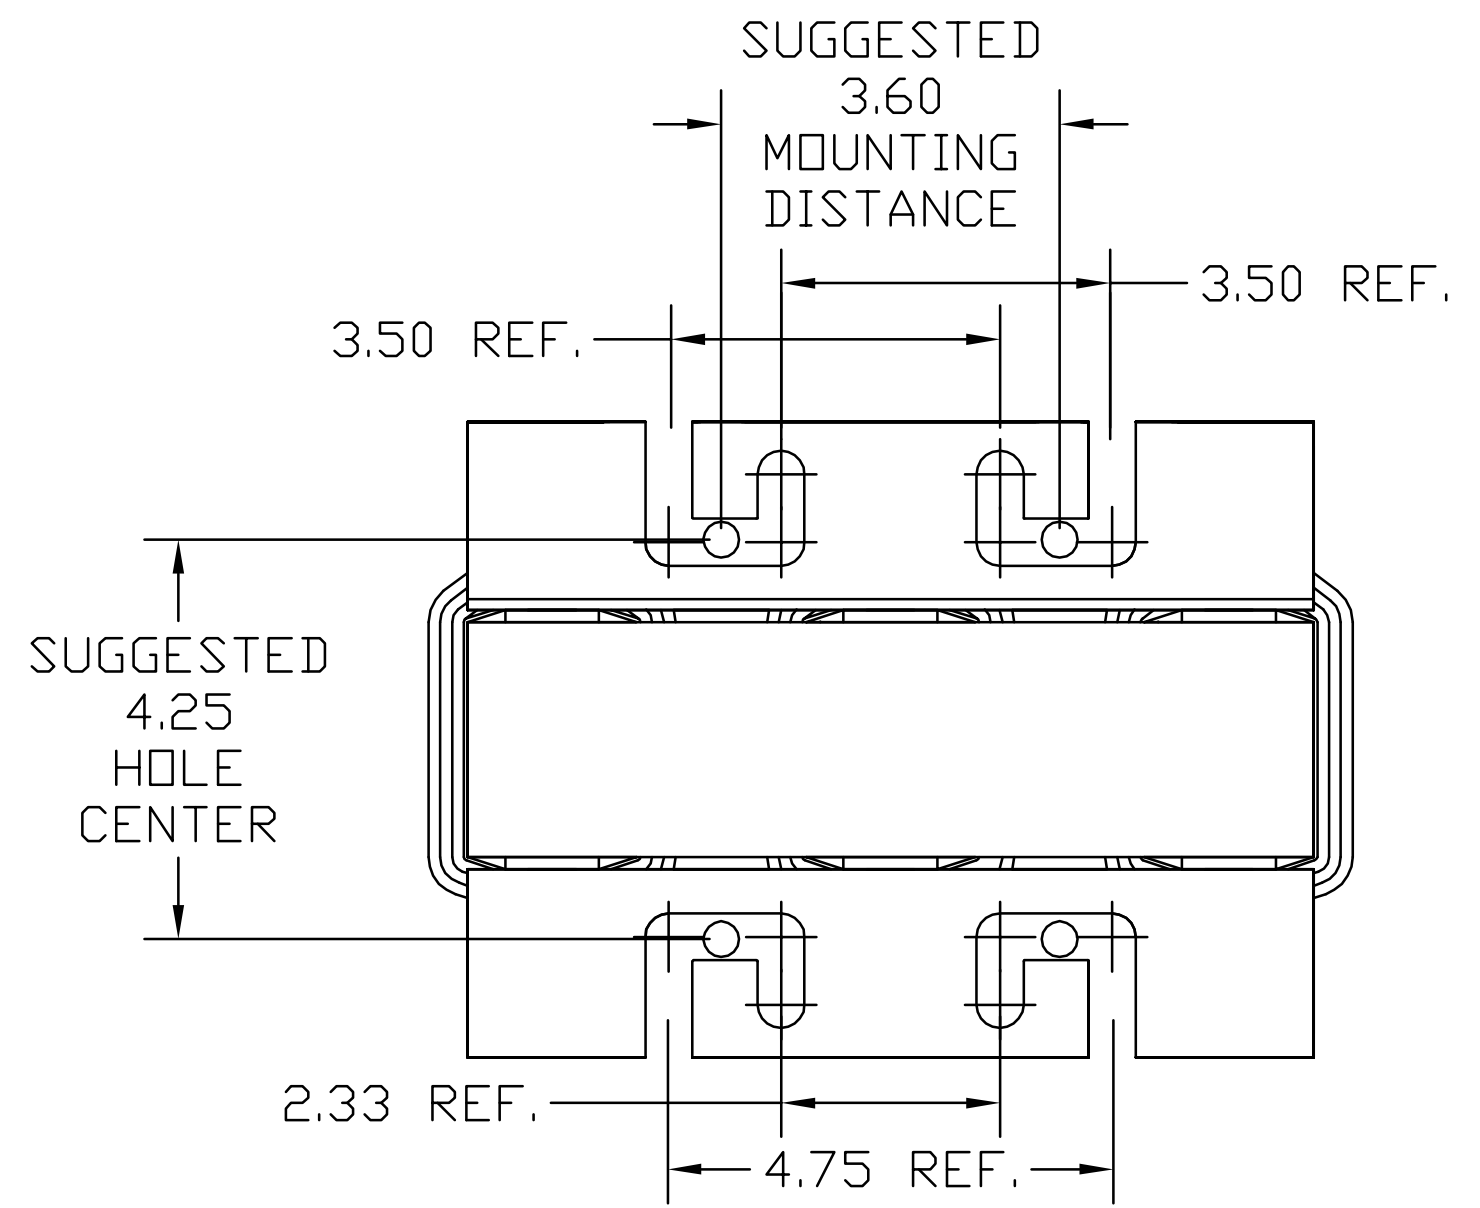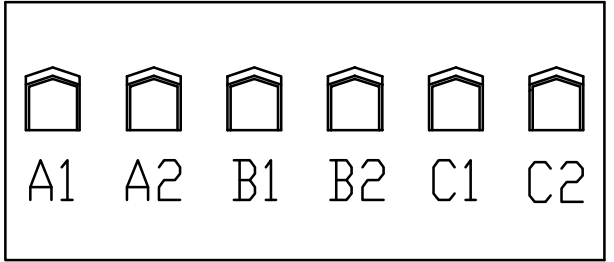

TCI, LLC CLAIMS
PROPRIETARY RIGHTS IN
THE MATERIAL HEREIN
DISCLOSED. IT IS
SUPPLIED WITHOUT
PREDJUDICE TO ANY
PATENT RIGHTS OF TCI
AND MAY NOT BE
REPRODUCED OR USED
TO MANUFACTURE
ANYTHING SHOWN
THEREIN WITHOUT
WRITTEN PERMISSION
FROM TCI.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ±.03 .XXX ±.01 FRACTIONAL ± 1/16 ANGULAR ± 1/2°
----	----------	------	----	--

TCI W132 N10611 Grant Drive
Germantown, WI 53022

KDR (FRAME G)
KDRG42T, 60HP, 600V, 10%

DRN. BY DSW DATE 2/28/05 DWG. NO. 102387DG
SCALE 1/2"=1" SIZE C SHT.1 OF 1