



HP	CATALOG NO	--mH ±20%	--AMPS(A)	APPROX WT-LBS
30	KDRH41T	2.87	32	40



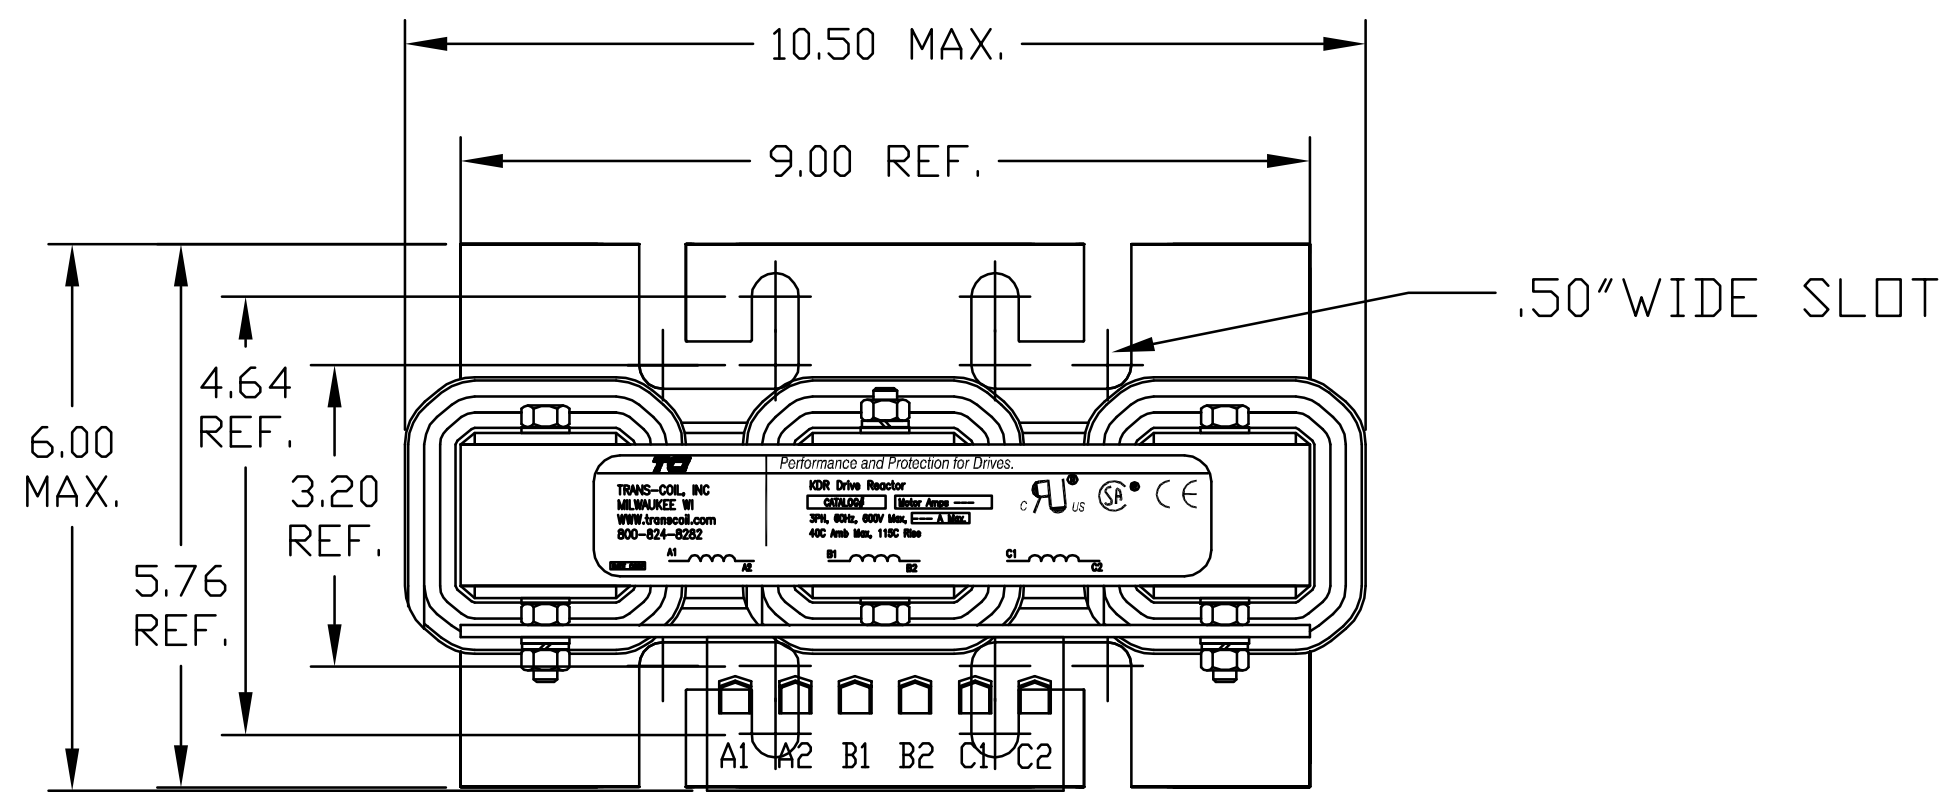


TCI TRANS-COIL, INC MILWAUKEE WI WWW.transcoil.com 800-824-8282	Performance and Protection for Drives.		
	KDR Drive Reactor CATALOG# <input type="text"/> Motor Amps <input type="text"/> 3PH, 60Hz, 600V Max, <input type="text"/> A Max. 40C Amb Max, 115C Rise		

NOTE: A1, A2, B1, B2, C1, C2,
TERMINAL BLOCK
FOR REFERENCE ONLY.

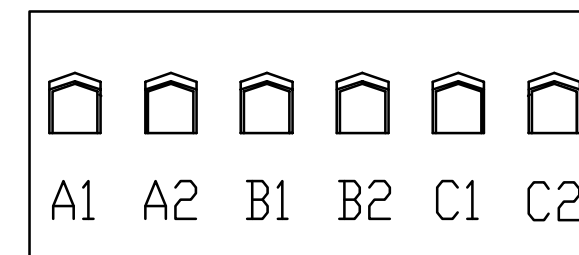

TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE
35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

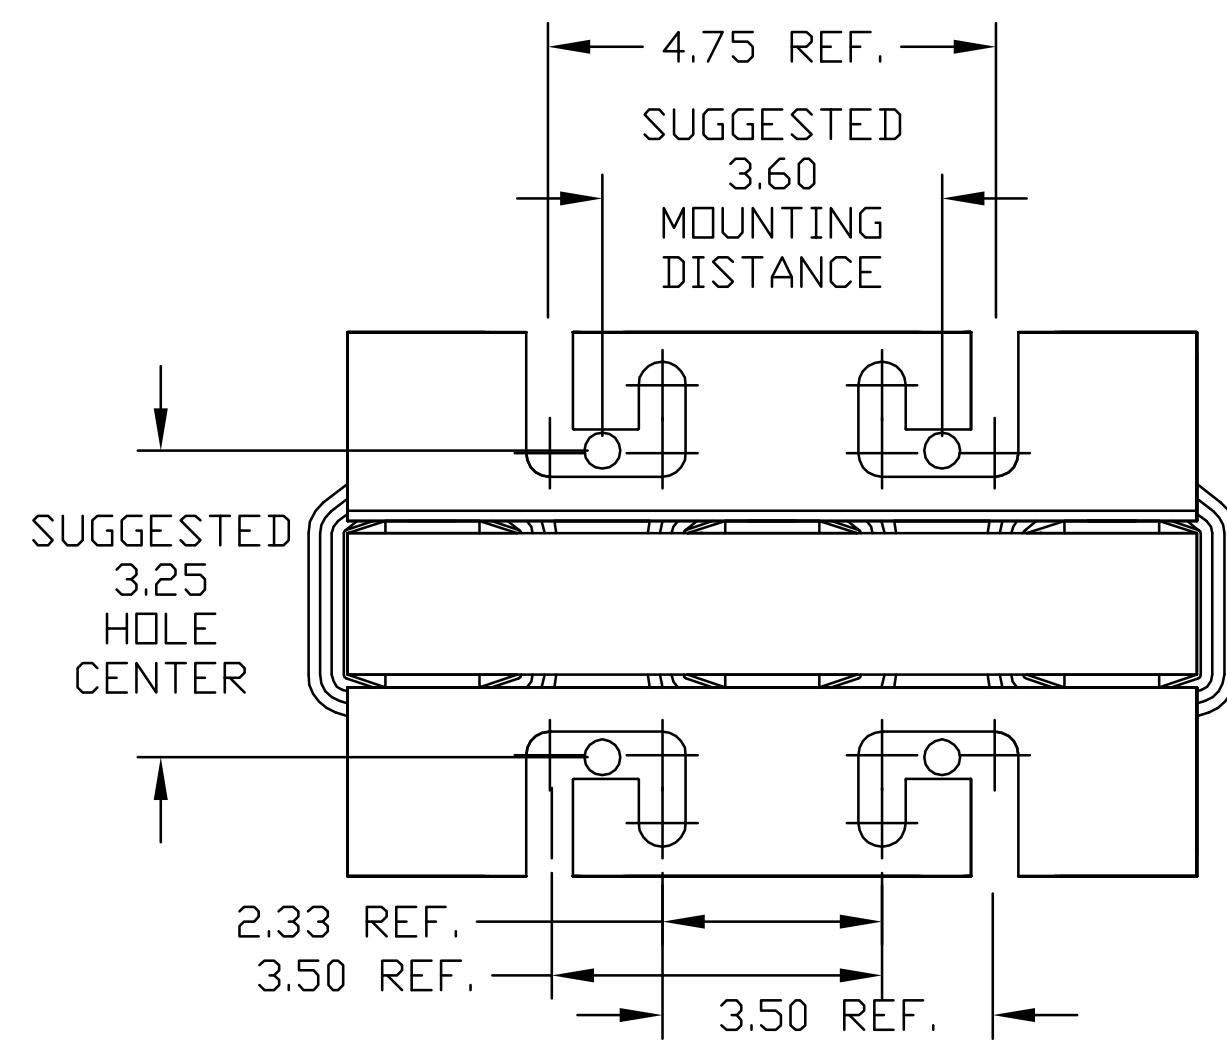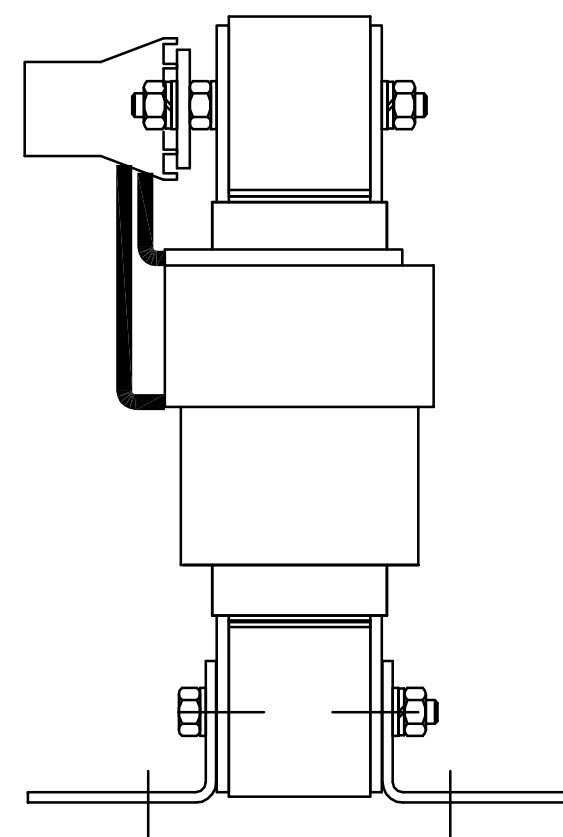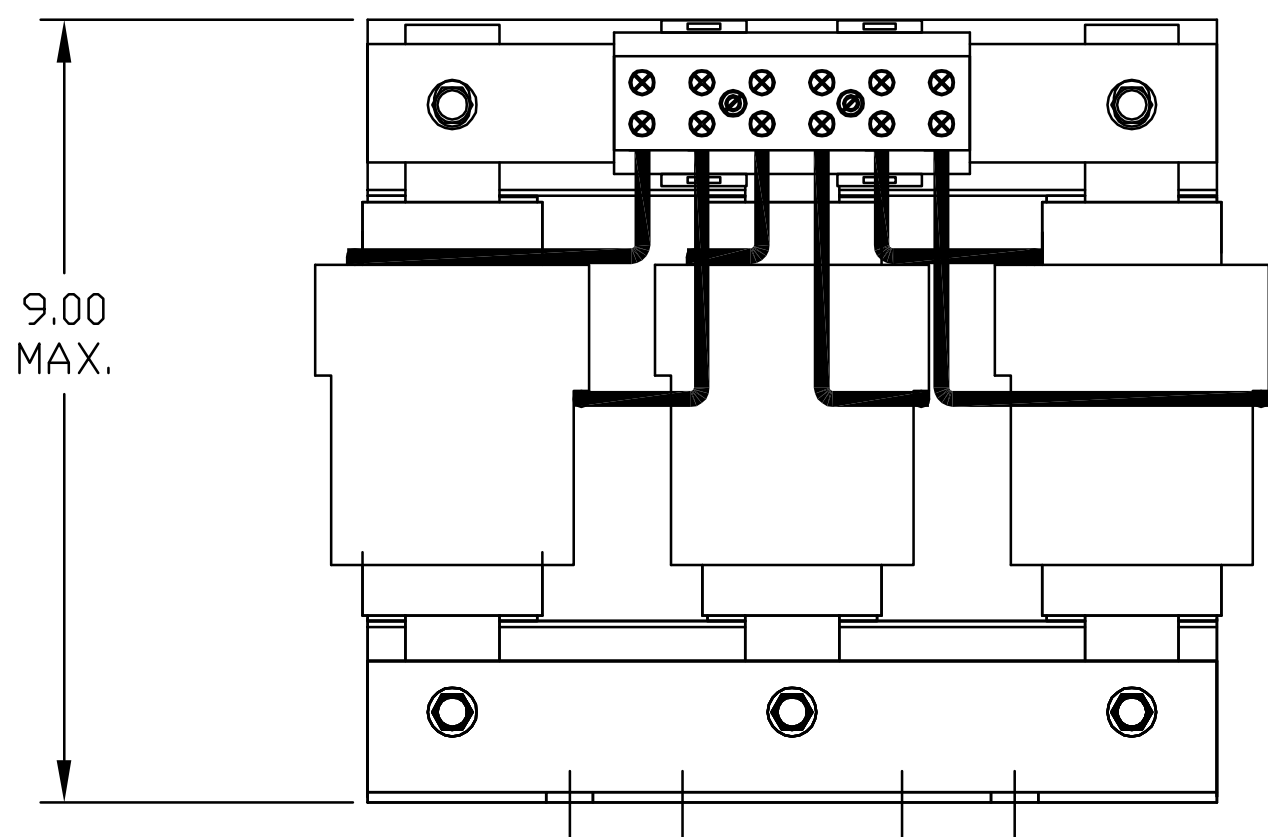

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ±10% .XXX ±.01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	W132 N10611 Grant Drive Germantown, WI 53022
					KDR (FRAME H) KDRH41T, 30HP, 600V, 10	
					DRN. BY DSW DATE 2/24/05 DVG. NO. 102368DG SCALE TO FIT SIZE C	SHT. 1 OF 1
	NO	REVISION	DATE	BY		