

HP	CATALOG NO	--mH ±20%	--AMPS(A)	APPROX WT-LBS
40	KDRI41T	2.24	41	51



TCI
 TRANS-COIL, INC
 MILWAUKEE WI
 WWW.transcoil.com
 800-824-8282

Performance and Protection for Drives.


KDR Drive Reactor
 CATALOG# Motor Amps ---
 3PH, 60Hz, 600V Max, --- A Max.
 40C Amb Max, 155C Rise

UL[®] US SA[®] CE

A1 A2 B1 B2 C1 C2

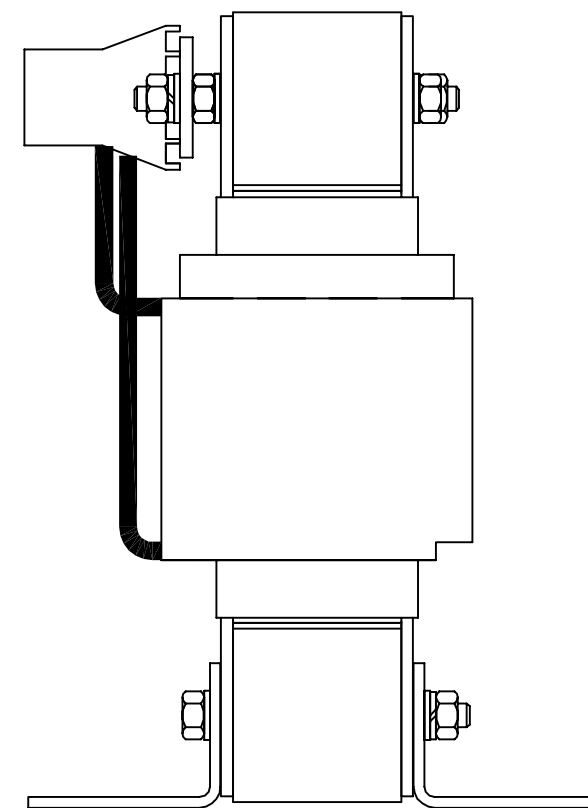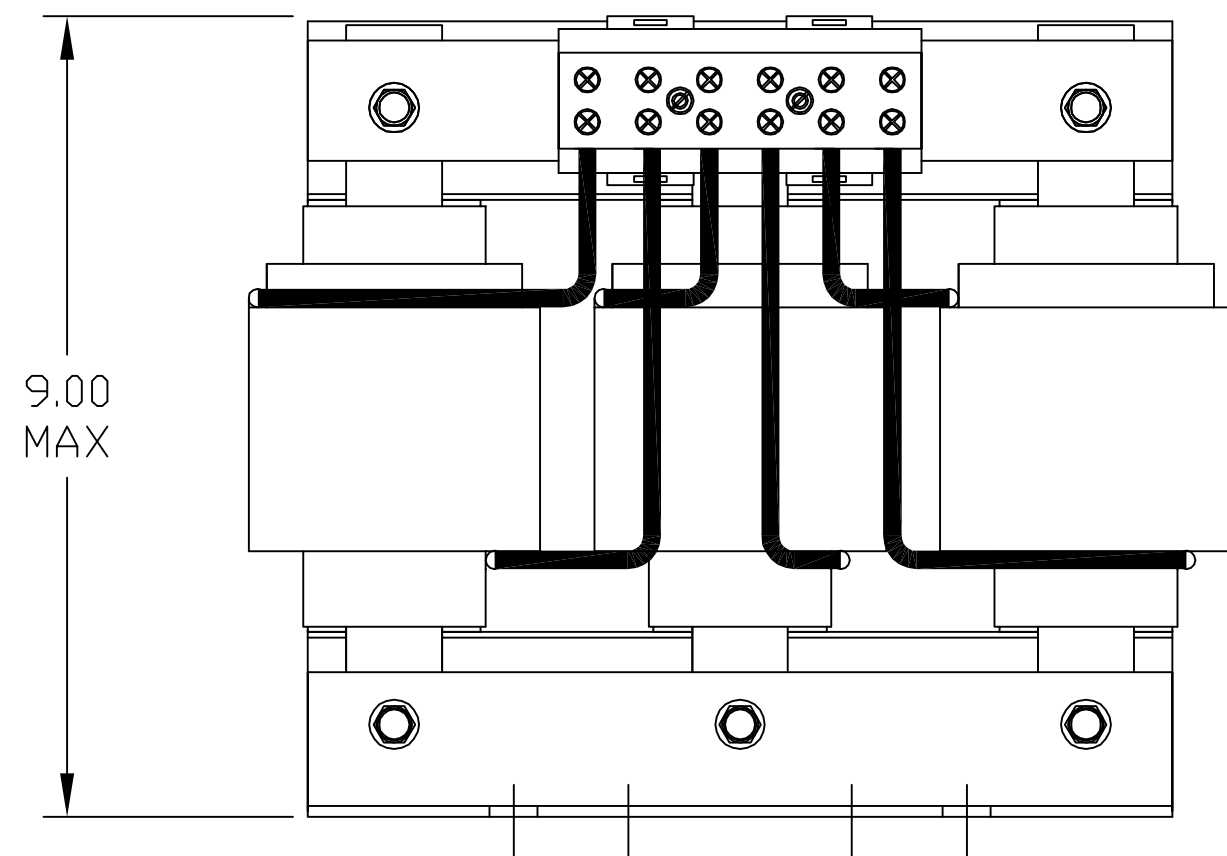


NOTE: A1, A2, B1, B2, C1, C2, TERMINAL BLOCK FOR REFERENCE ONLY.

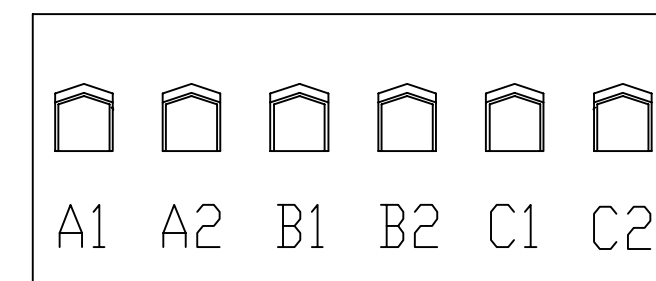

TERMINAL BLOCK
 TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
 30 = 6 AWG THRU 14 AWG
 25 = 16 AWG THRU 22 AWG

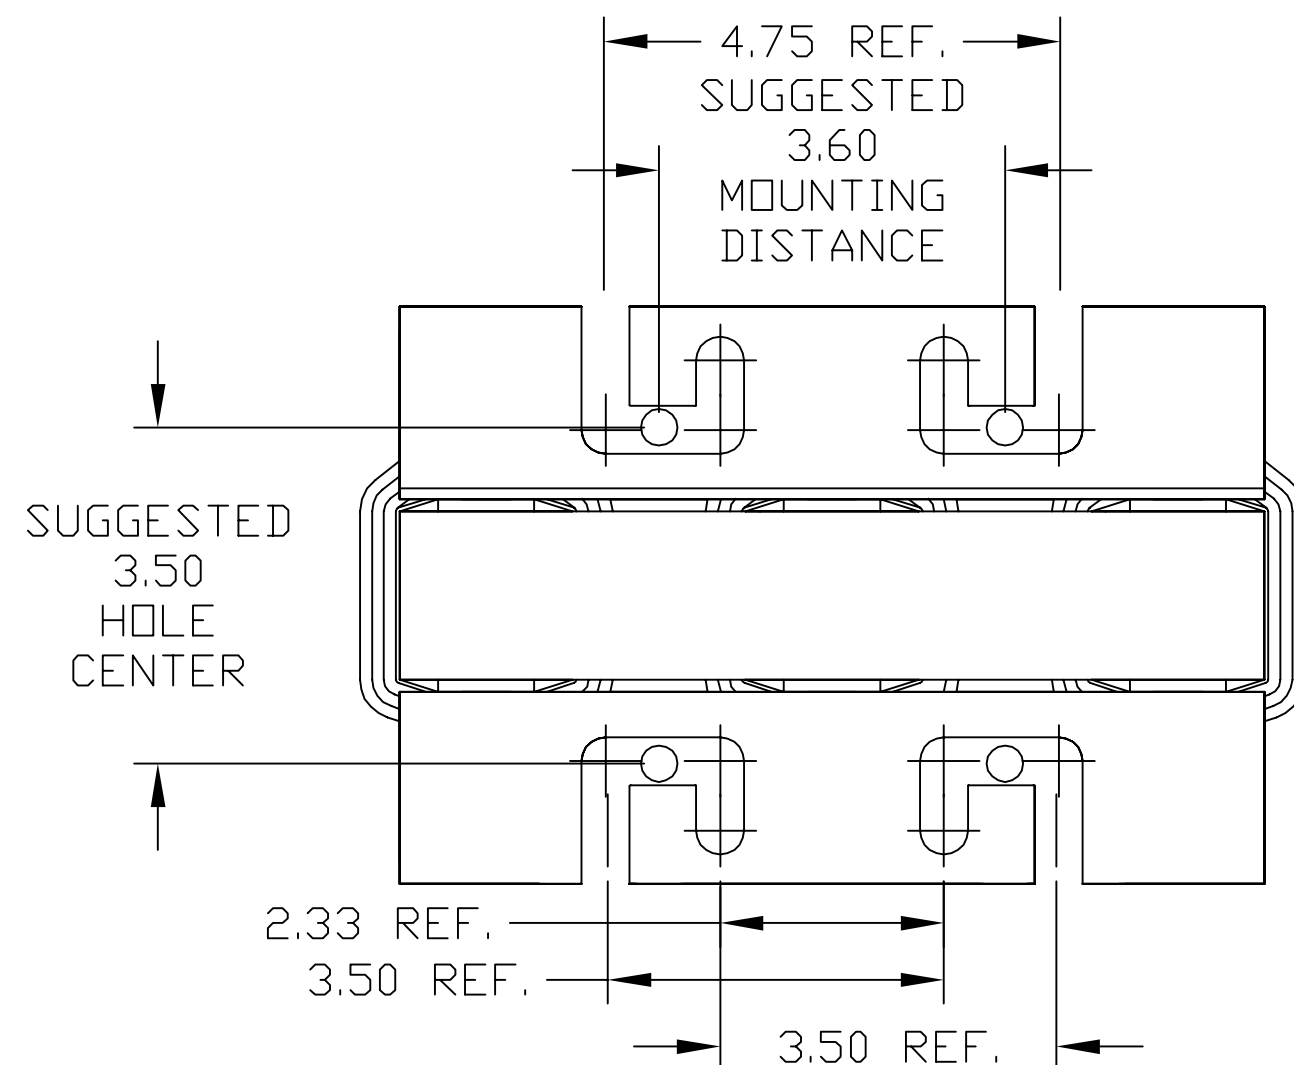

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED): DECIMAL	W132 N10611 Grant Drive Germantown, WI 53022	
				.XX ±.03 .XXX ±.01		
	B	2661 ADD CE TO LABEL	2/24/10	DSW	FRACTIONAL ± 1/32	TRAP REACTOR KTR10C65HG, 30HP, 600V
	A	2565, TOLERANCE CHG.	11/13/08	DSW	ANGULAR ± 1/2°	
NO	REVISION	DATE	BY	SCALE TO FIT	DRN. BY DSW DATE 1/31/05 DWG. NO. 102375DG SIZE C SHT. 1 OF 1	