


HP	CATALOG NO	RATED AMPS(A)	MAX AMPS(A)	APPROX WT-LBS
40	KDRI41TT	30.93	41	50

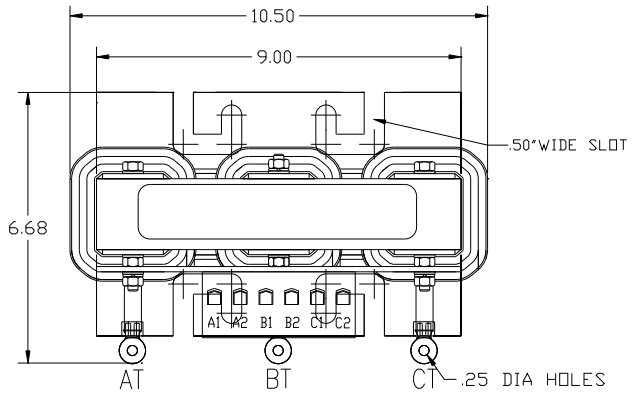

TCL Performance and Protection for Drives.




TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282

KDR Drive Reactor
REACTOR Motor Amps ---Max.
3PH, 60Hz, 600V Max, ---A Rated
40C Amb Max, 155C Rise

UL US CE


W132000 A1 A2 B1 B2 C1 C2

NOTE: A1, AT A2, B1, BT, B2, C1, CT C2, TERMINAL BLOCK AND COIL FOR REFERENCE ONLY.

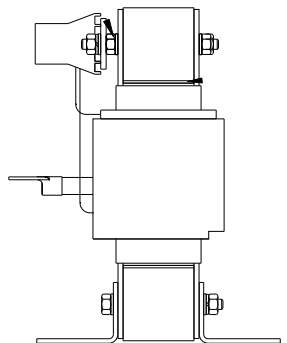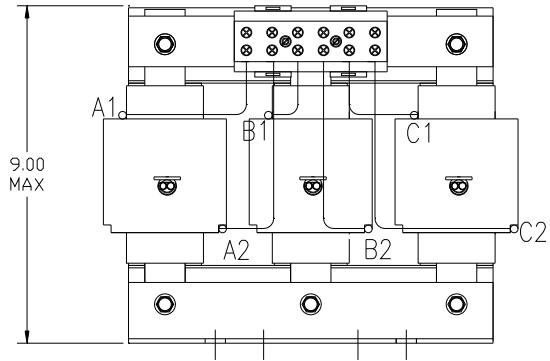

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

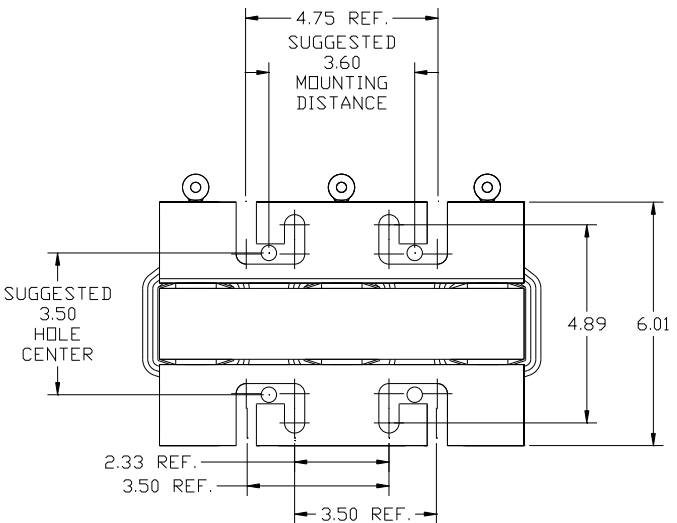

<p>TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.</p>	NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	<p>TCL W132 N10611 Grant Drive Germanstown, WI 53022</p> <p>KDRI41TT, 600V 40HP, HGP FILTER REACTOR</p> <p>DRN BY DSW DATE 5/29/2014 DWG. NO. 105665DG SCALE TO FIT SIZE C SHT. 1 of 1</p>