

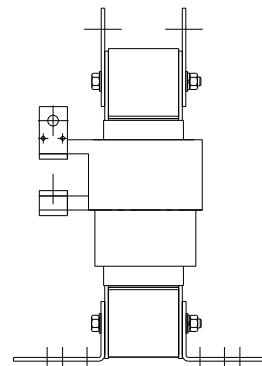


HP	CATALOG NO	--mH ±20%	--AMPS(A)	APPROX WT-LBS
125	KDRL1T	.471	156	100

.38 DIA HOLE
6 PLACES.

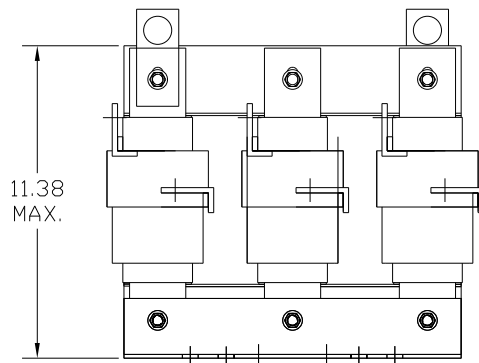

TCI TRANS-COIL, INC MILWAUKEE WI WWW.transcoil.com 800-824-8282	Performance and Protection for Drives. KDR Drive Reactor CATALOG# <input type="text"/> Motor Amps <input type="text"/>		
	3PH, 60Hz, 600V Max, <input type="text"/> A Max. 40C Amb Max, 155C Rise		
(DATE CODE) A1 A2	B1 B2	C1 C2	

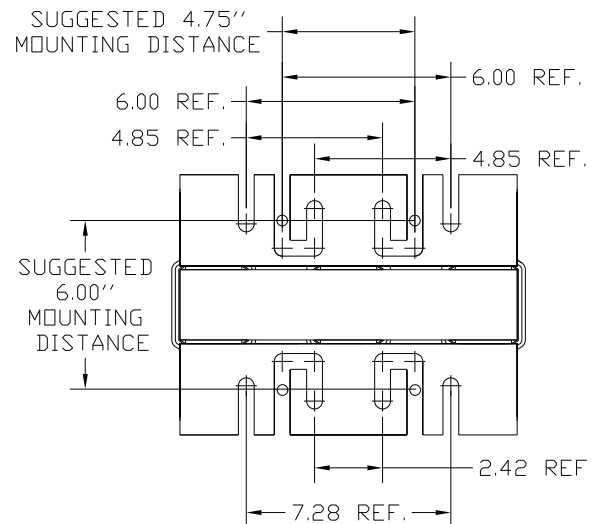

				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°		7878 N. 86th STREET MILWAUKEE, WI 53224	
				KDRL1T, 125HP 480 Volts, 156 Amps			
NO	REVISION	DATE	BY	SCALE TO FIT	DRN BY DSW	DATE 02/01/05	DWG NO 102429DG
							SHT. 1 OF 1