HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS
250	KDRS3TT	302	165

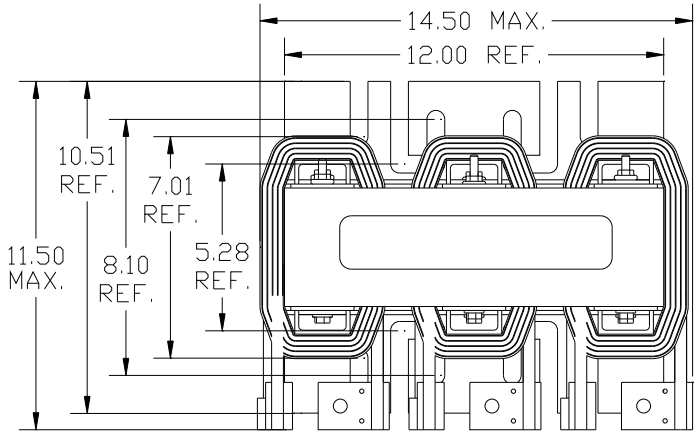

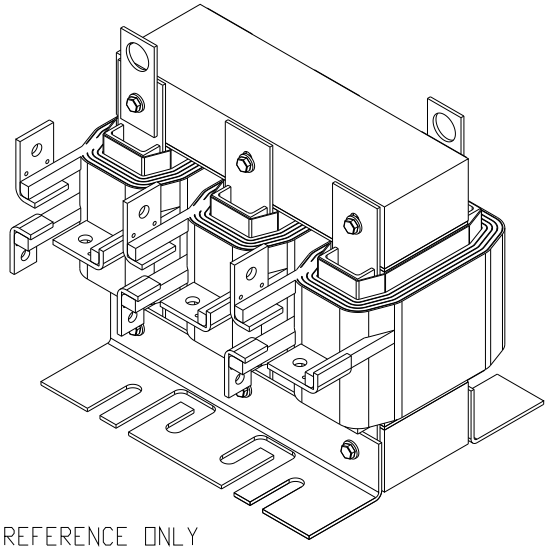

TCI — Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282

KDR Drive Reactor
REACTOR # Motor Amps ---Max.
3PH, 60Hz, 600V Max, --- A Rated.
40C Amb Max, 155C Rise

DATE CODE

A1 AT A2 B1 BT B2 C1 CT C2

A1, AT, A2, B1, BT, B2, C1, CT, C2, MARKINGS FOR REFERENCE ONLY

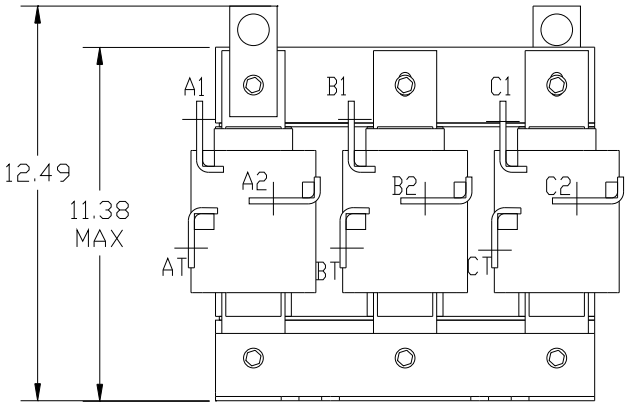

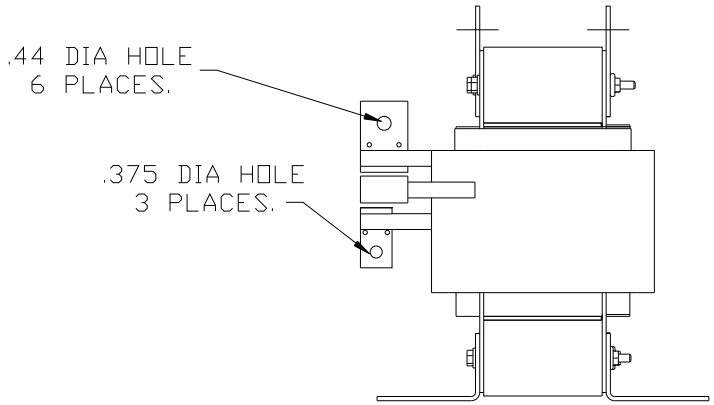

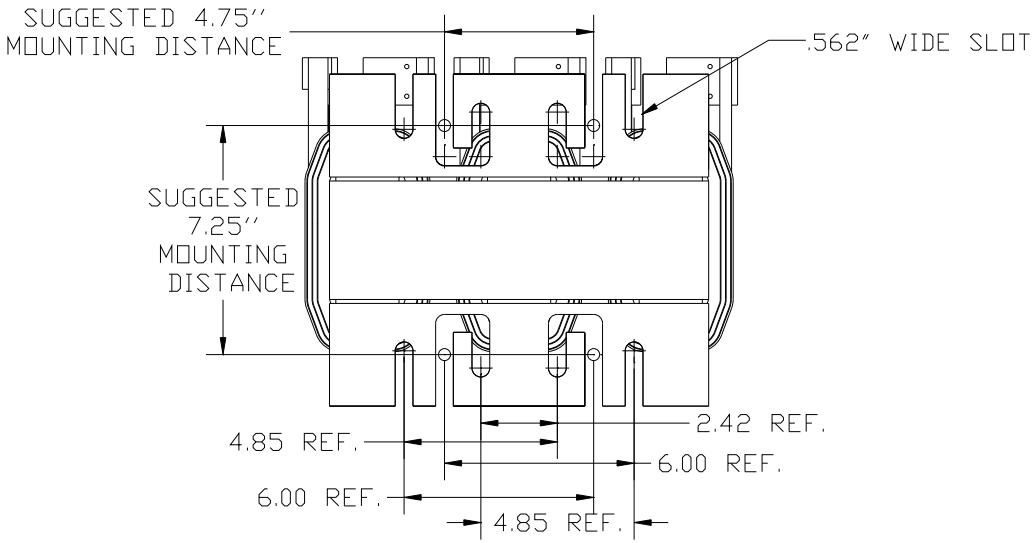

NO	REVISION	DATE	BY
2934	CHG TAP TERM	8/6/2013	DSW

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX ± .03
.XXX± .01
FRACTIONAL
± 1/32
ANGULAR
± 1/2°

TCI 7878 N. 86th STREET MILWAUKEE, WI 53224

KDRS3TT
250HP, HGP FILTER REACTOR

DRN. BY DSW | DATE 6/24/2013 | DWG. NO. C 105300DG
SCALE TO FIT | APRVD. | SHT. 1 OF 1