

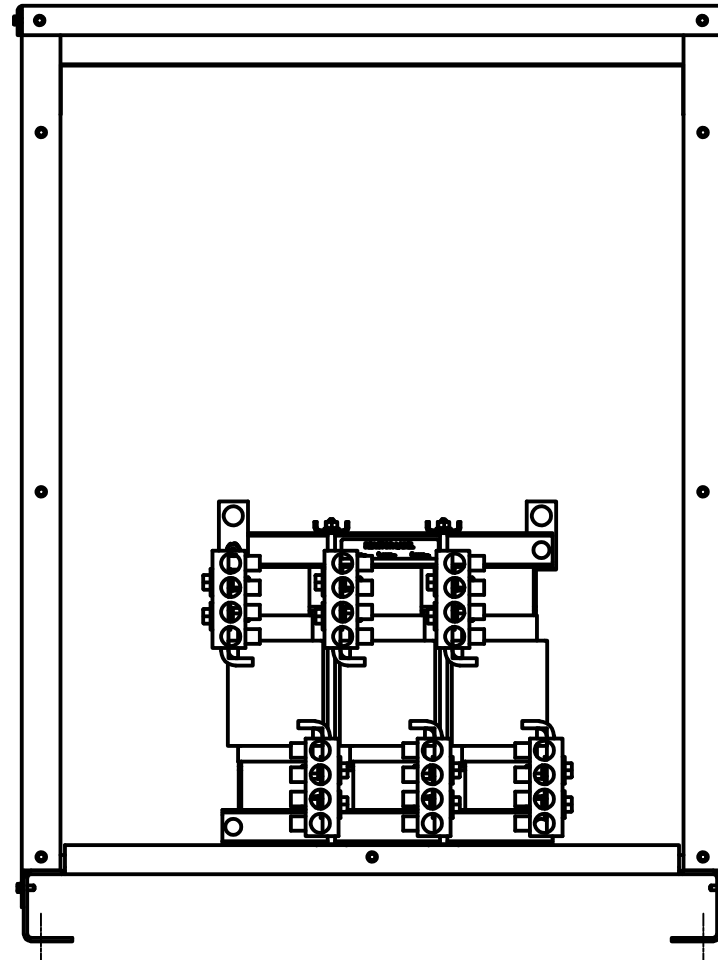
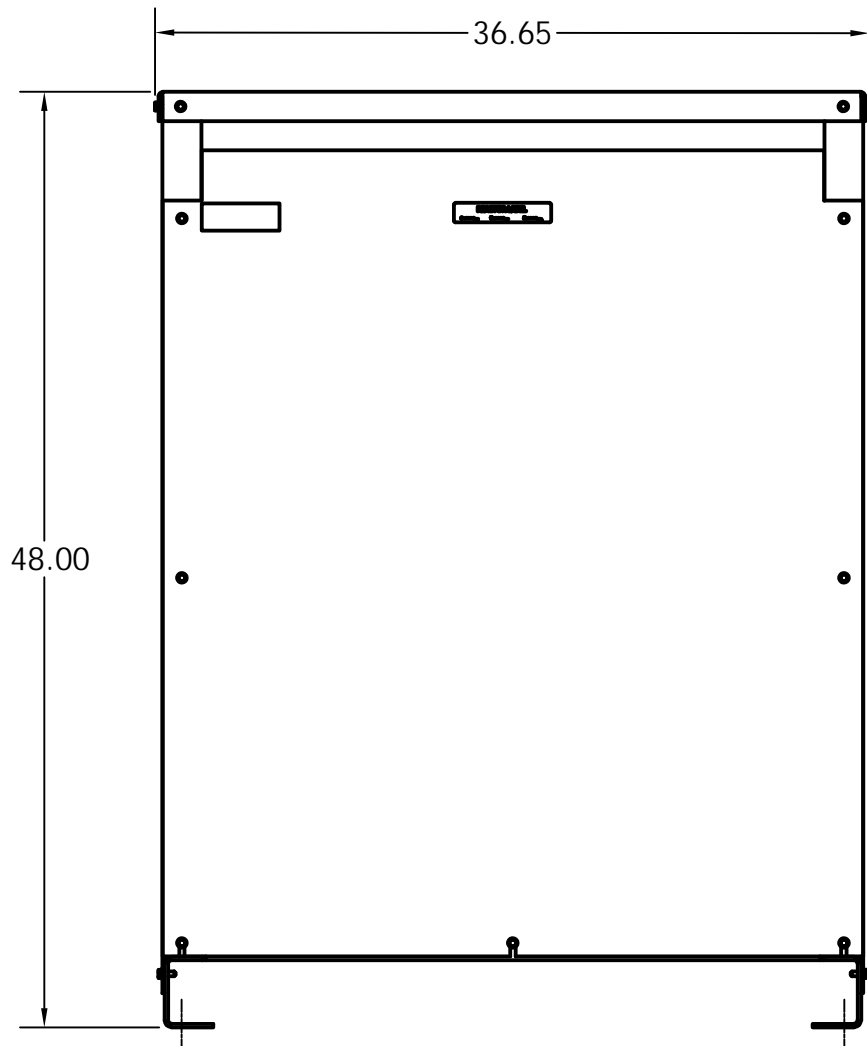
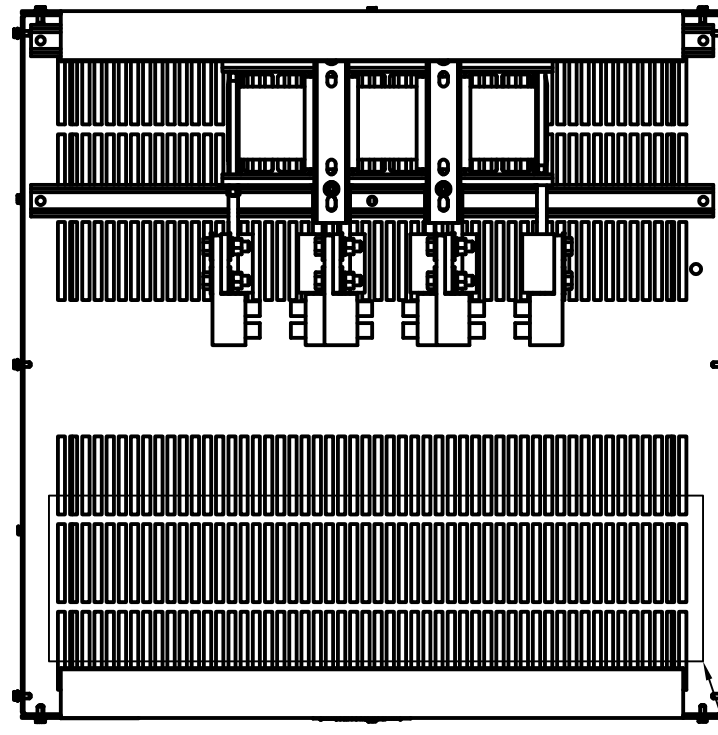
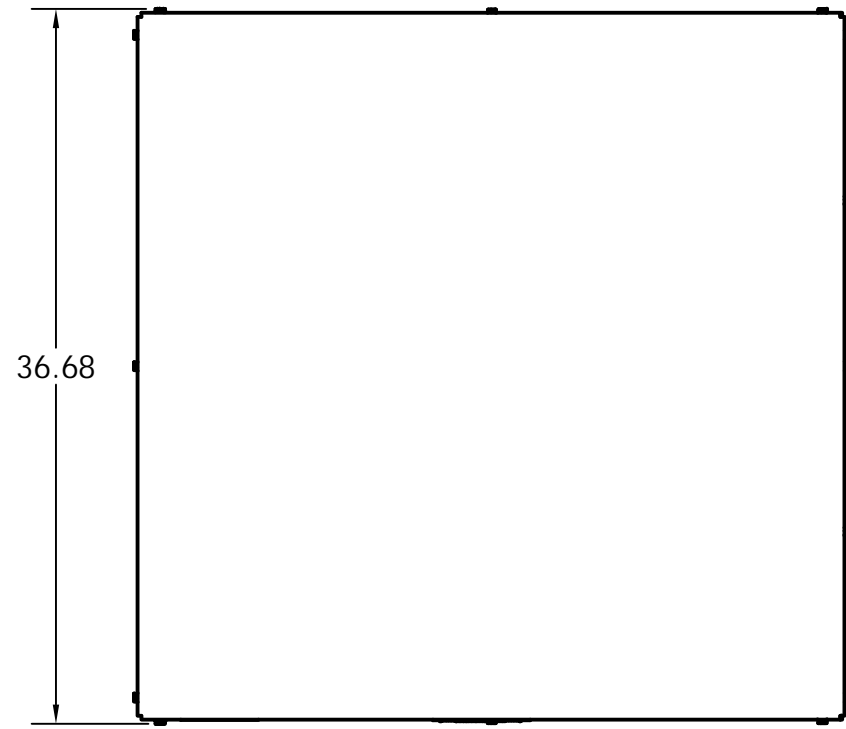


HP	TCI Part Number	Motor Amps	Amps Max.	Watts Loss	Approx Weight (LBS)
900	KDRULX3HE01	1080	1100	1869	628

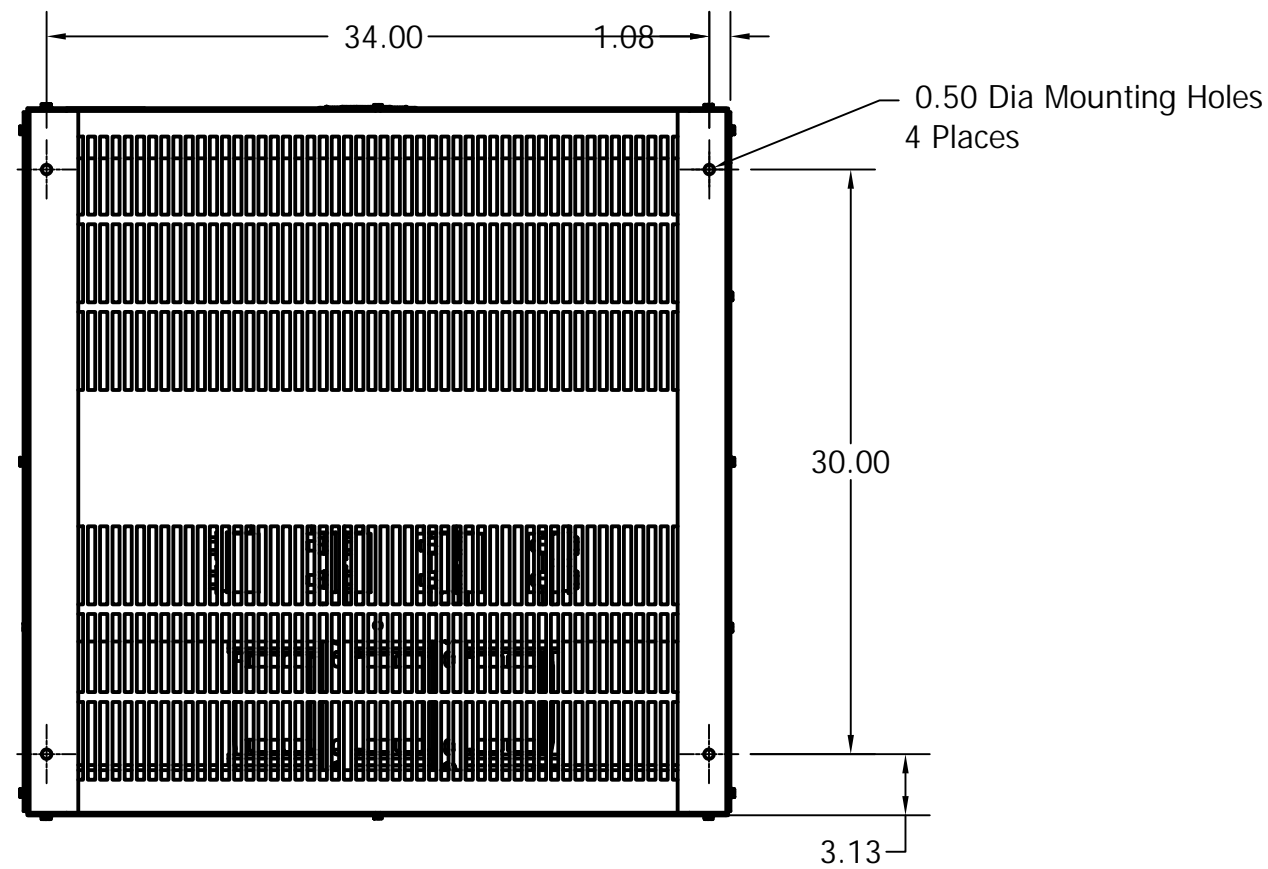

Suggested Customer Entry
Lug Wire Range: 600MCM-2AWG
See IOM Manual For Torques.

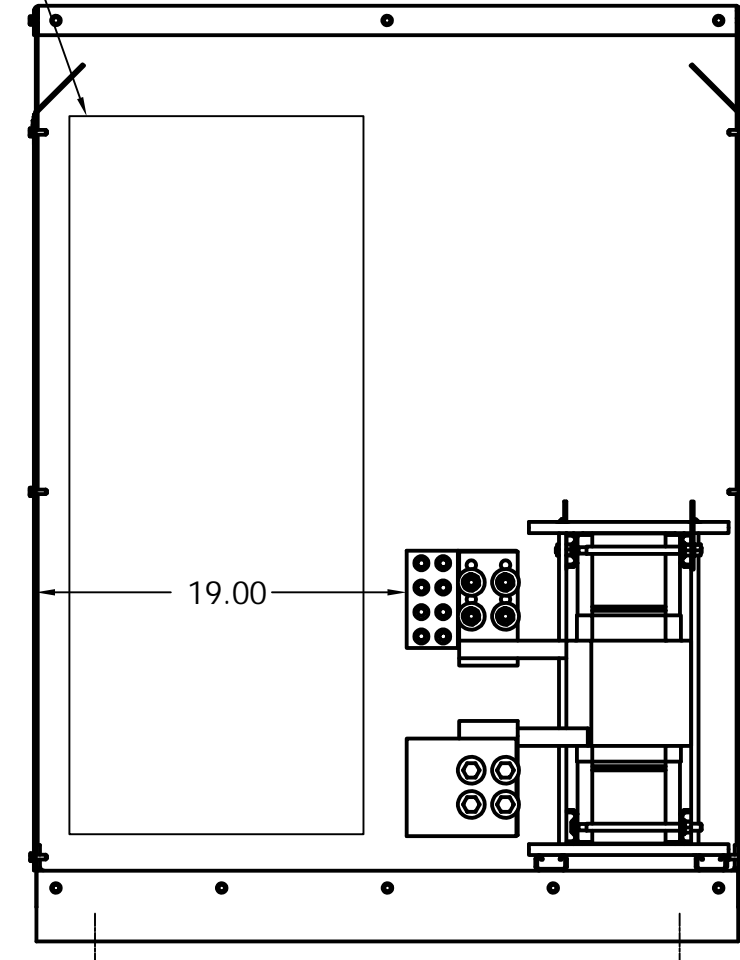

Material(s) Shall be RoHS Compliant

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	TCI W132 N10611 Grant Drive Germantown, WI 53022 KDRULX3HE01 480V, 1100A, 900HP, 3 Phase, Type 1, Input Line Reactor, High Impedance, UL Listed
				DECIMAL	
				.XX ± .25 .XXX ± .10	
				FRACTIONAL ± 1/16	
	A	4128, dwg was KDRULX3HE01	9/18/17	DSW	DRN BY: DSW SCALE: 1/4 DATE: 6/21/04 APRVD: SIZE: C 107259DG SHT 1 OF 1
	NO	REVISION	DATE	BY	
				ANGULAR ± 1°	