

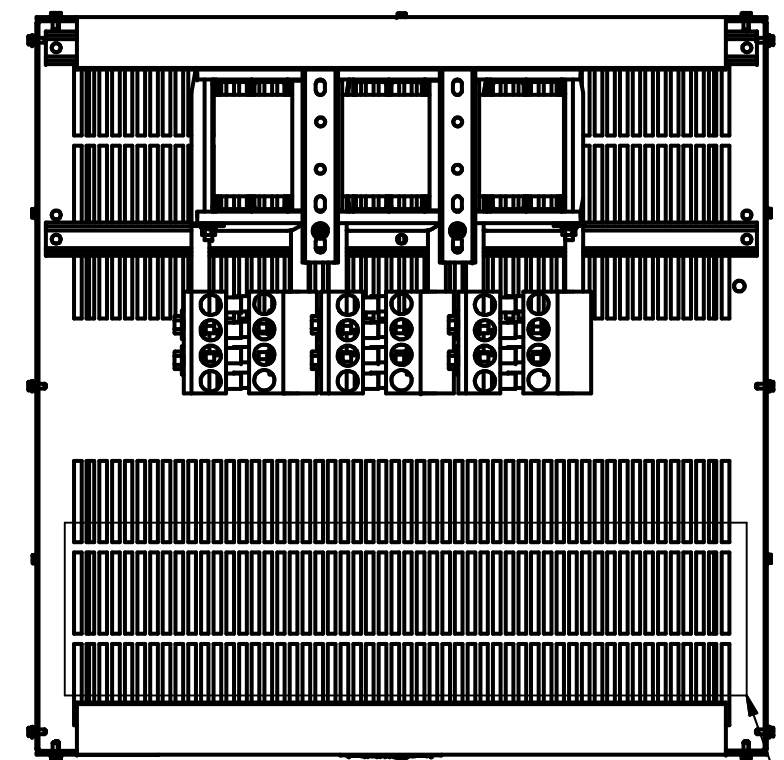
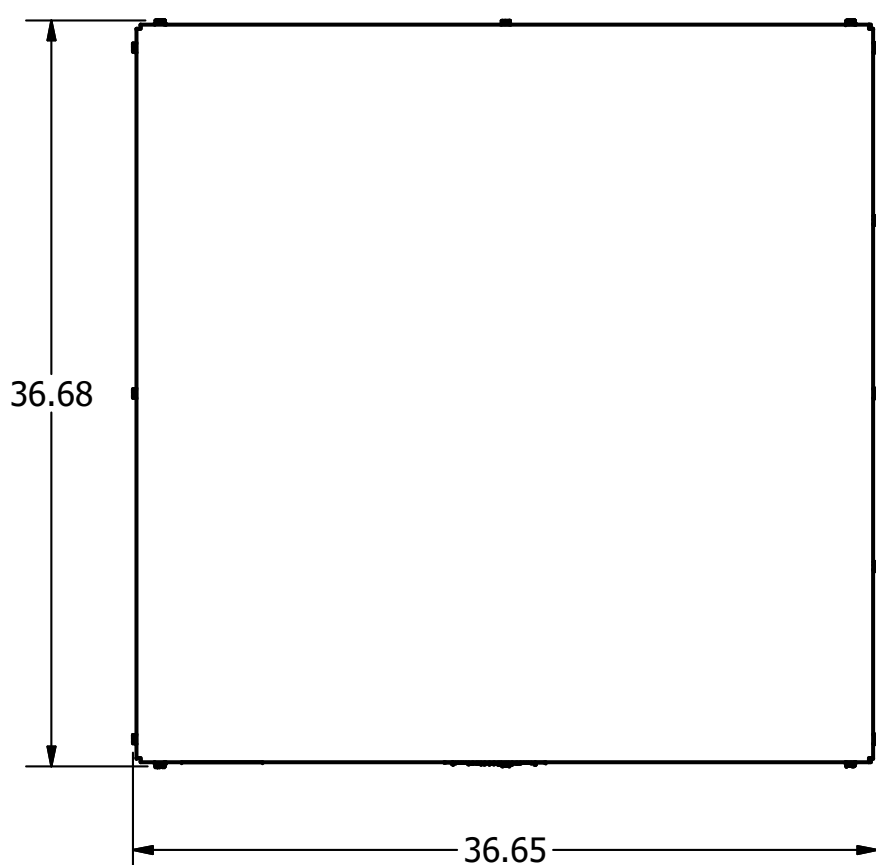
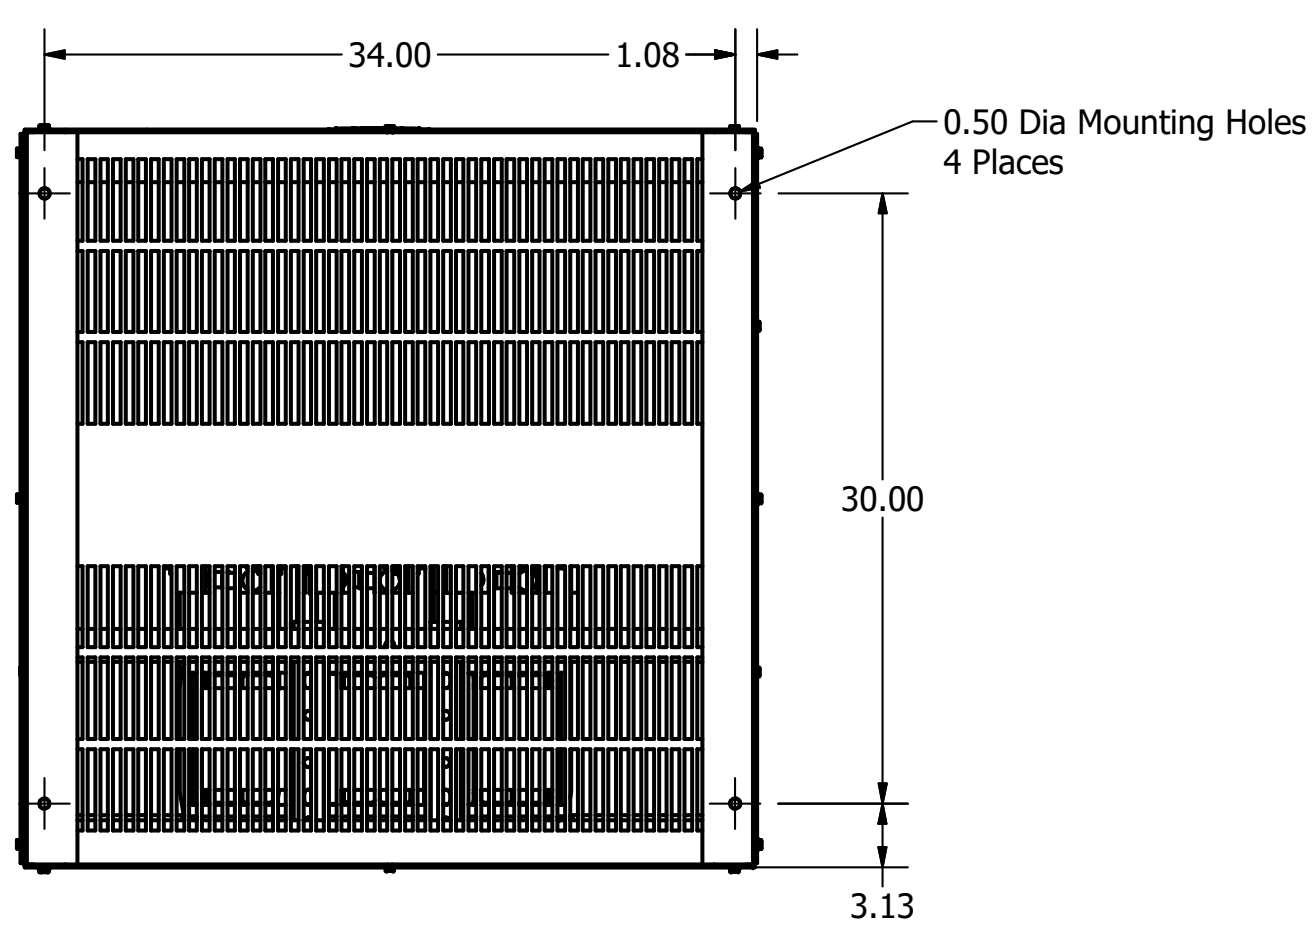
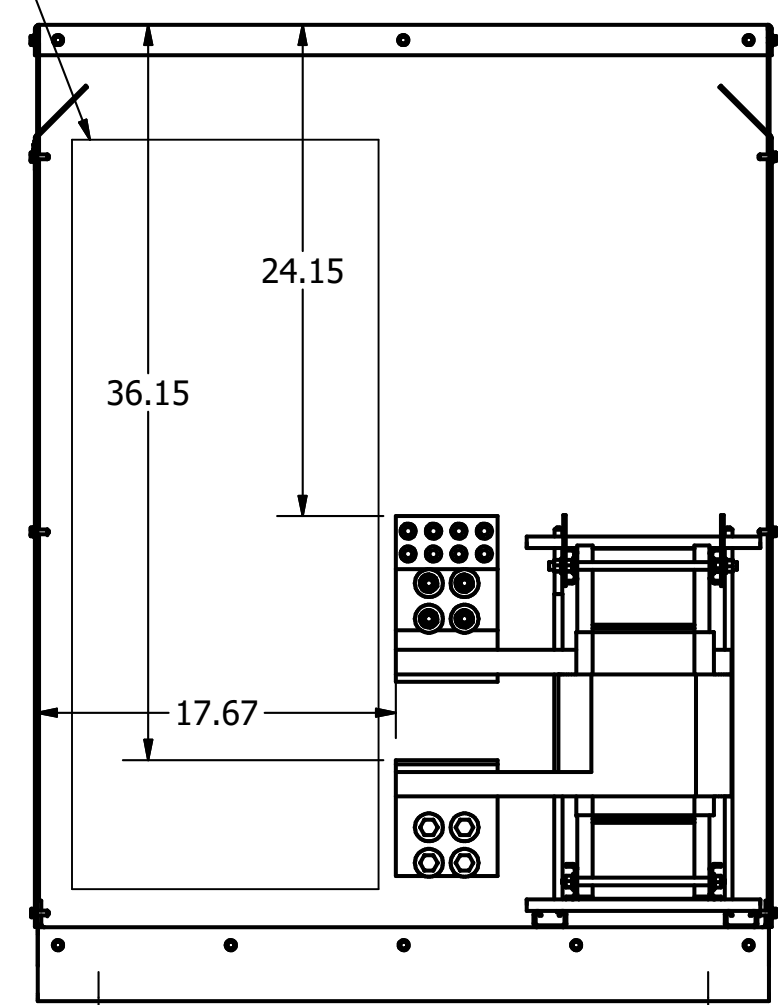


HP	TCI Part Number	Motor Amps	Amps Max.	Watts Loss	Approx Weight (LBS)
1250	KDRULY41HE01	1200	1200	2488	860

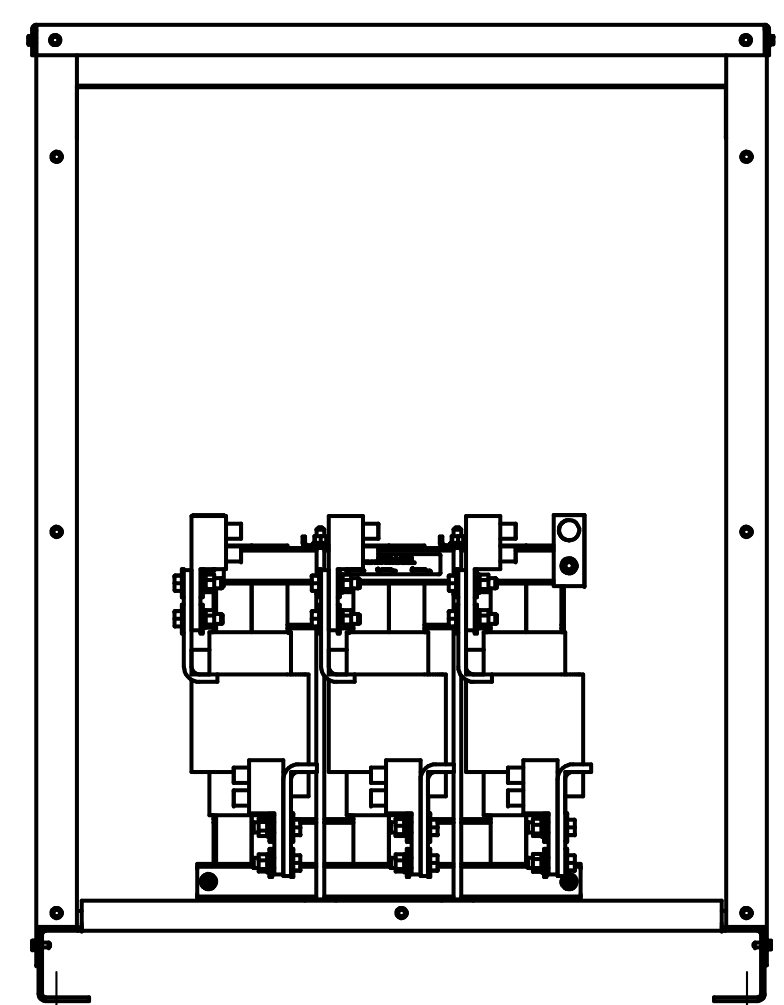

Suggested Customer Entry

Lug Wire Range: 600MCM-2AWG  
See IOM Manual For Torques.

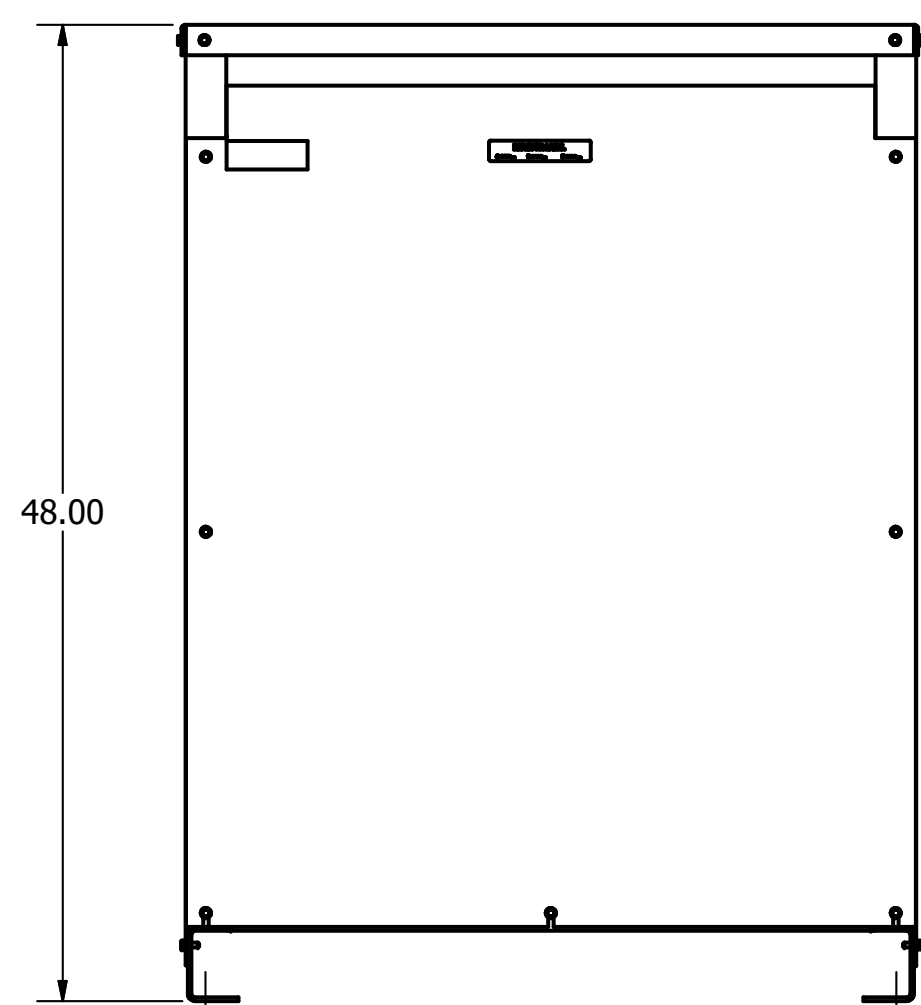

Material(s) Shall be RoHS Compliant

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)		W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL		
				FRACTIONAL		KDRULY41HE01, 575V, 1200A, 1250HP, 3 Phase, Type 1, Input Line Reactor, High Impedance
				± 1/16		
A 4130, Drawing Updated		9/20/17	DSW	DRN BY: DSW    DATE: 7/6/04 SCALE: 1/4    APRVD:		KDRULENCL-62 SIZE C    SHT 1 OF 1
NO REVISION		DATE	BY			