
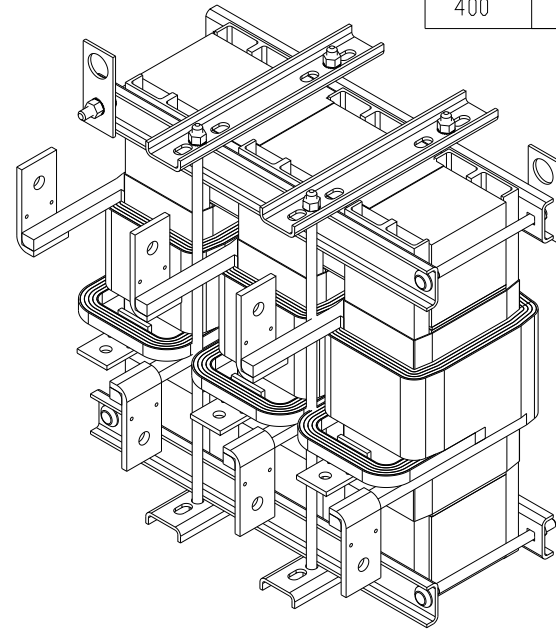


HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS
400	KDRX3TT	477	285

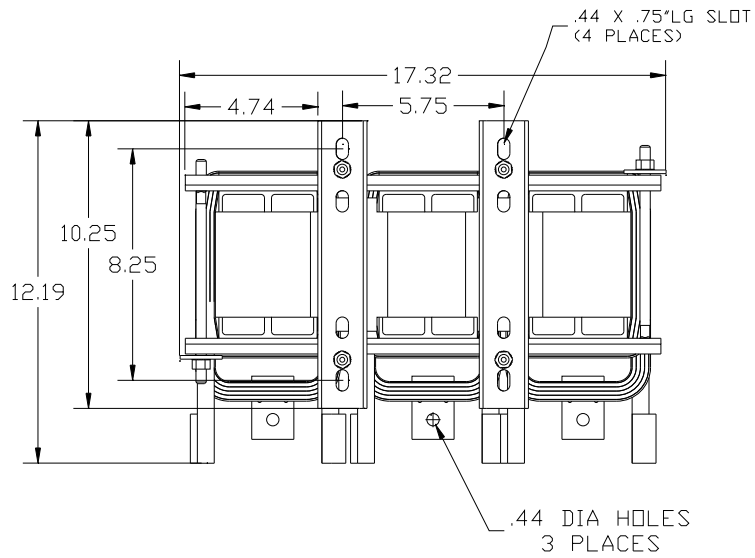

**TCL** Performance and Protection for Drives.


TRANS-COIL, INC.  
MILWAUKEE, WI  
WWW.transcoil.com  
800-824-8282

KDR Drive Reactor  
EXCEEDS IEC 60086-21  
3PH, 60Hz, 600V Max.  A Buses  
40C Amb Max, 155C Rise


UL®  
UL®  
CE

A1, AT, A2, B1, BT, B2, C1, CT, C2

A1, AT, A2, B1, BT, B2, C1, CT, C2, MARKINGS FOR REFERENCE ONLY

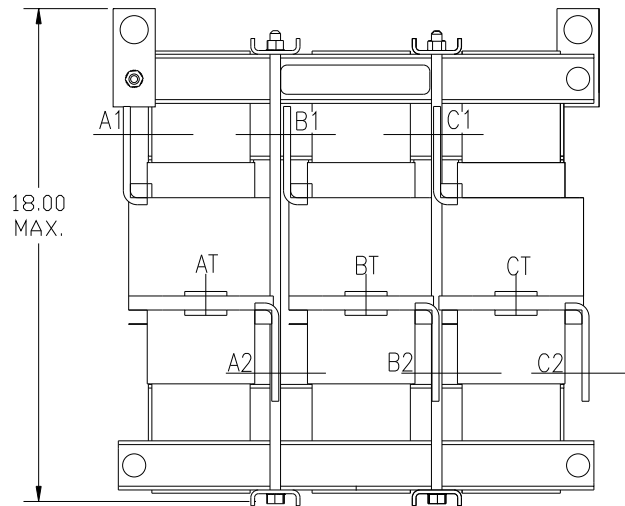

.53 DIA HOLES  
6 PLACES.

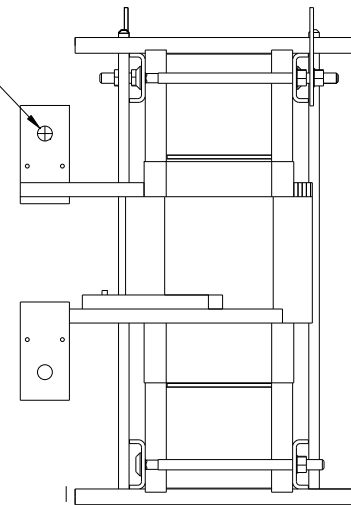

TOLERANCES (EXCEPT AS NOTED)				<b>TCL</b> 7878 N. 86th STREET MILWAUKEE, WI 53224
DECIMAL				
.XX ± .03				KDRX3TT, 400HP HGP FILTER REACTOR
XXX ± .01				
FRACTIONAL ± 1/32				
ANGULAR ± 1/2°				DRN. BY: DSW DATE: 6/25/2013 DWG. NO.: 105310DG
NO	REVISION	DATE	BY	SCALE: TO FIT APRVD: C