
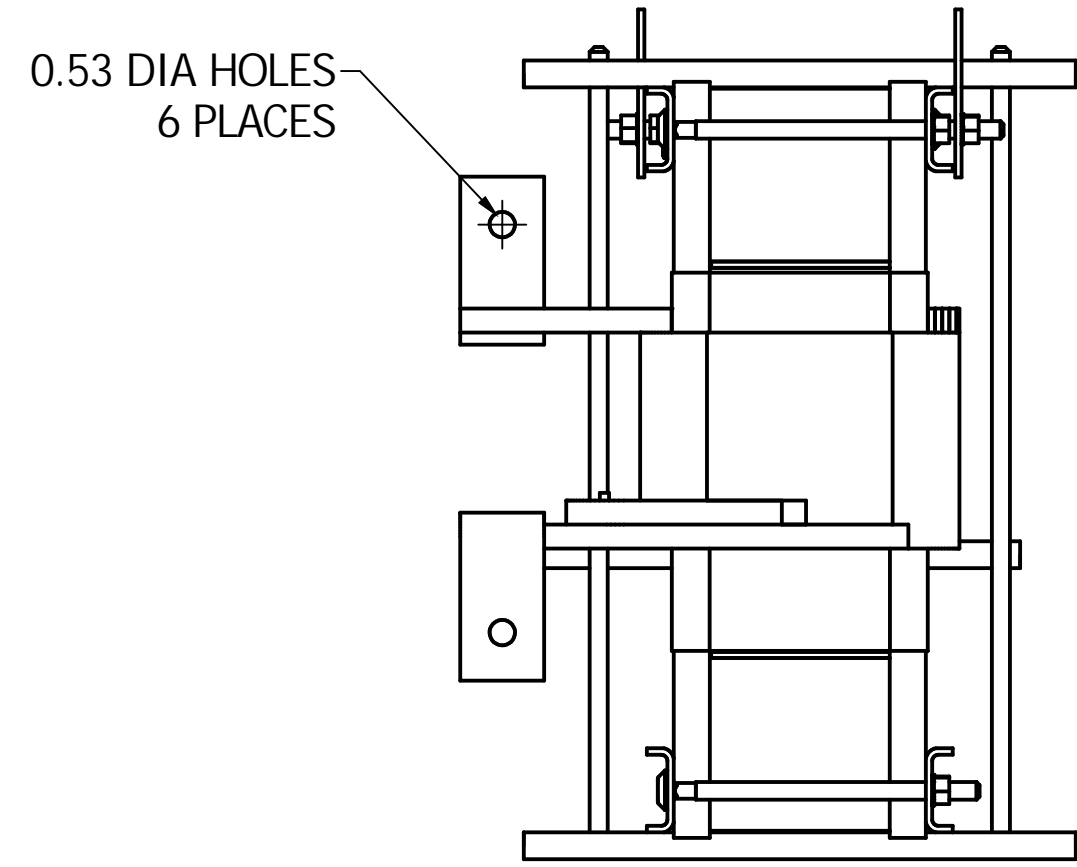
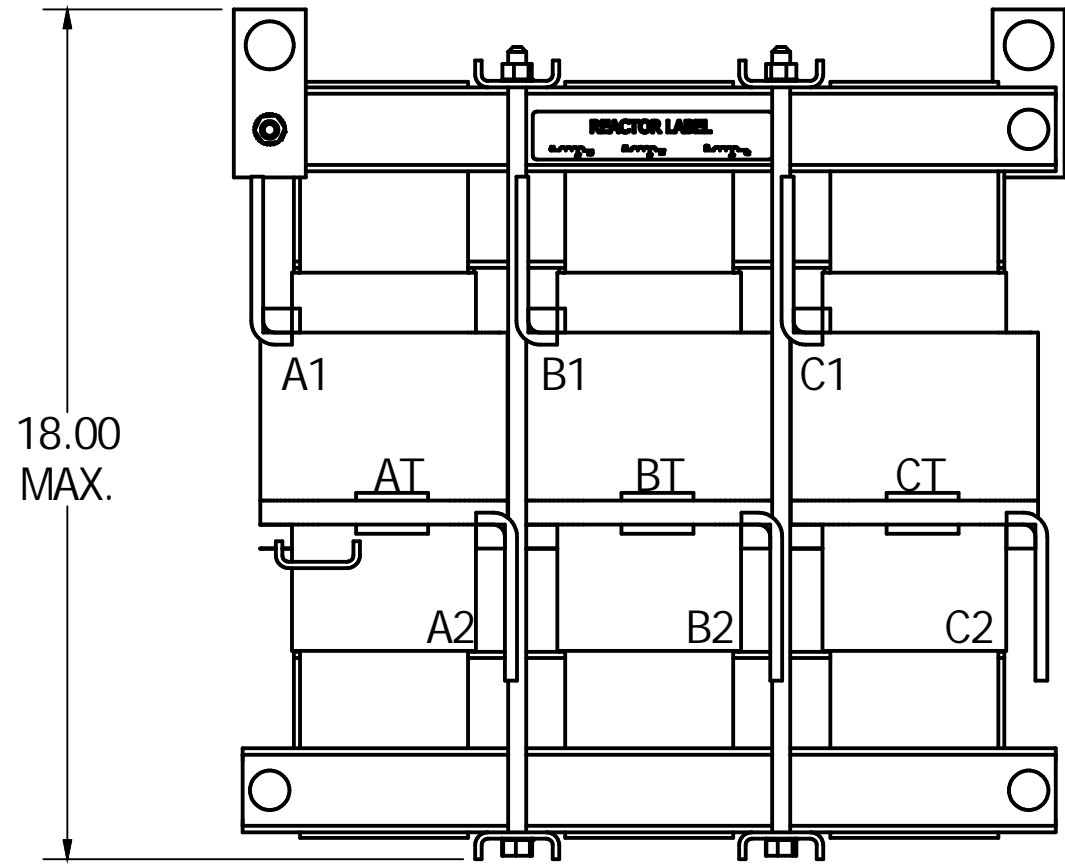


HP	CATALOG NO	RATED AMPS (A)	MAX. AMPS(A)	APPROX WT-LBS
450	KDRX4TT	435	534	285

480V 50/60 Hz

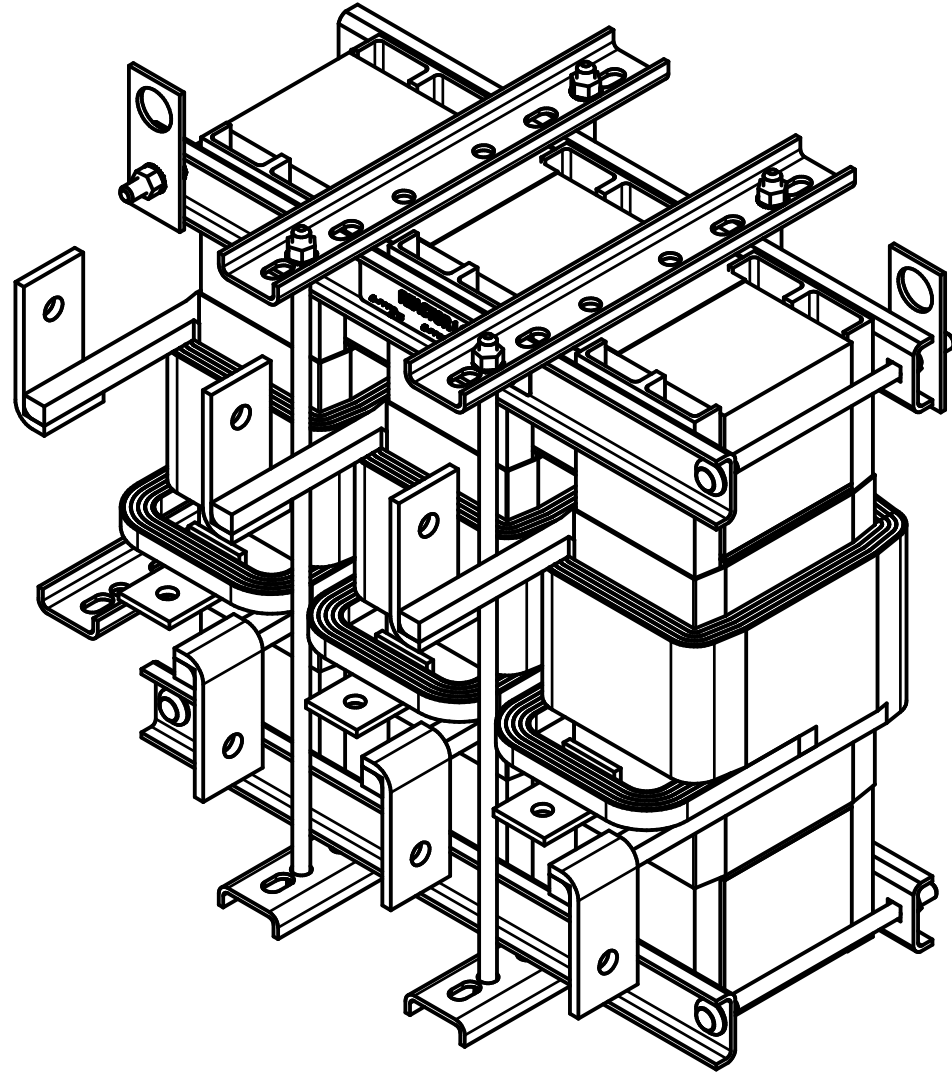

**Material(s) Shall be RoHS Compliant**

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY
A	3894 BRACKET UPDATE	2/27/17	JRN

	W132 N10611 Grant Drive Germantown, WI. 53022	
	KDRX4TT, 450 HP HGP5 FILTER REACTOR	
DRN. BY DSW	DATE 6/25/2013	DWG. No. 105311DG
SCALE 1/4	APPRVD.	SHEET 1 OF 1

TOLERANCES (EXCEPT AS NOTED)  
 DECIMAL  
 .XX +/- .25  
 .XXX +/- .10  
 FRACTIONAL  
 +/- 1/16  
 ANGULAR  
 +/- 1°