

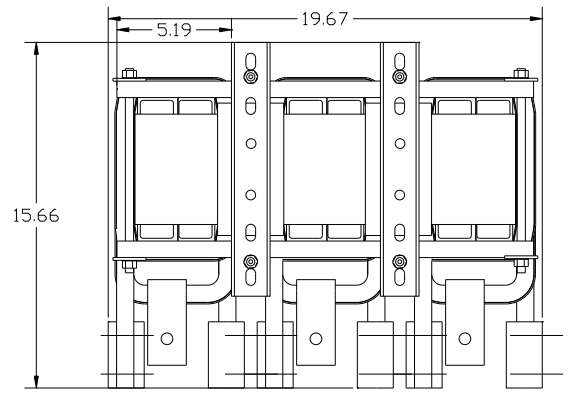
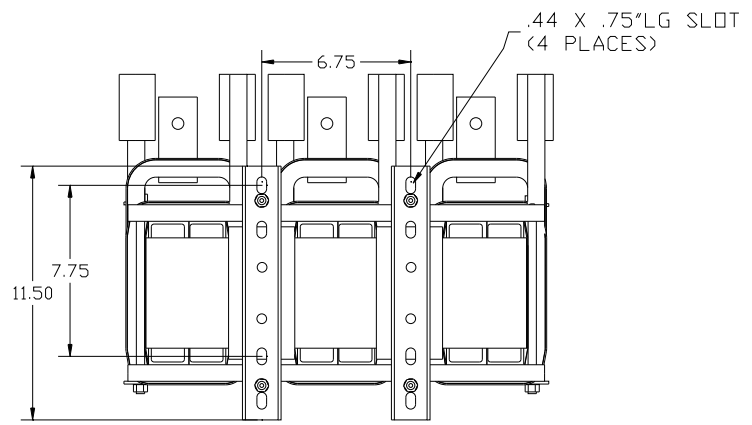


HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS
700	KDRY2TT	840	512

TRANS-COIL, INC. MILWAUKEE, WI WWW.TRANSCOIL.COM 800-824-8282	Performance and Protection for Drives. KDR Drive Reactor [REACTOR] Motor Amps [---] Max. 3PH, 60HZ, 600V Max. [---] A [---] Break 40C Amb Max, 150C Rise	

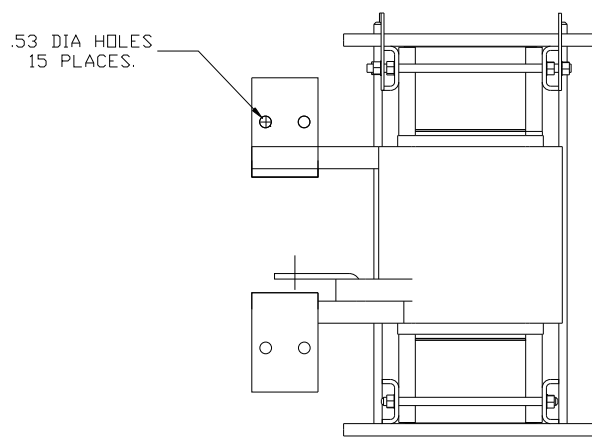

A1, AT, A2, B1, BT, B2, C1, CT, C2, MARKINGS FOR REFERENCE ONLY

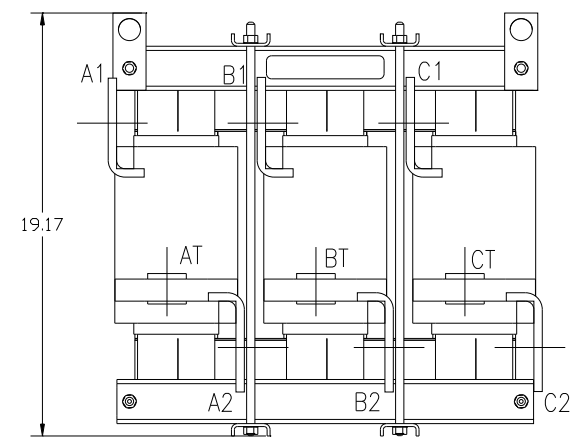

				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°		7878 N. 86th STREET MILWAUKEE, WI 53224	
				KDRY2TT 700HP HGP FILTER REACTOR		DRN. BY: DSW DATE: 7/10/2013 DWG. NO: 105323DG	
A	AS RELEASED	8/9/13	DSW	SCALE: TO FIT	APPRV: [Signature]	SHT. 1 OF 1	