

HP	CATALOG NO	__AMPS(A)	APPROX WT-LBS
900	KDRY4TT	1080	500


TCI Performance and Protection for Drives.

TRANS-COIL, INC.
MILWAUKEE, WI
WWW.transcoil.com
800-824-8282



KDR Drive Reactor
REACTOR Motor Amps $\frac{1}{2}$ - Max
3PH, 60Hz, 600V Max $\frac{1}{2}$ - A Rating
40C Amb Max, 150C Rise

UL[®] US [®] CE

A1, AT, A2, B1, BT, B2, C1, CT, C2, MARKINGS FOR REFERENCE ONLY

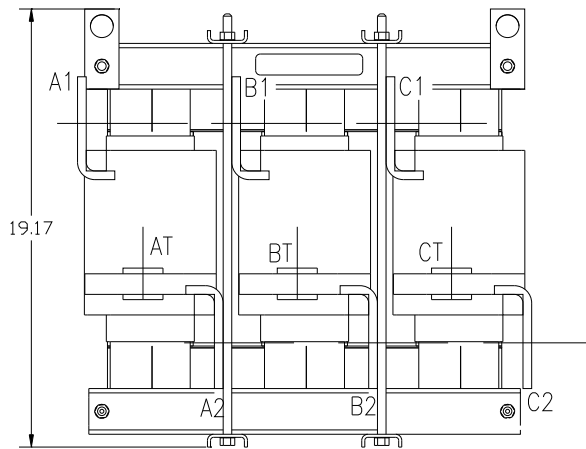

.53 DIA HOLES
15 PLACES.

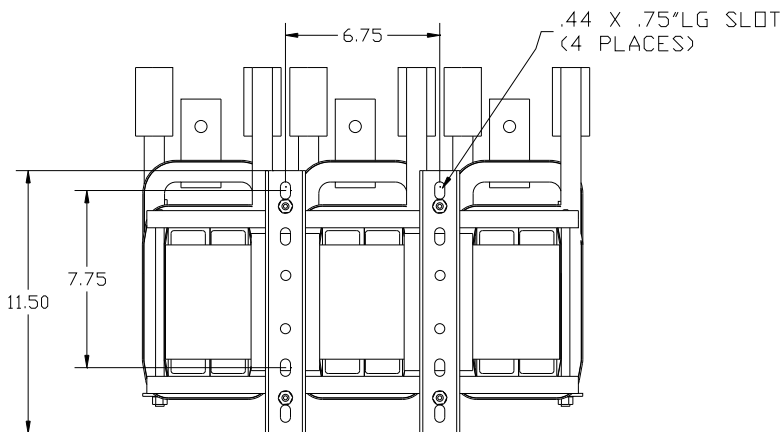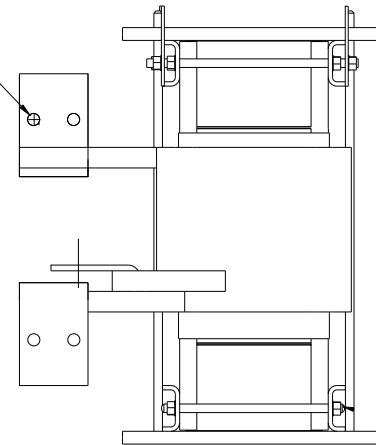

				TOLERANCES (EXCEPT AS NOTED)		7878 N. 86th STREET MILWAUKEE, WI 53224	
				DECIMAL			
				.XX ± .03		KDRY4TT 900HP HGP FILTER REACTOR	
				.XXX ± .01			
				FRACTIONAL ± 1/32			
B		AS RELEASED	8/9/13	DSW	DATE	7/12/2013	DWG. NO. 105325DG
NO	REVISION	DATE	BY	ANGULAR ± 1/2°	SCALE TO FIT	APPROV.	SHT. 1 OF 1