
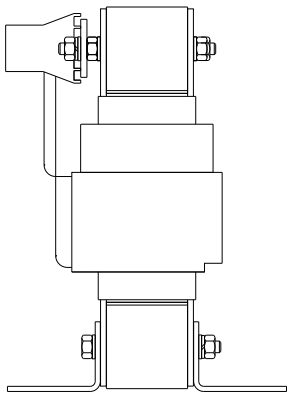


CATALOG NO	__mH $\begin{matrix} +8\% \\ -2\% \end{matrix}$	__AMPS(A)	APPROX WT-LBS
KTR20C65HG	2.161	30.61	45


TCL Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.TRANSCOIL.COM
800-824-8282

KTR Tuning Reactor
CATALOG#
3PH, 60Hz, 600V Max, --- Amps
40C Amb Max, 155C Rise

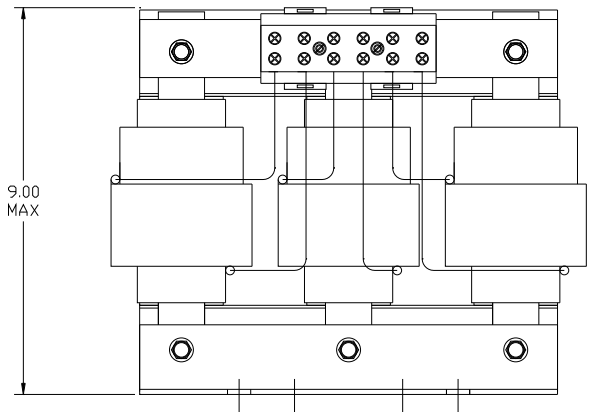


NOTE: A1, A2, B1, B2, C1, C2,
TERMINAL BLOCK
FOR REFERENCE ONLY.

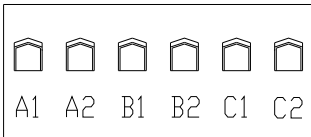

TERMINAL BLOCK
TORQUE(LB-IN)=CUSTOMER WIRE

35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

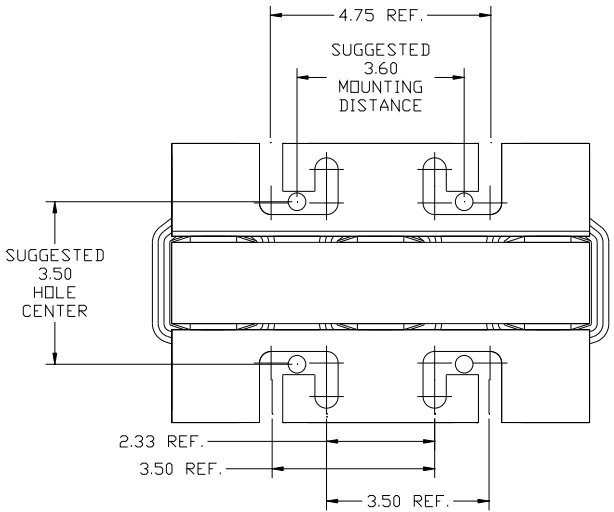

<p>TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.</p>				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± .03 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	<p>TCL W132 N10611 Grant Drive Germanstown, WI 53022</p> <p>TRAP REACTOR KTR20C65HG</p> <p>DRN BY DSW DATE 2/23/05 DWG NO 102377DG SCALE TO FIT SIZE C SHT. 1 OF 1</p>
	B	2661 ADD CE	3/9/10	DSW	
	NO	REVISION	DATE	BY	