

CATALOG NO	__mH $\begin{matrix} +8\% \\ -2\% \end{matrix}$	__AMPS(A)	APPROX WT-LBS
KTR25C65HG	1.729	38.26	50



**TCI** Performance and Protection for Drives.

TRANS-COIL, INC  
MILWAUKEE WI  
WWW.transcoil.com  
800-824-8282

KTR Tuning Reactor  
CATALOG#  
3PH, 60Hz, 600V Max, --- Amps  
40C Amb Max, 155C Rise

UL<sup>®</sup> US<sup>®</sup> SA<sup>®</sup> CE


DATE CODE A1 A2 B1 B2 C1 C2

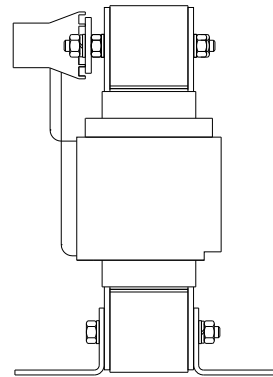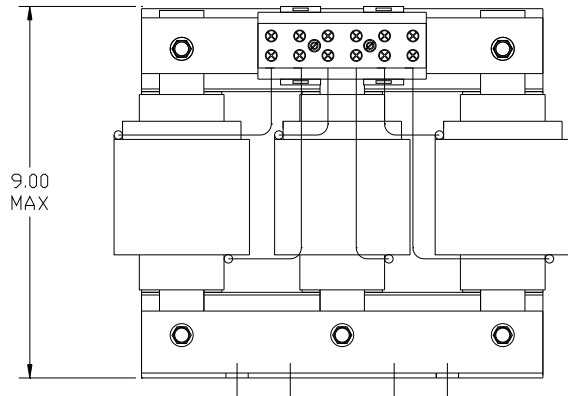

NOTE: A1, A2, B1, B2, C1, C2,  
TERMINAL BLOCK  
FOR REFERENCE ONLY.



TERMINAL BLOCK TORQUE(LB-IN)=CUSTOMER WIRE
35 = 1 AWG THRU 4 AWG
30 = 6 AWG THRU 14 AWG
25 = 16 AWG THRU 20 AWG
20 = 22 AWG

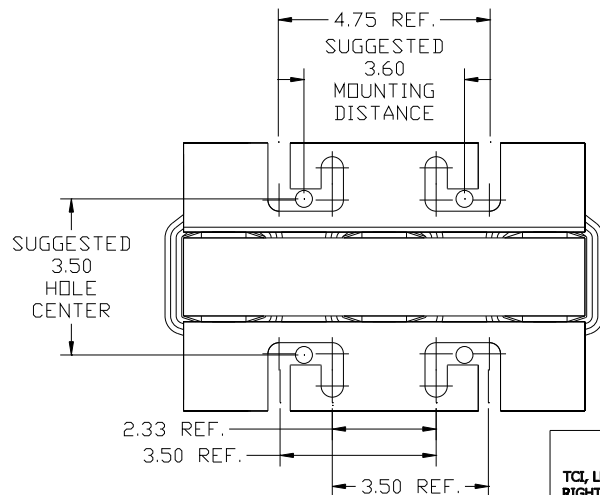

<p>TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.</p>				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germanstown, WI 53022
				DECIMAL	
				.XX ± .03	
				.XXX ± .01	
				FRACTIONAL ± 1/32	
	B 2661 ADD CE TO LABEL	3/10/10	DSW	ANGULAR ± 1/2°	DRN. BY DSW
NO	REVISION	DATE	BY	SCALE TO FIT	DATE 01/24/05
					DWG. NO. B 102378DG
					SHT.1 of 1