
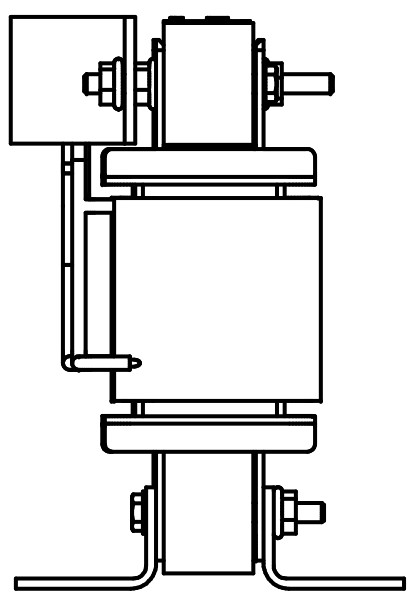


TCI PART#	AMPS (A)	APPROX WT-LBS	--mH +8%/-2%
KTR3A65HG	5.74	12	9.22

TERMINAL BLOCK TORQUE (LB-IN)
 WIRE RANGE #4 AWG. TO #18 AWG. = (20 LB-IN)

NOTE: MARKINGS A1,A2,B1,B2,C1,C2 ON COILS, ARE FOR REFERENCE ONLY.

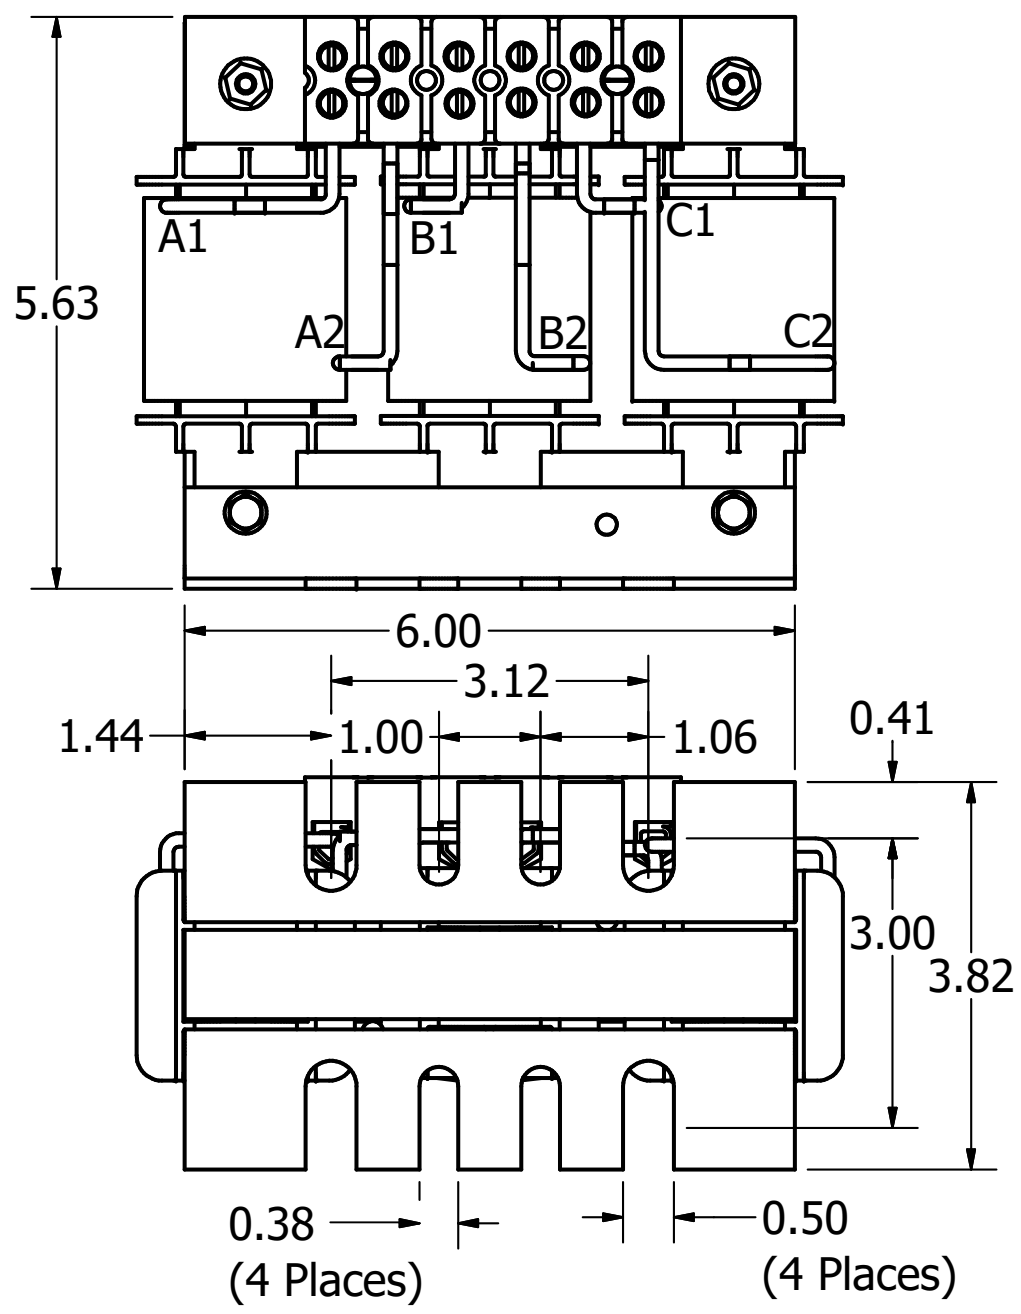

NO	REVISION	DATE	BY
C	3290, CORE TO M6, WEDGE BOBBIN	4/14/15	DSW

TOLERANCES (EXCEPT AS NOTED)
DECIMAL
.XX +/- .25
.XXX +/- .10
FRACTIONAL
+/- 1/32
ANGULAR
+/- 1/2

TCI W132 N10611 Grant Drive
 Germantown, WI 53022

KTR3A65HG
 7.5HP/10HP, 480V, 5.74 AMPS

DRN. BY: DSW DATE: 01/31/05 DWG. No. 102290DG
 SCALE: 1/2 APRVD. SHEET 1 OF 1

B

B

A

A

A

A

4

3

2

1