

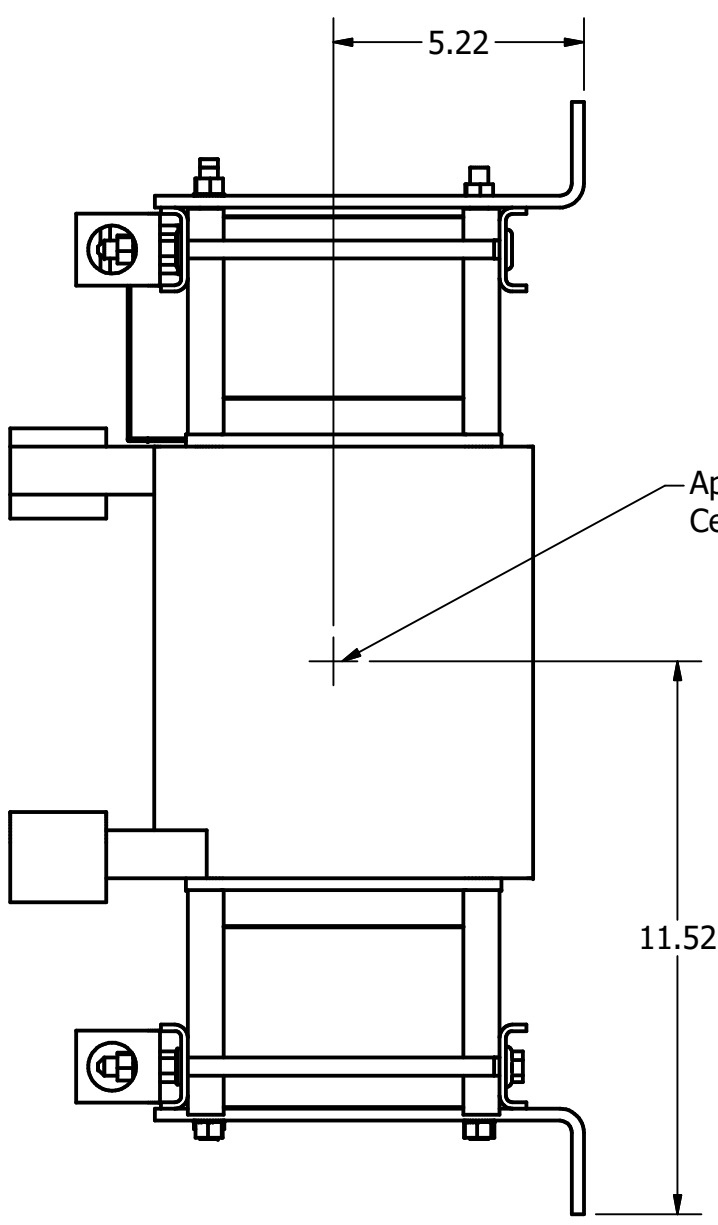
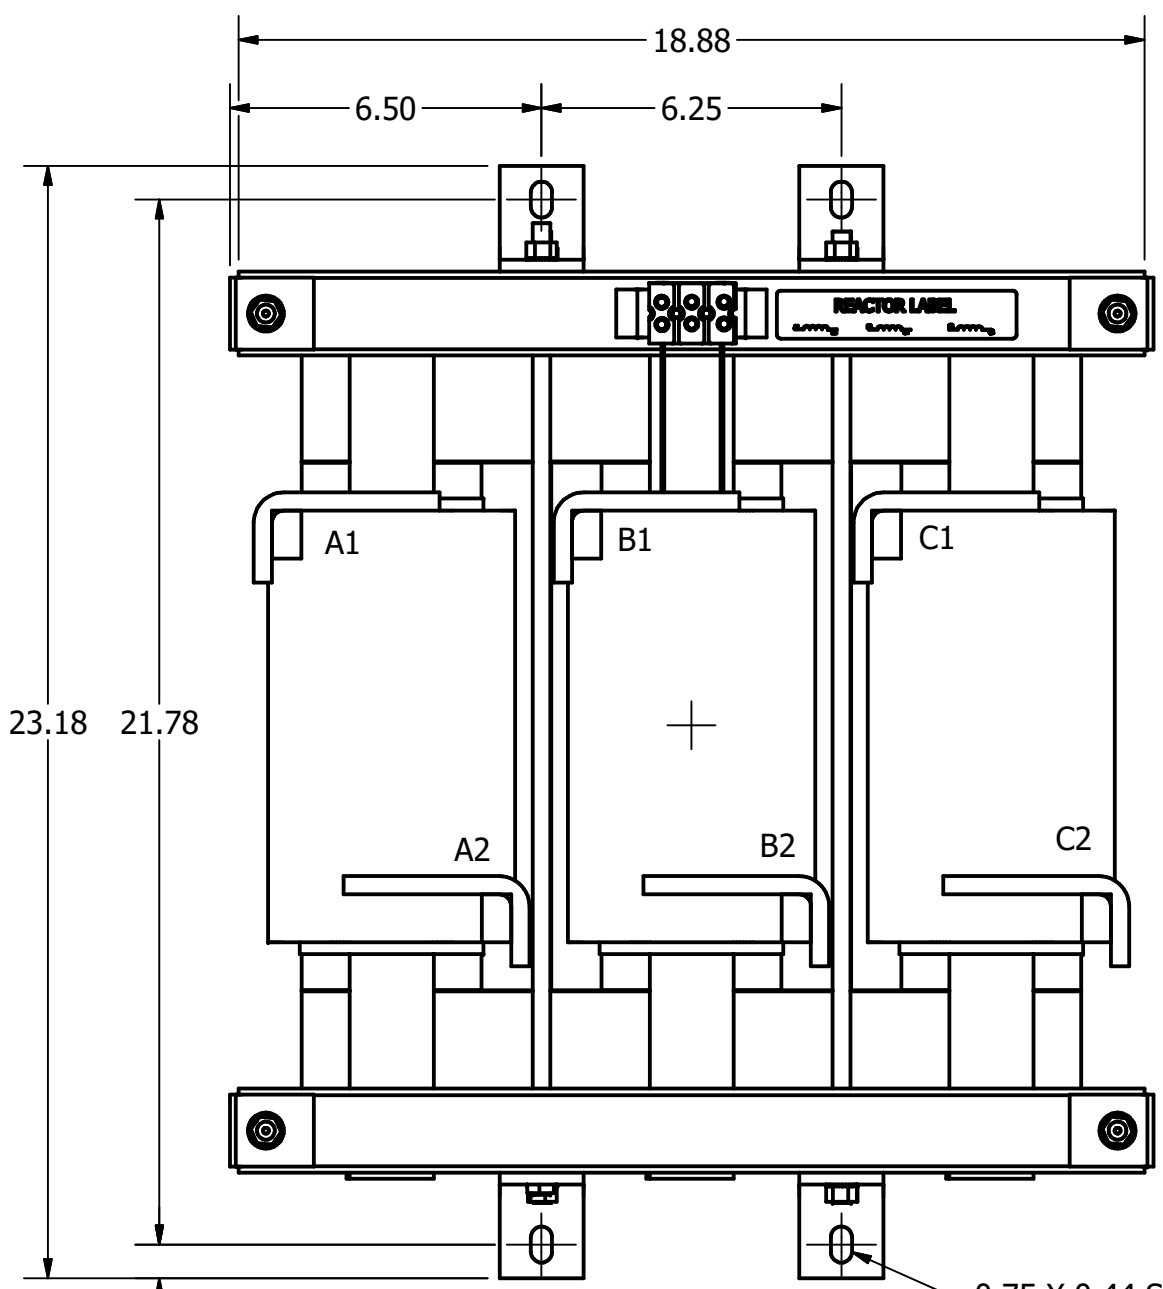
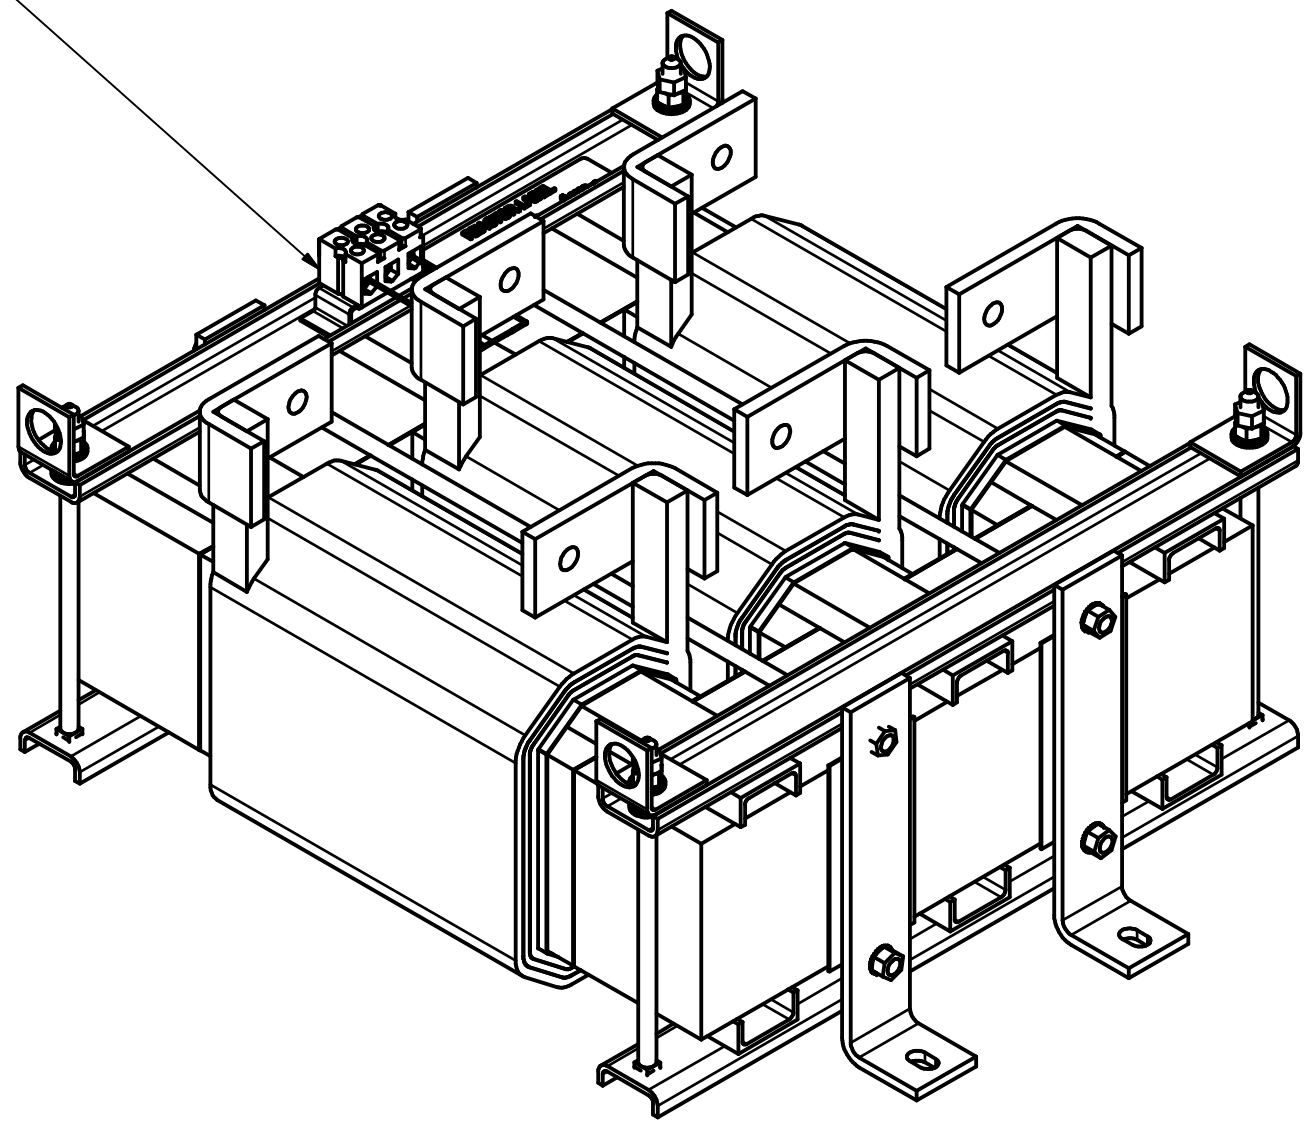
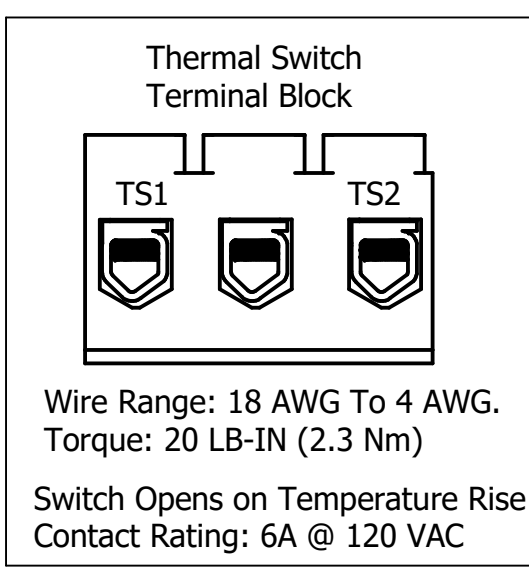


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG540AX7	540	480	60	90	450

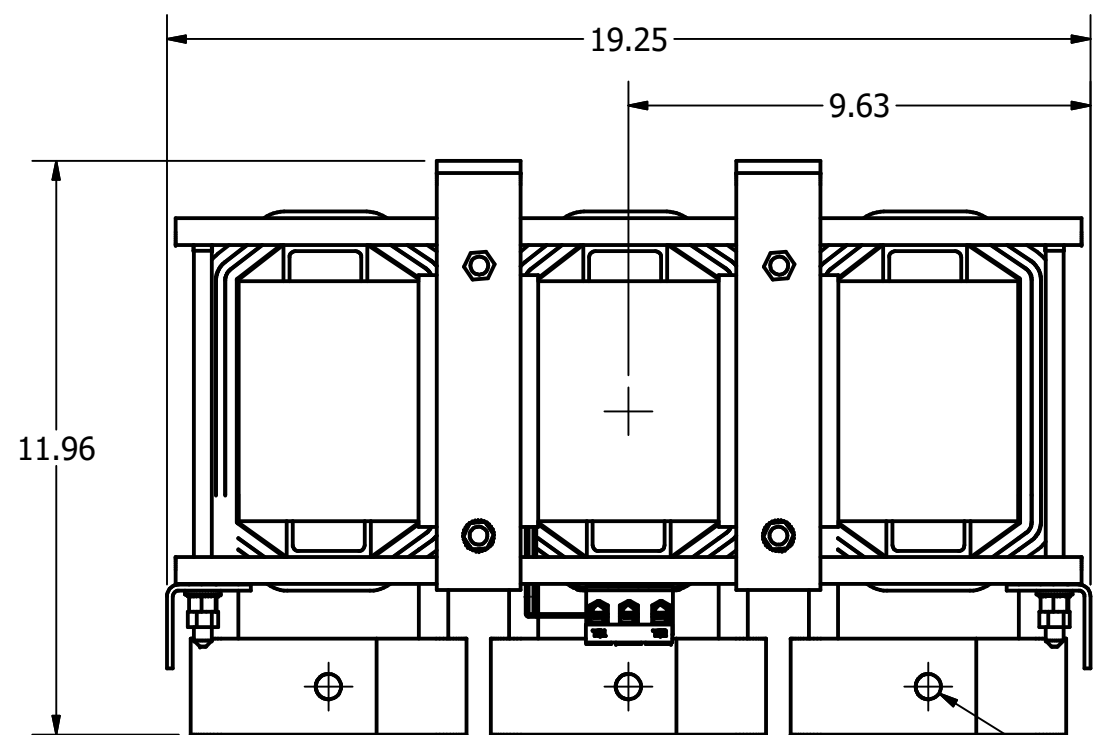

Approximate Center Of Gravity

0.75 X 0.44 Slots  
4 Places

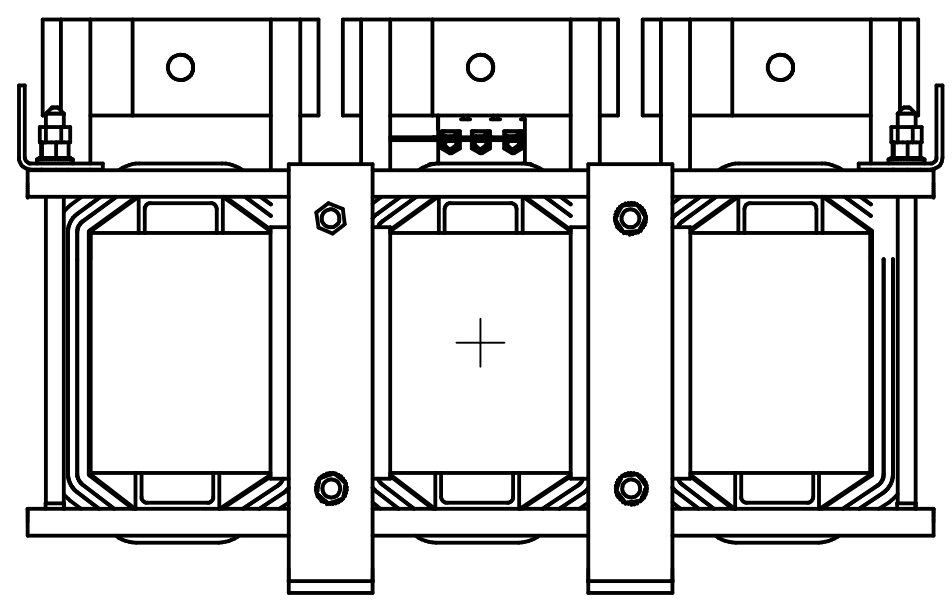

**TCI, LLC**  
 Germantown, WI  
[www.transcoll.com](http://www.transcoll.com)  
 800-824-8282

**KDR Drive Reactor**  
**KTRMG— (Motor Amps) Or (Rating Amps)**  
**3 PH, 50/60Hz, 600V Max. —Max.**  
**40C Amb Max, 155C Rise.**

(800) 824-8282 • [transcoll.com](http://transcoll.com)

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)		W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL		
		.XX ± .25	DRN BY: JRN DATE: 07/15/20 SCALE: 1/4	108684DG SIZE: C		
		.XXX ± .10			SHT. 1 OF 1	
		FRACTIONAL ± 1/16				
		ANGULAR ± 1°				
NO	REVISION	DATE	BY			

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.