
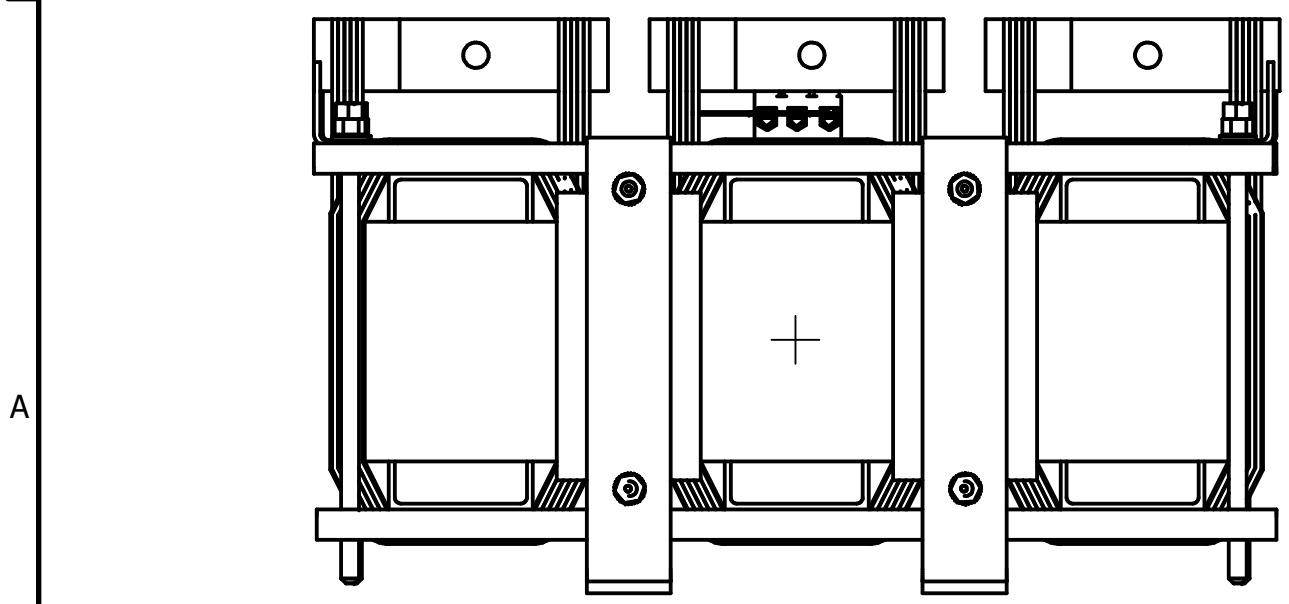
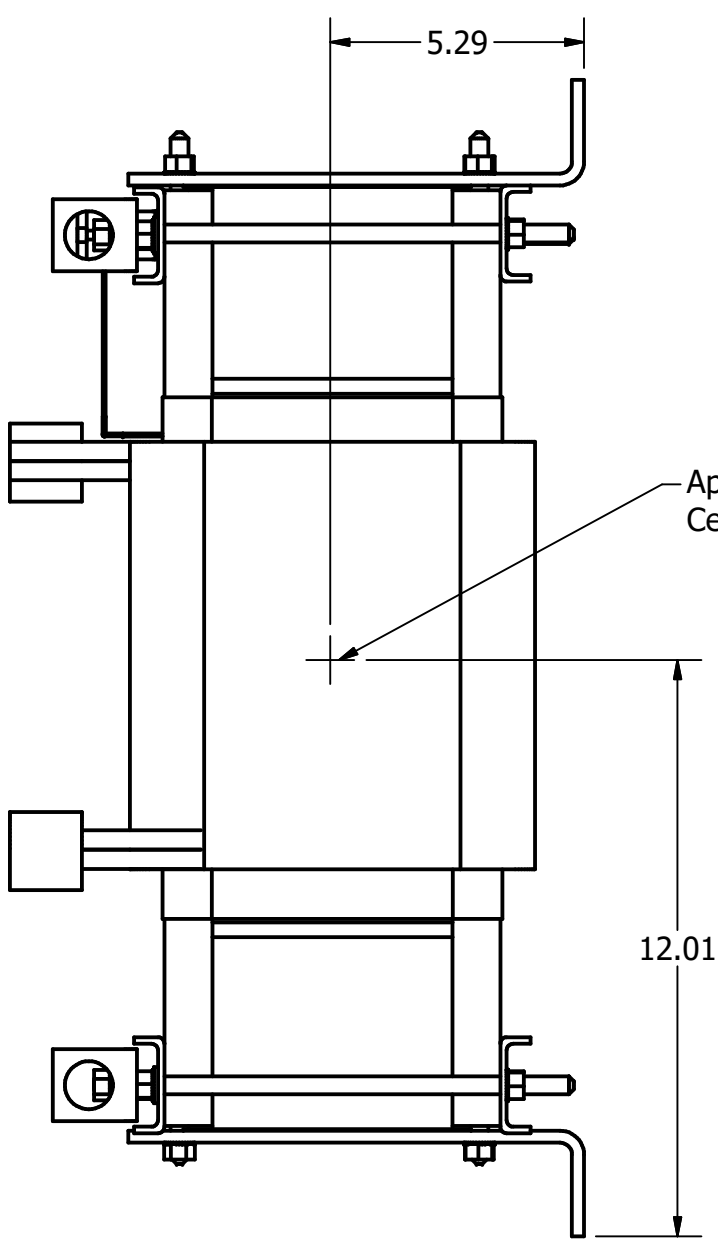
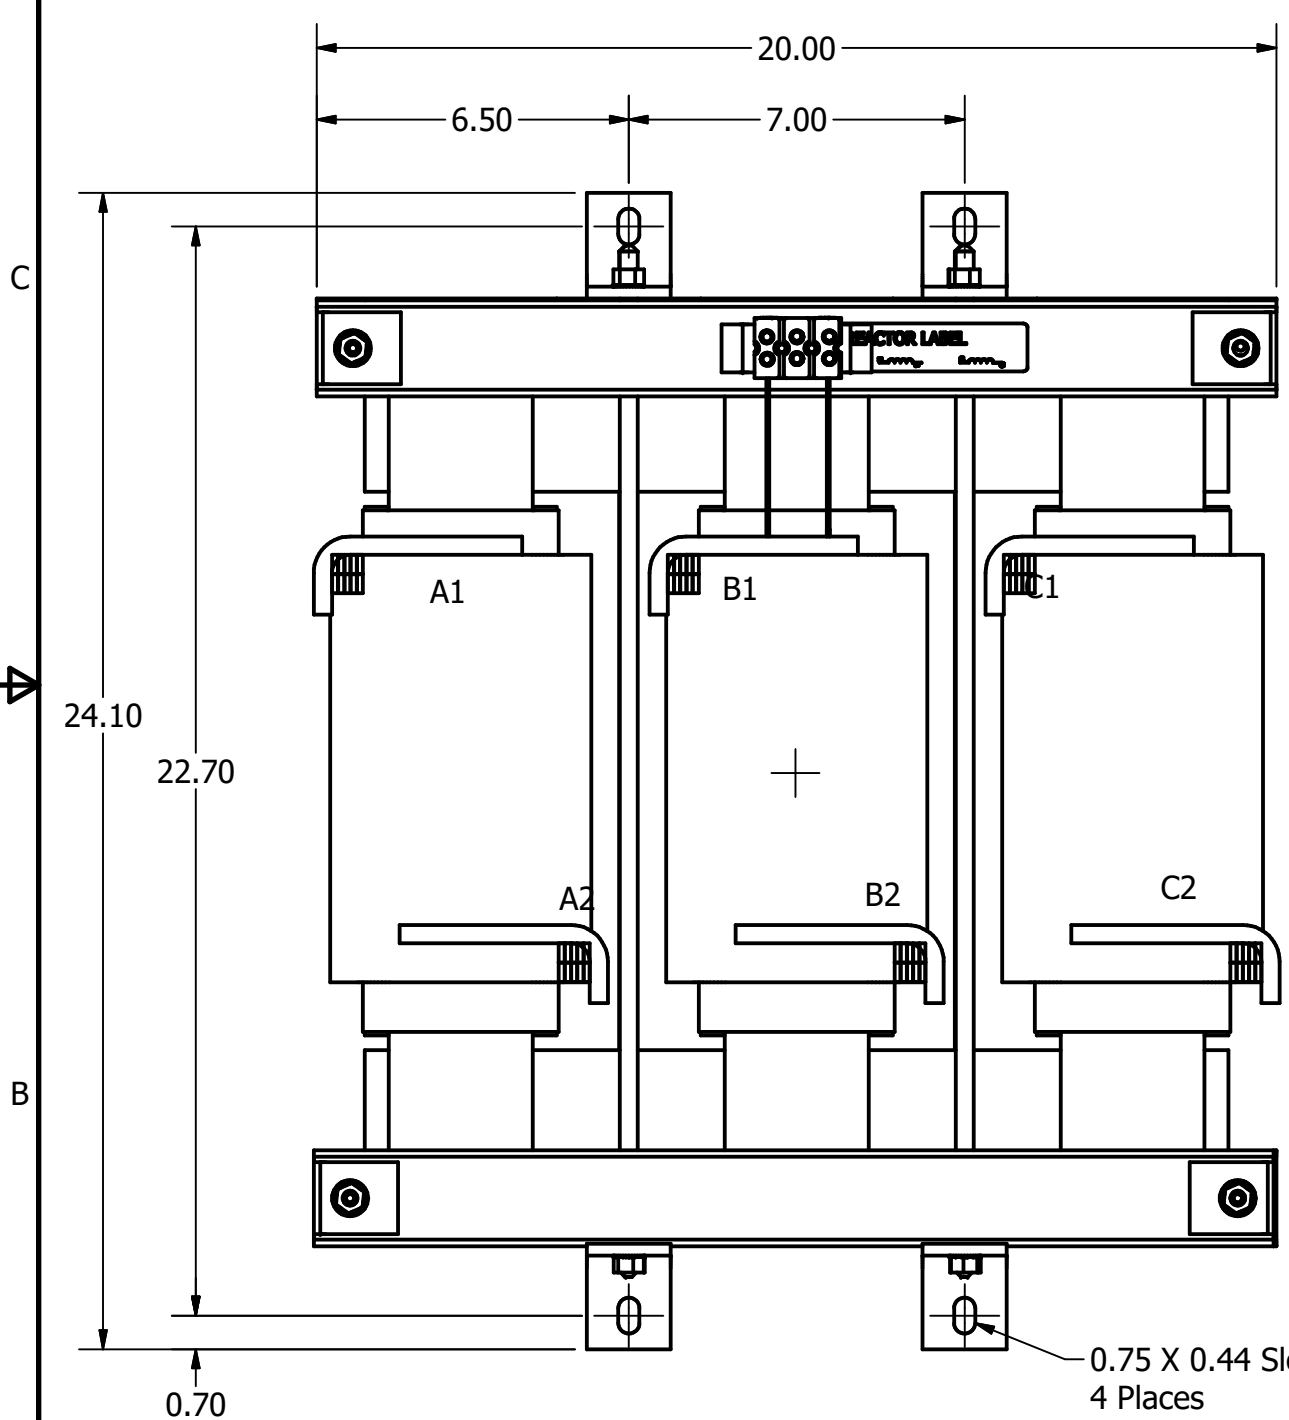
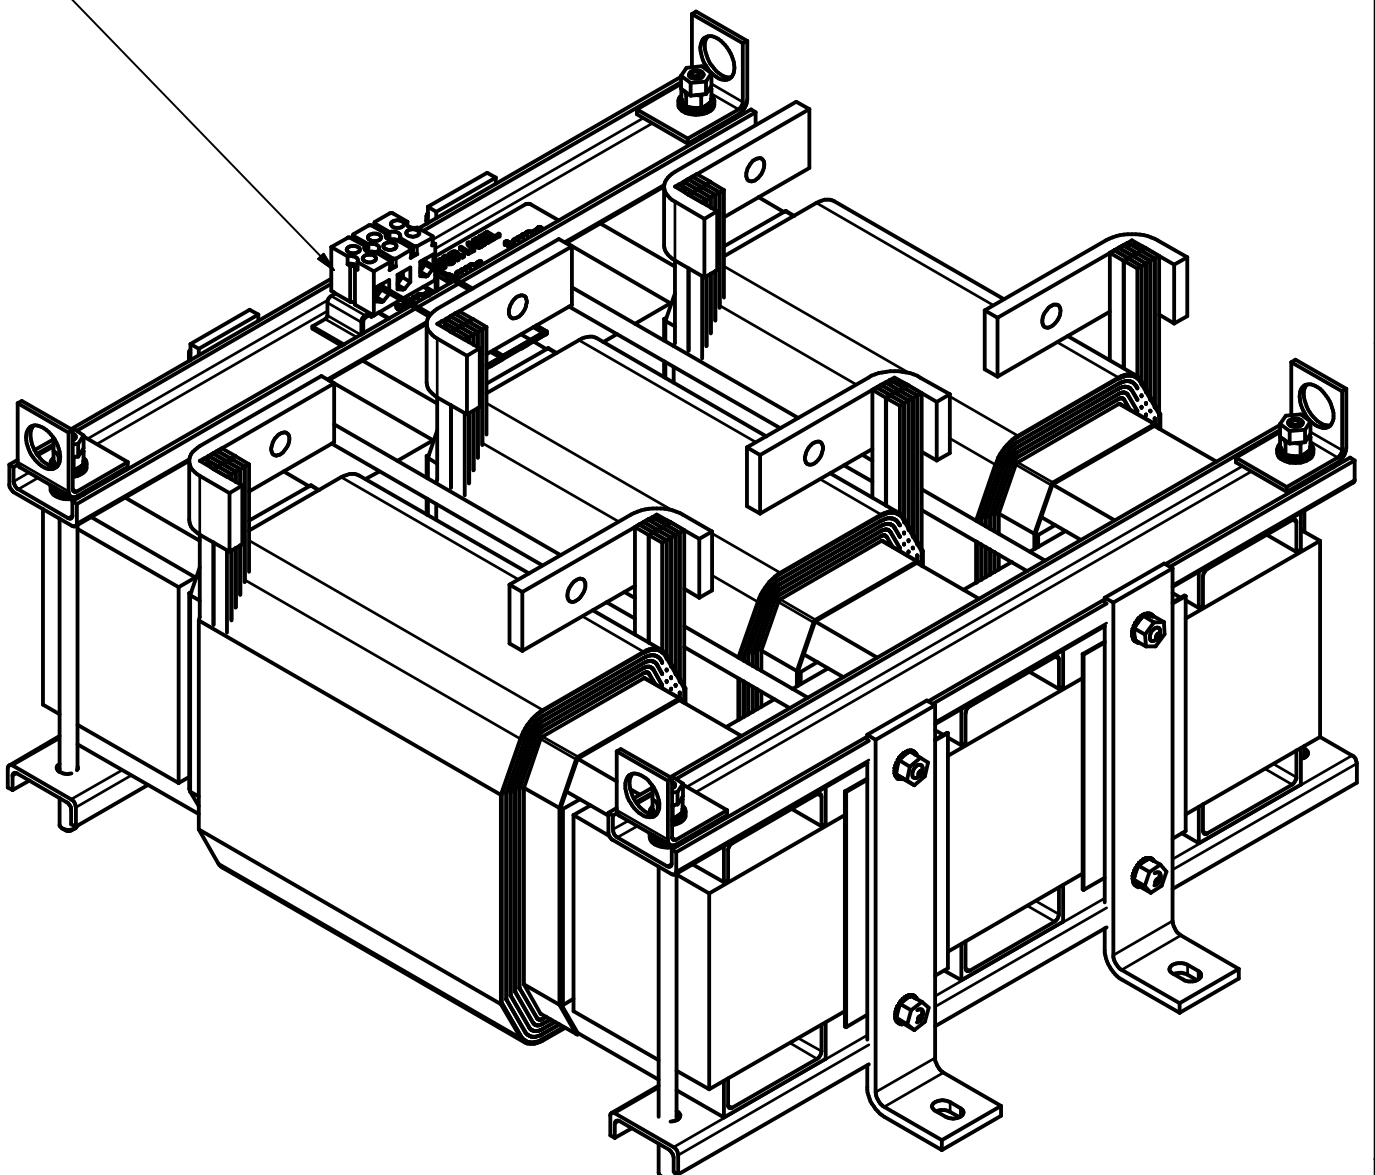
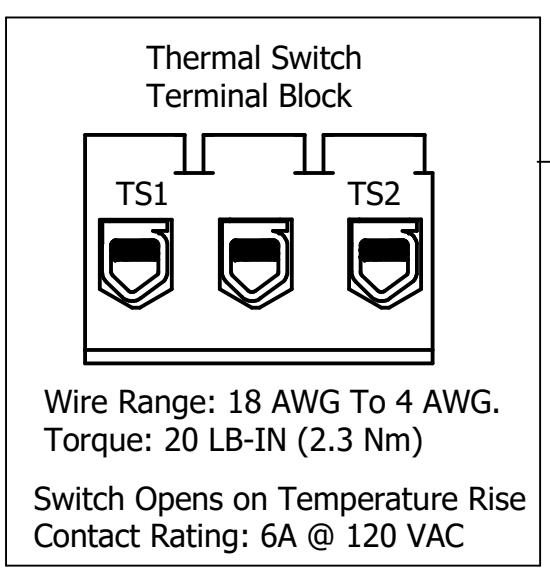


TCI Part Number	Rated Amps (A)	Rated Voltage (V)	Hz	---uH ±5%	Approx Weight (LBS)
KTRMG600CX1	600	600	60	100	495

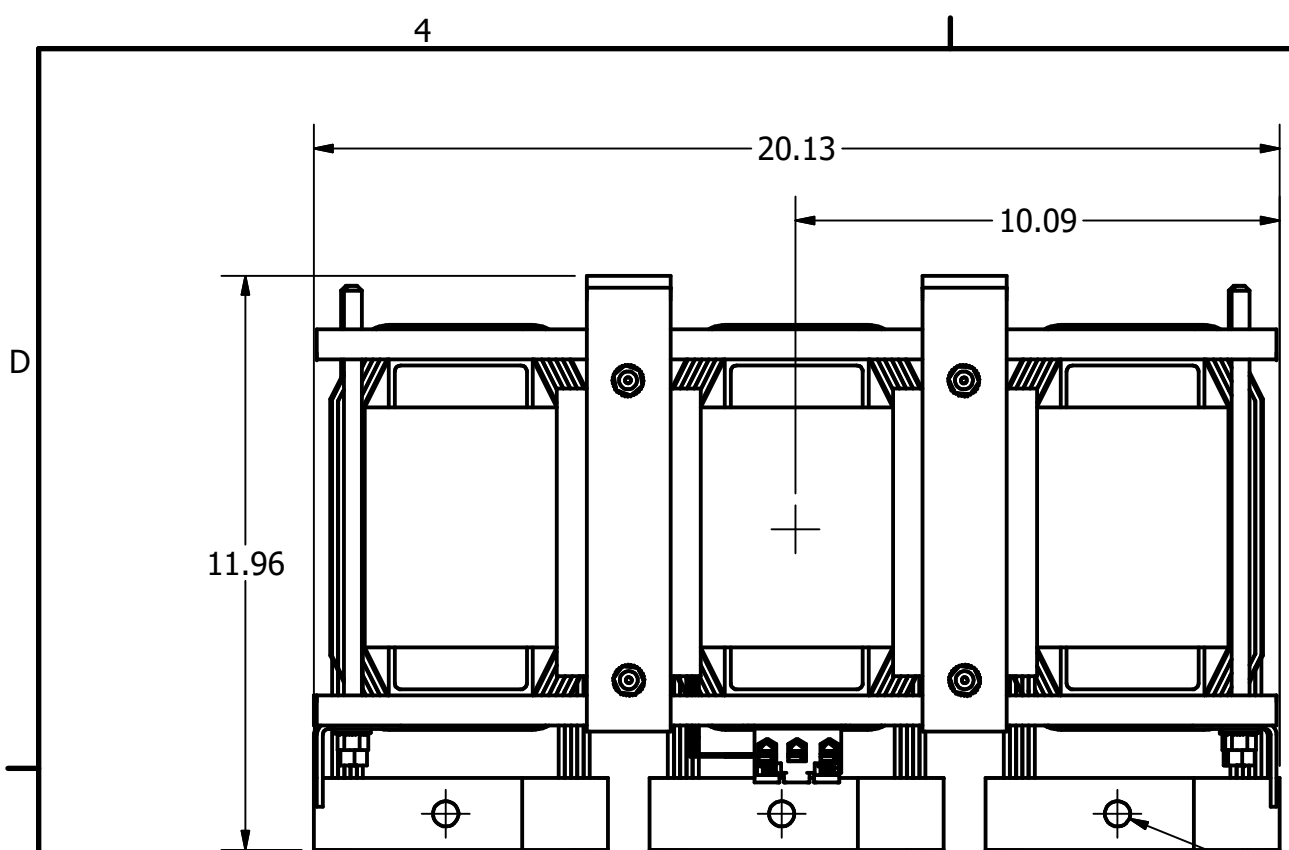

TCI, LLC
 Germantown, WI
 www.transcoll.com
 800-824-8282

KDR Drive Reactor
 KTRMG— (Motor Amps) Or (Rating Amps)
 3 PH, 50/60Hz, 600V Max. —Max.
 40C Amb Max, 155C Rise.

(800) 824-8282 • transcoll.com

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .25 .XXX ± .10 FRACTIONAL ± 1/16 ANGULAR ± 1°		W132 N10611 Grant Drive Germantown, WI 53022 Sinewave Reactor, Wall Mounted KTRMG600CX1, 600V, 600A	
A	As Designed	07/15/20	JRN	DRN BY JRN	DATE 07/15/20	108687DG	SCALE 1/4
NO	REVISION	DATE	BY	SCALE 1/4	APRVD:	SIZE C	SHT. 1 OF 1

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant