
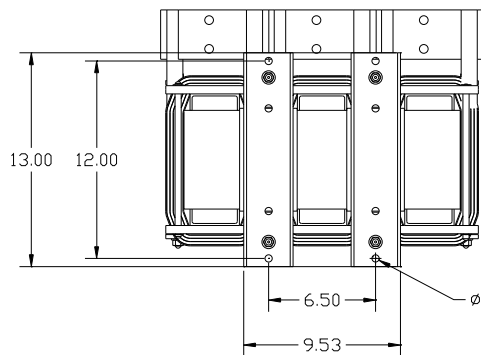
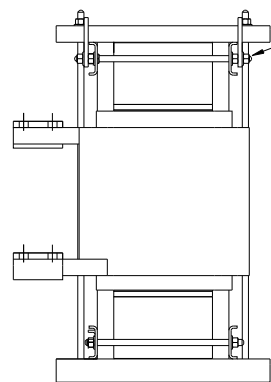


.53 DIA
12 PLACES.

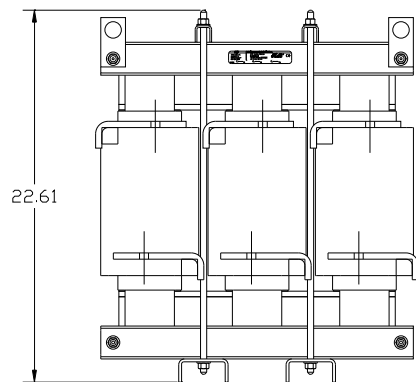

CATALOG NO:	__mH-±5%	__AMPS(A)	APPROX WT-LBS
KTRMG960A	.050	972	625

TCI Performance and Protection for Drives.

TRANS-COIL, INC
MILWAUKEE WI
WWW.transcoil.com
800-824-8282

KTR Tuning Reactor
CATALOG#

3PH, 60Hz, 600V Max, --- Amps
40C Amb Max, 155C Rise

UL[®] US[®] SA[®] CE

DATE CODE A1 A2 B1 B2 C1 C2

				TOLERANCES (EXCEPT AS NOTED)	TCI 7878 N. 86th STREET MILWAUKEE, WI 53224
				DECIMAL	
C	2696 LENGTHEN YOKE	3/24/10	DSW	.XX ± .03	SINEWAVE REACTOR KTRMG960A, 480V, 800HP
	16.25 TO 16.80	7/22/10	DSW	.XXX ± .01	
B	2661 ADD CE TO LABEL	3/24/10	DSW	FRACTIONAL ± 1/32	
A	2596 ADD DOG BONE	2/17/09	DSW	ANGULAR ± 1/2°	DRN BY DSW DATE 05/09/05 DWG NO 102677DG
NO	REVISION	DATE	BY		SCALE 1:4 APRVD B SHT.1 OF1