

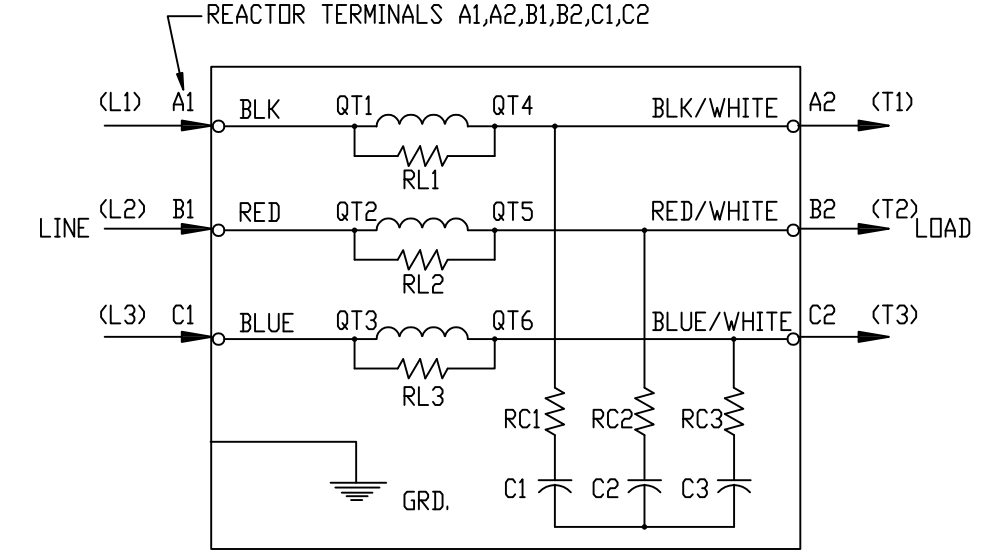


See V1K Installation Guide For Terminal Wire Size And Torque Information.
 Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.



V1K Part Number	Rated Voltage	Amps	Phase	Weight (LBS)
V1K200A01	600	200	3	93
V1K200A01EX	600	200	3	93
V1K250A01	600	250	3	93
V1K250A01EX	600	250	3	93

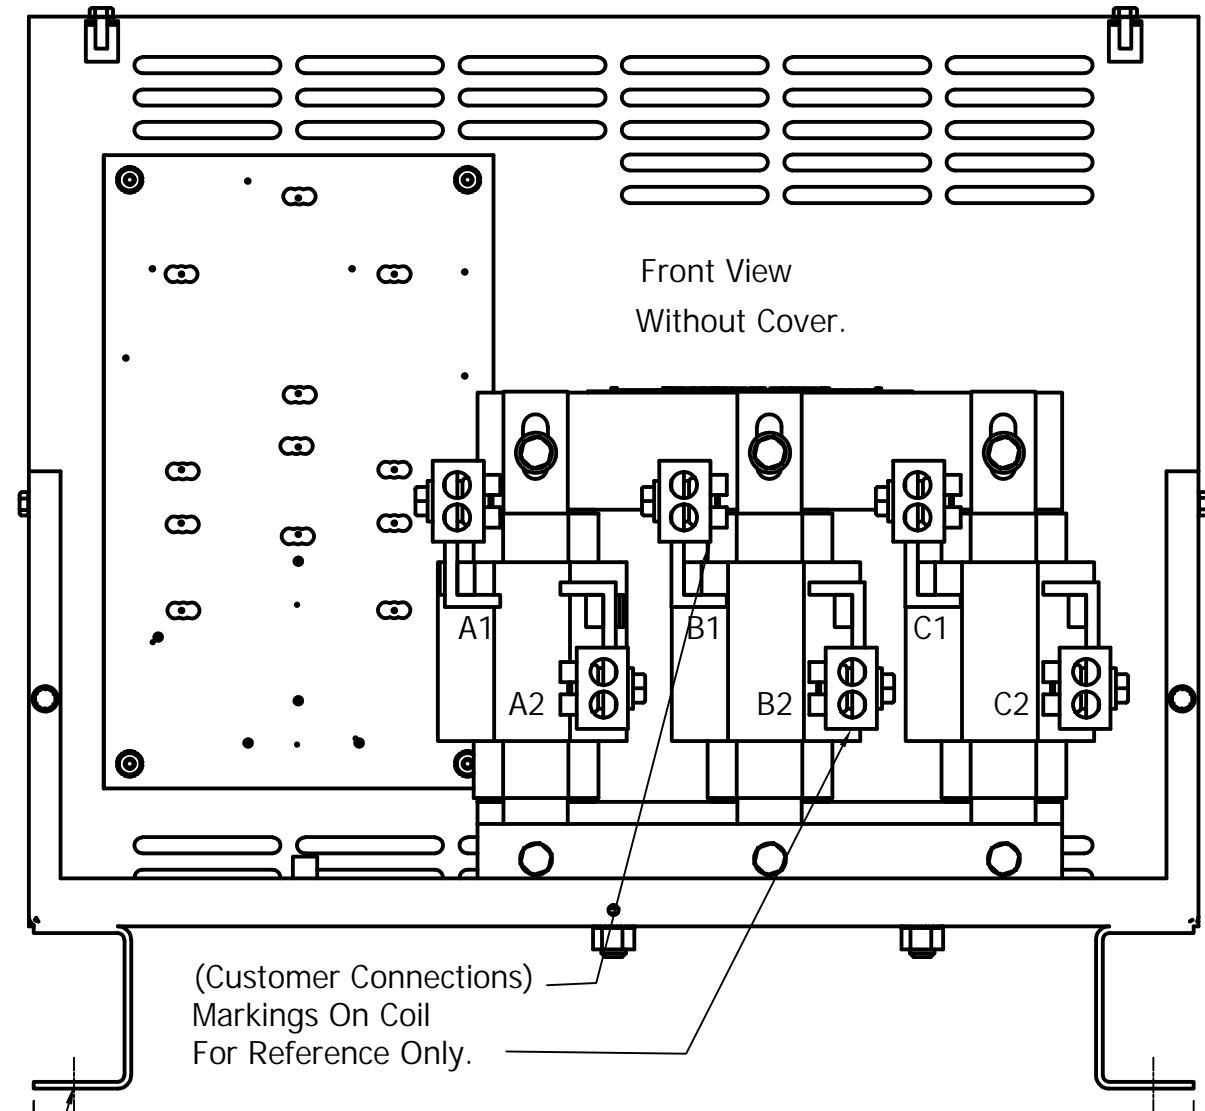

REACTOR AND BOARD ASSEMBLY CONNECTIONS

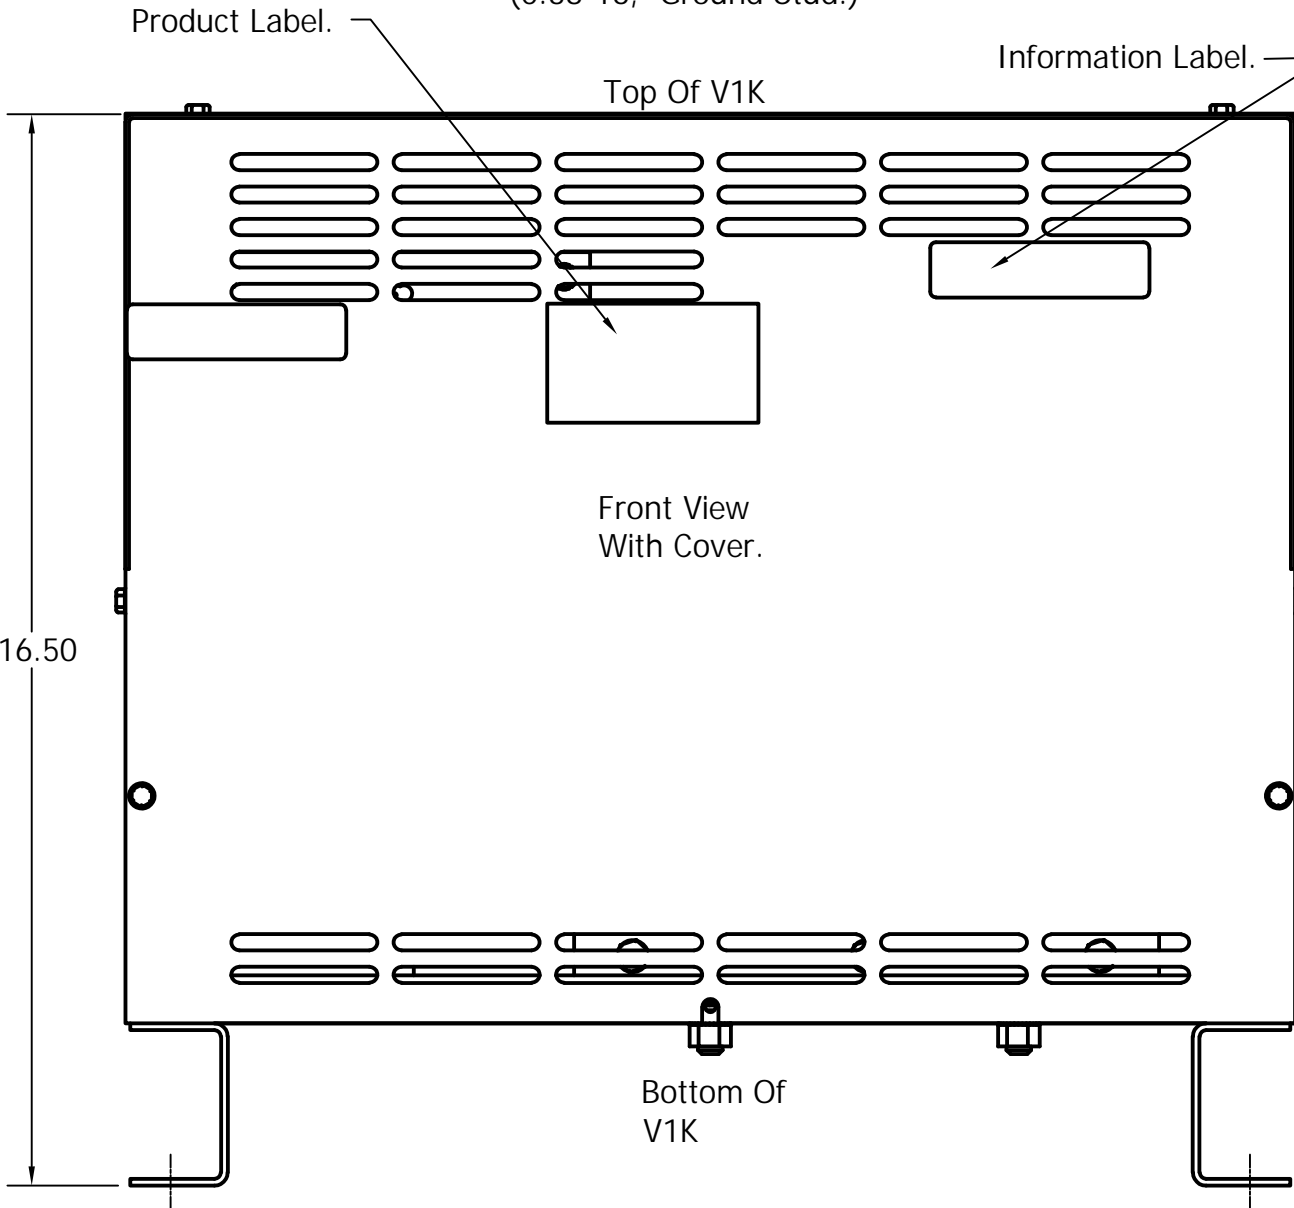

(Customer Connections) Markings On Coil For Reference Only.

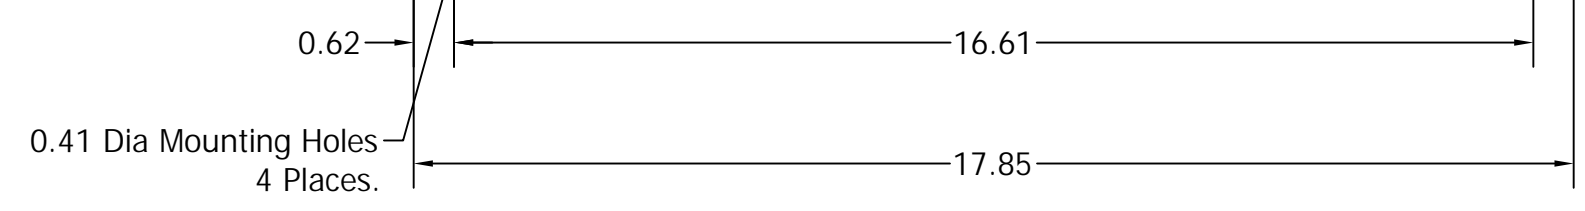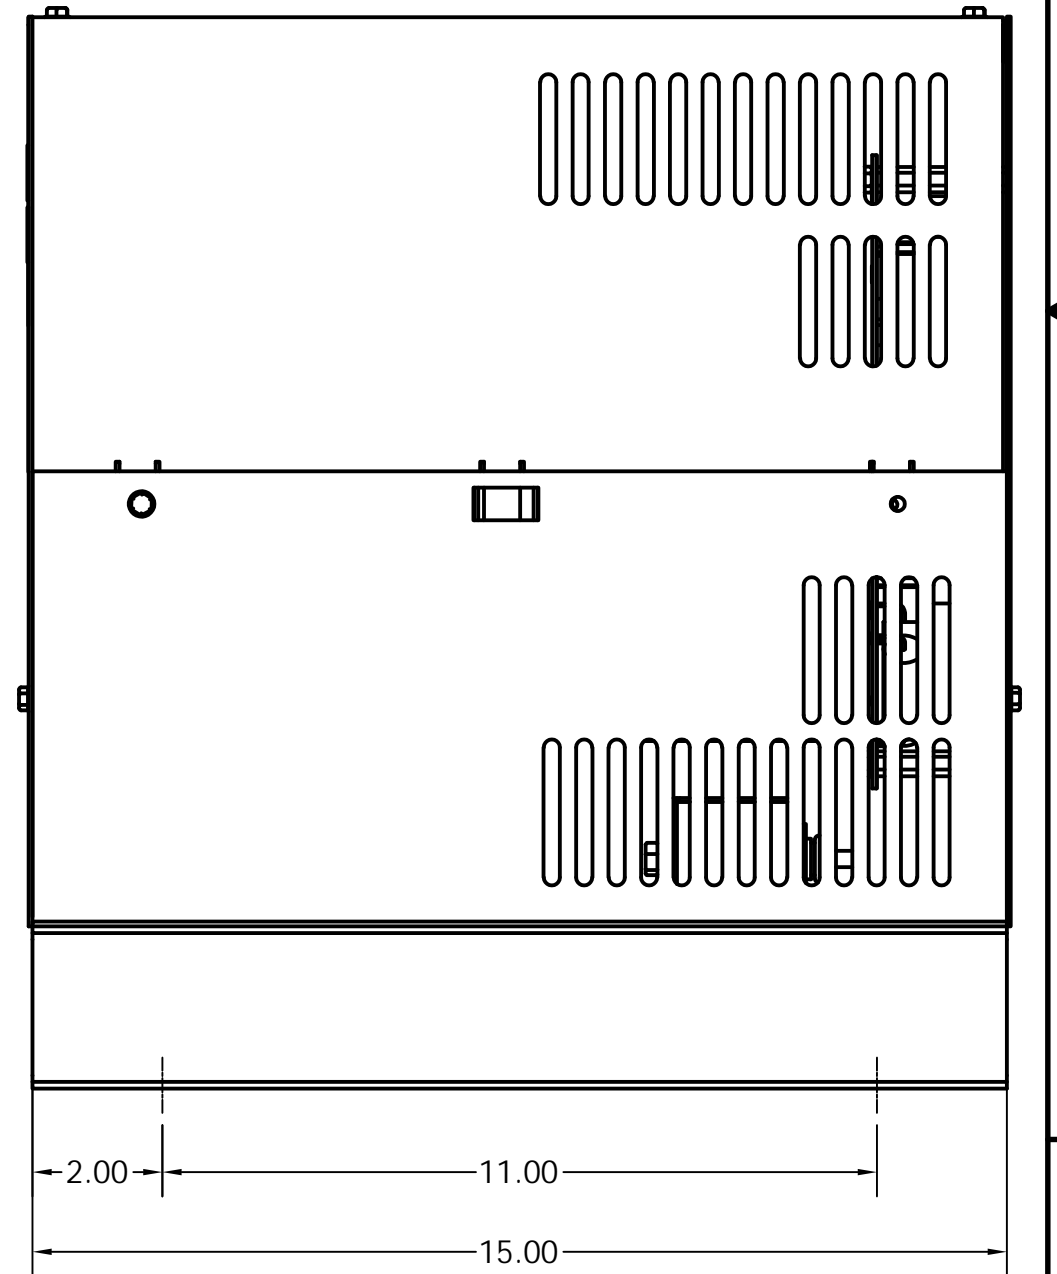

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	W132 N10611 Grant Drive Germantown, WI 53022 V1K, Enclosed, TYPE 1 200Amps, 250Amps
				DECIMAL	
				.XX ± .25 .XXX ± .10	
				FRACTIONAL ± 1/16	
	G 4030, Combine, Update V1K Drawings	6/23/17		ANGULAR ± 1°	DRN BY: DSW SCALE: TO FIT DATE: 4/26/17 APRVD:
	NO REVISION	DATE	BY		SIZE: 102410DG SHEET: 1 OF 1