


See V1K Installation Guide For Terminal Wire Size And Torque Information.

Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.


V1K Part Number	Rated Voltage	Amps	Phase	Weight (LBS)
V1K200A03	600	200	3	99
V1K200A03EX	600	200	3	99
V1K250A03	600	250	3	99
V1K250A03EX	600	250	3	99

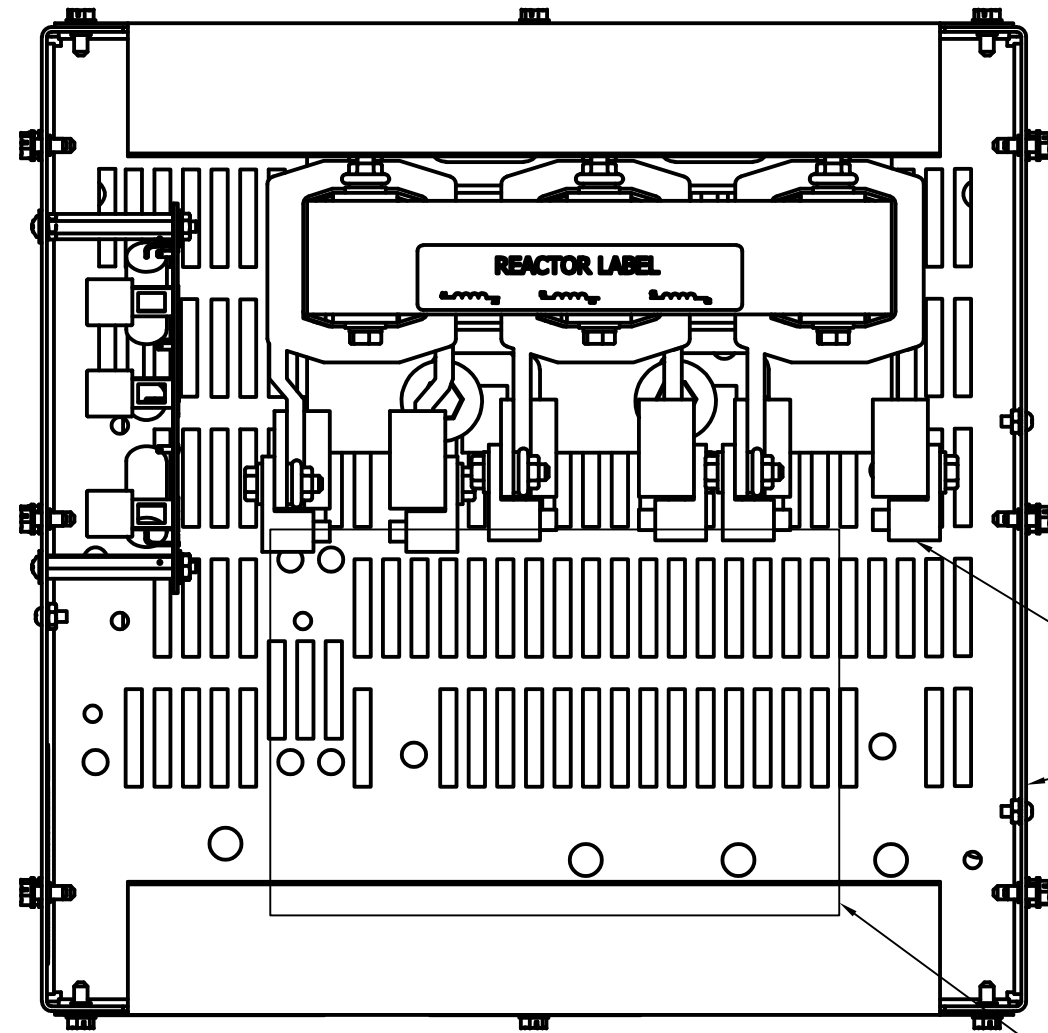




(Customer Connections) Markings On Coil For Reference Only.

Suggested Customer Entry Side Of Enclosure.

Suggested Customer Entry Bottom Of Enclosure.

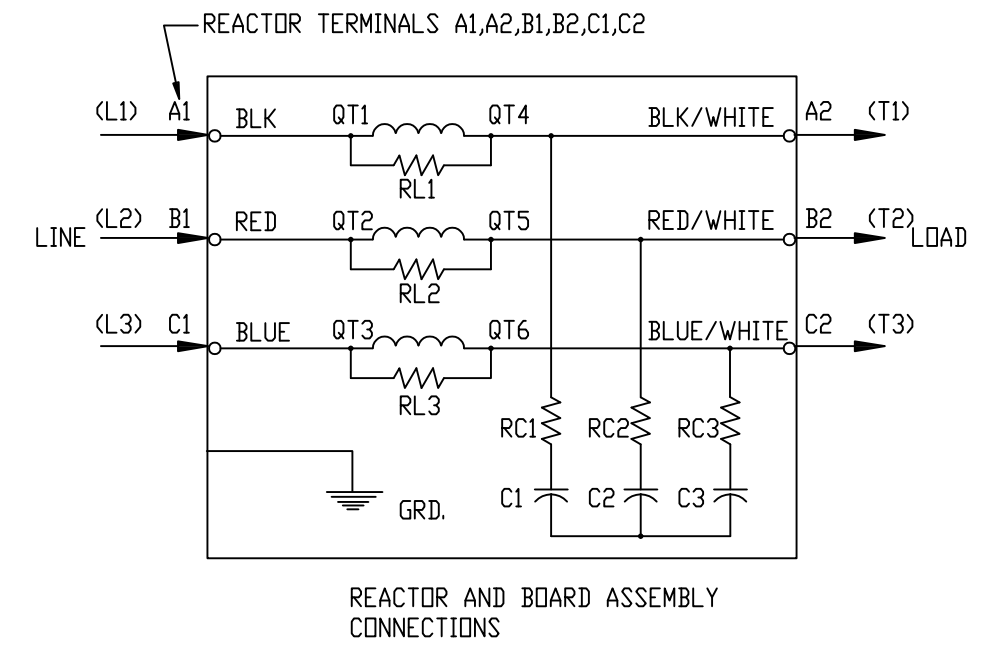

REACTOR AND BOARD ASSEMBLY CONNECTIONS

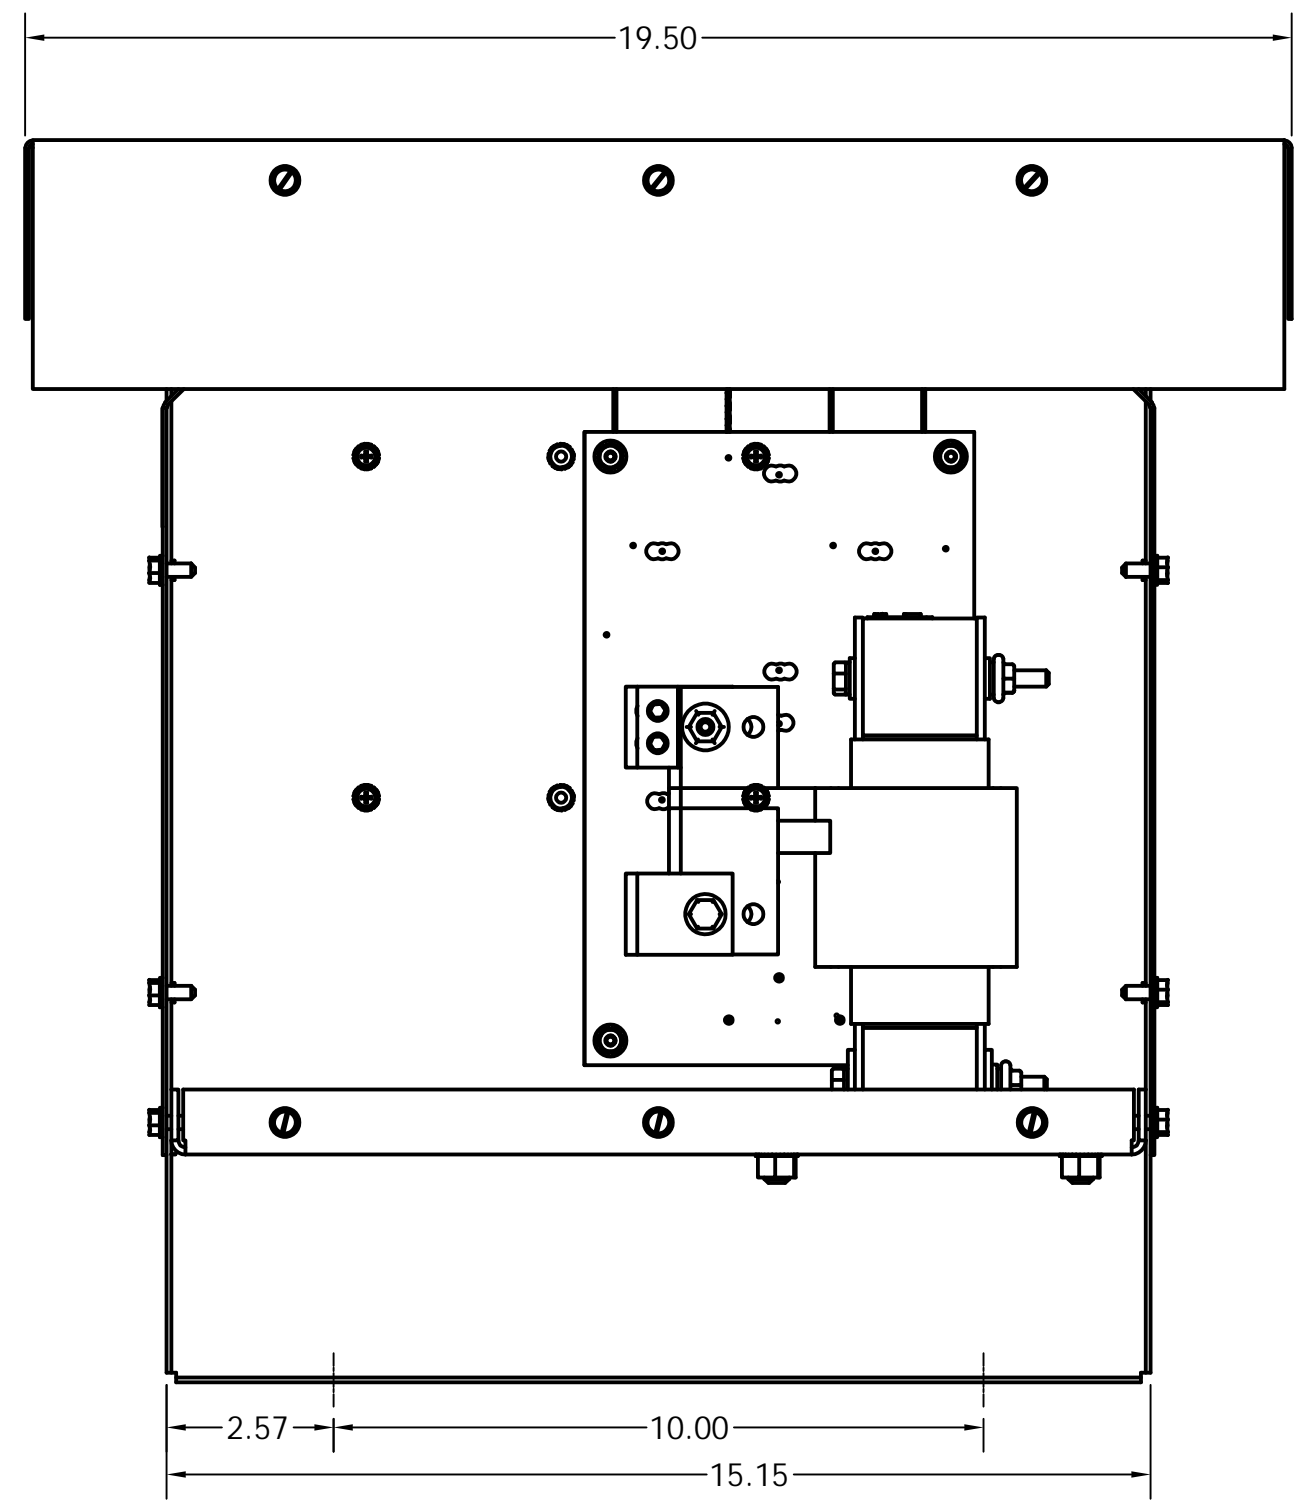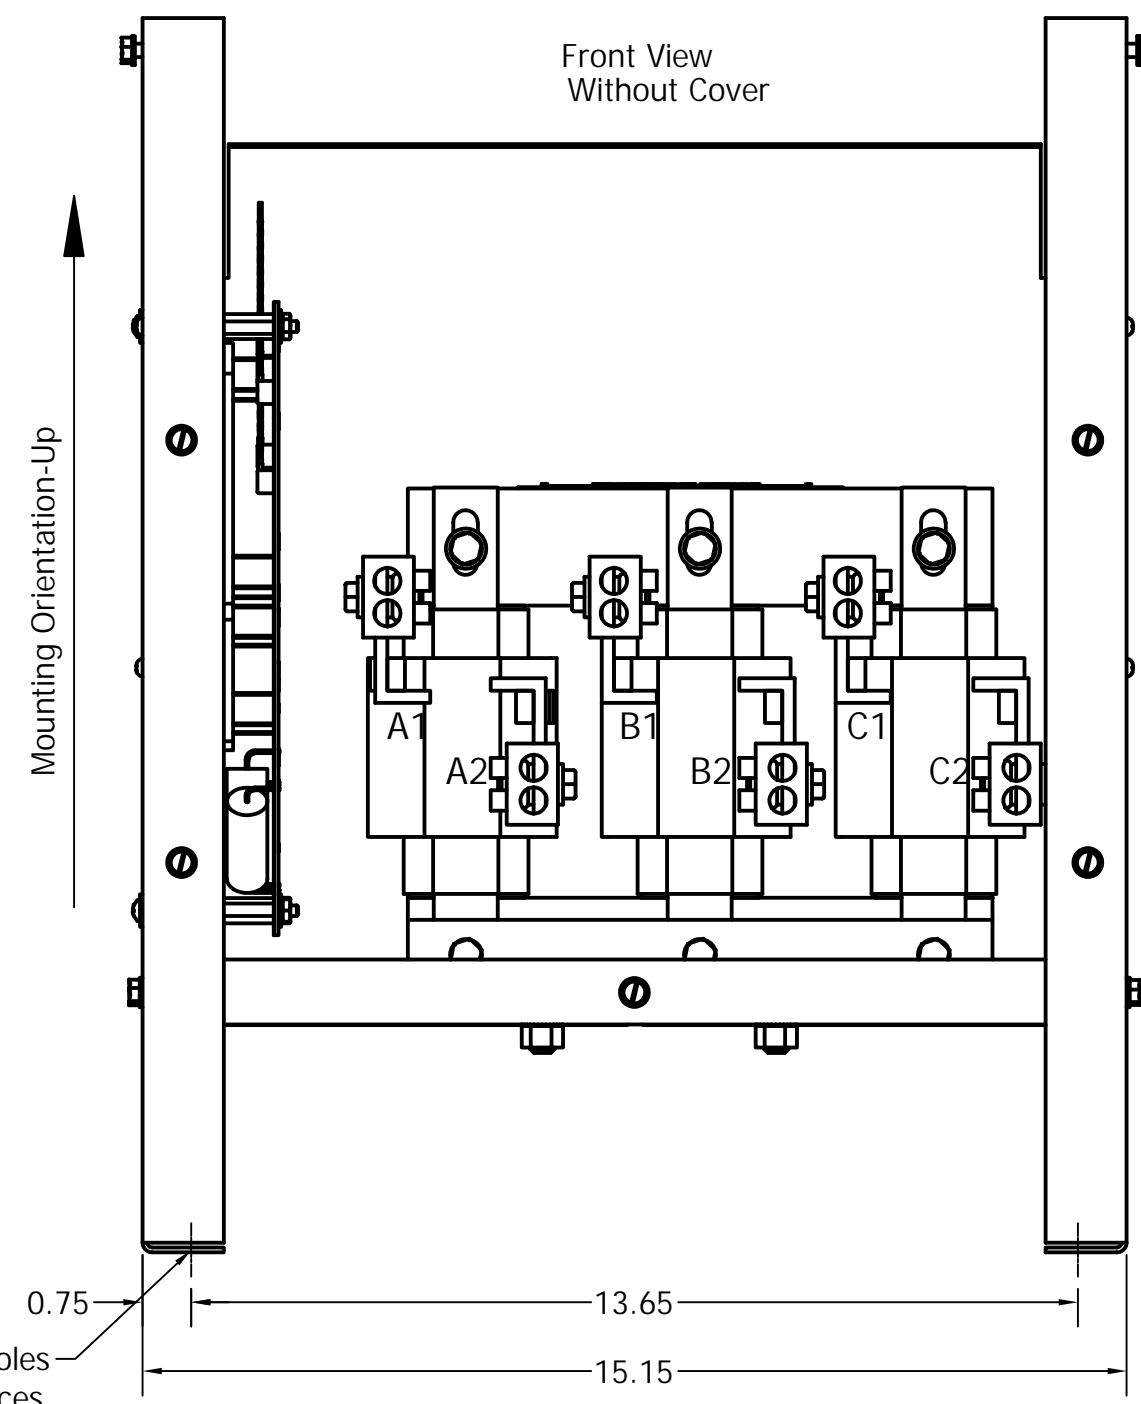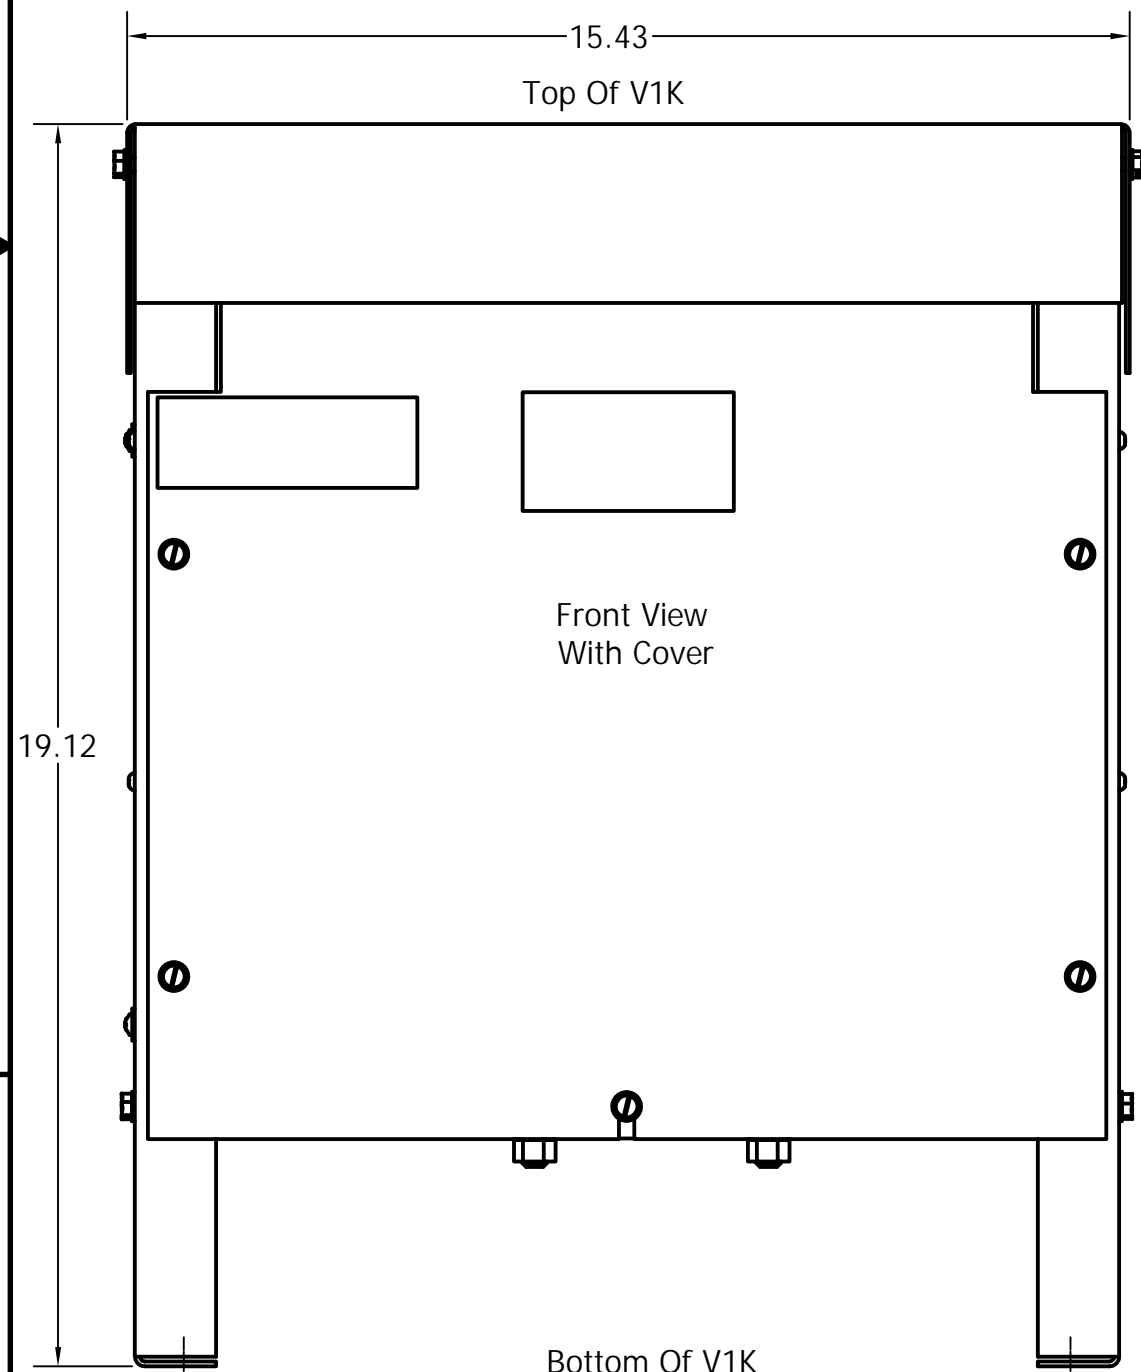

Material(s) Shall be RoHS Compliant

TOL TOLERANCES (EXCEPT AS NOTED)				TOL TOLERANCES (EXCEPT AS NOTED)	
DECIMAL				DECIMAL	
.XX ± .25				.XX ± .25	
.XXX ± .10				.XXX ± .10	
FRACTIONAL				FRACTIONAL	
± 1/16				± 1/16	
ANGULAR				ANGULAR	
± 1°				± 1°	

DRN BY	DATE	BY	DATE	SCALE	APRVD	DATE	SIZE	NO
DSW	6/26/17	DSW	6/27/17	TO FIT		6/26/17	C	104233DG
SHT 1 OF 1								

W132 N10611 Grant Drive
Germantown, WI 53022

V1K, TYPE 3R
200 Amps, 250 Amps

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.
NOTE: USE ONLY HUBS OR FITTINGS THAT COMPLY WITH UL514B FOR TYPE 3R ENCLOSURES