
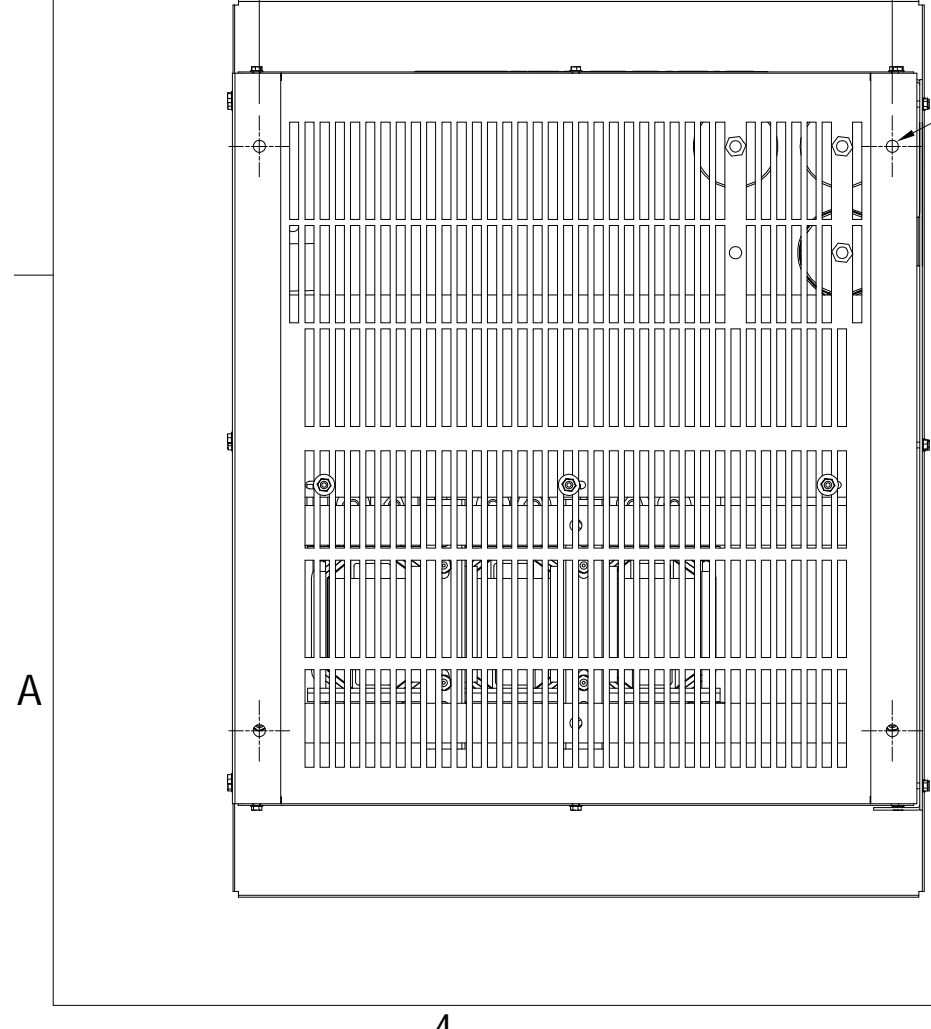
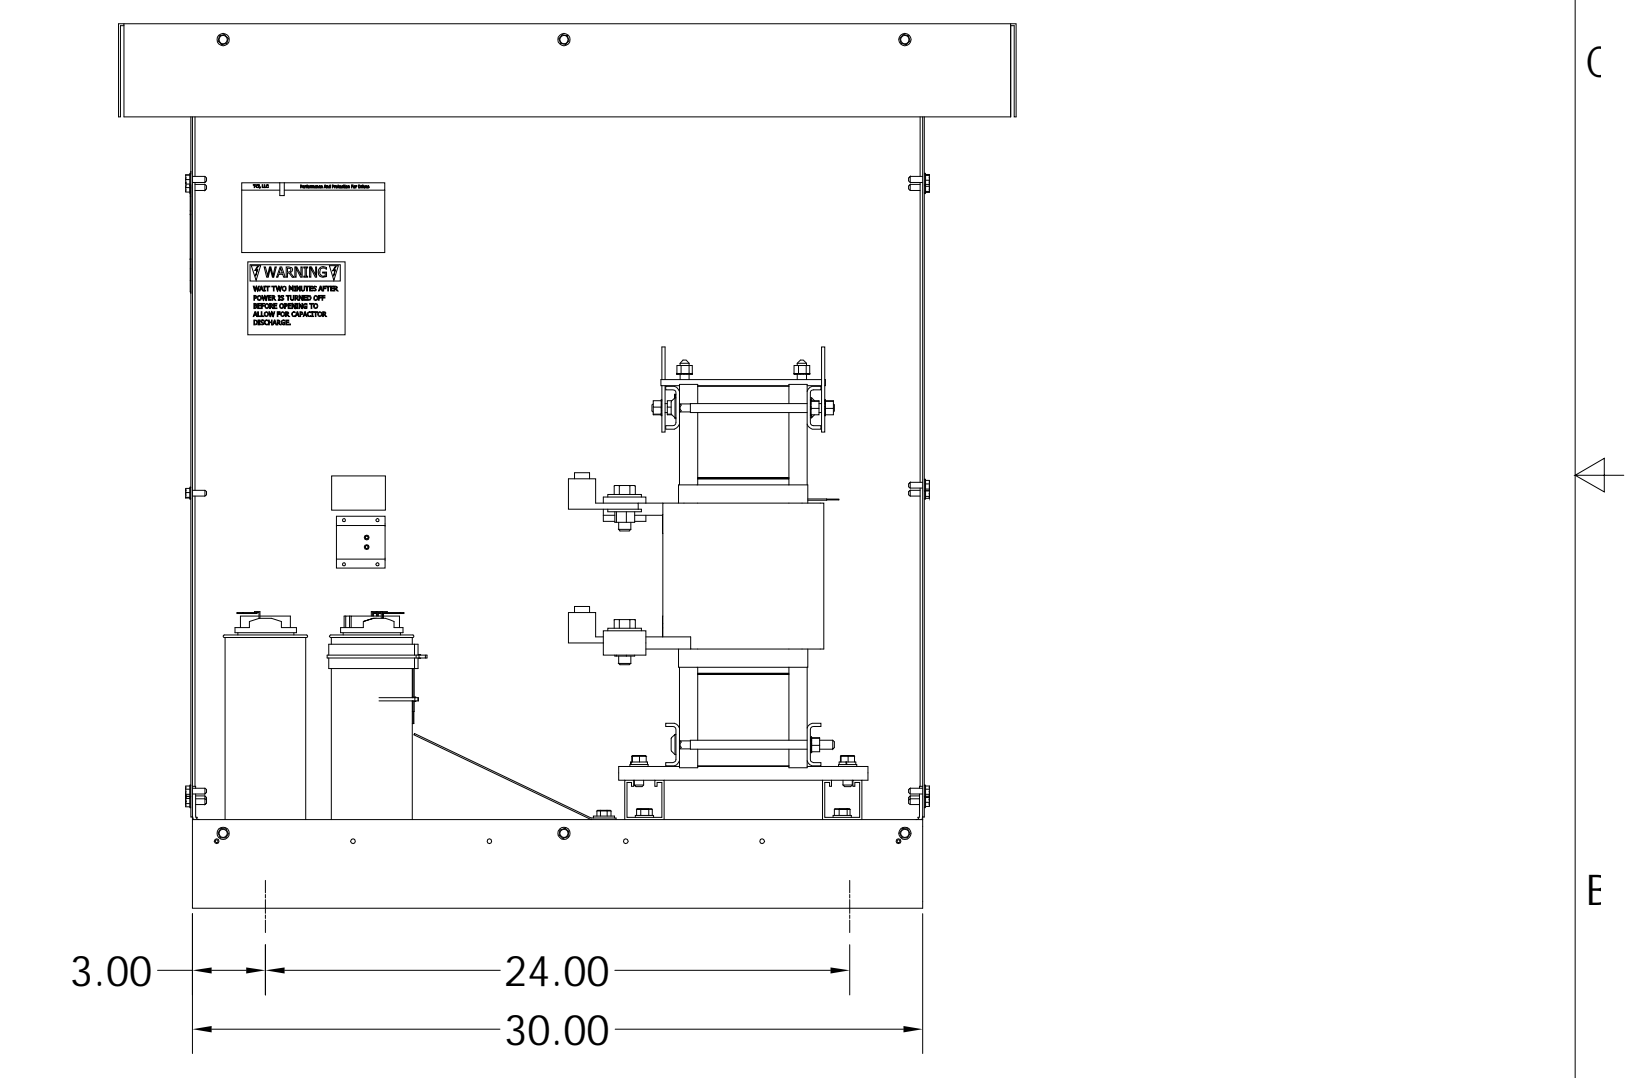
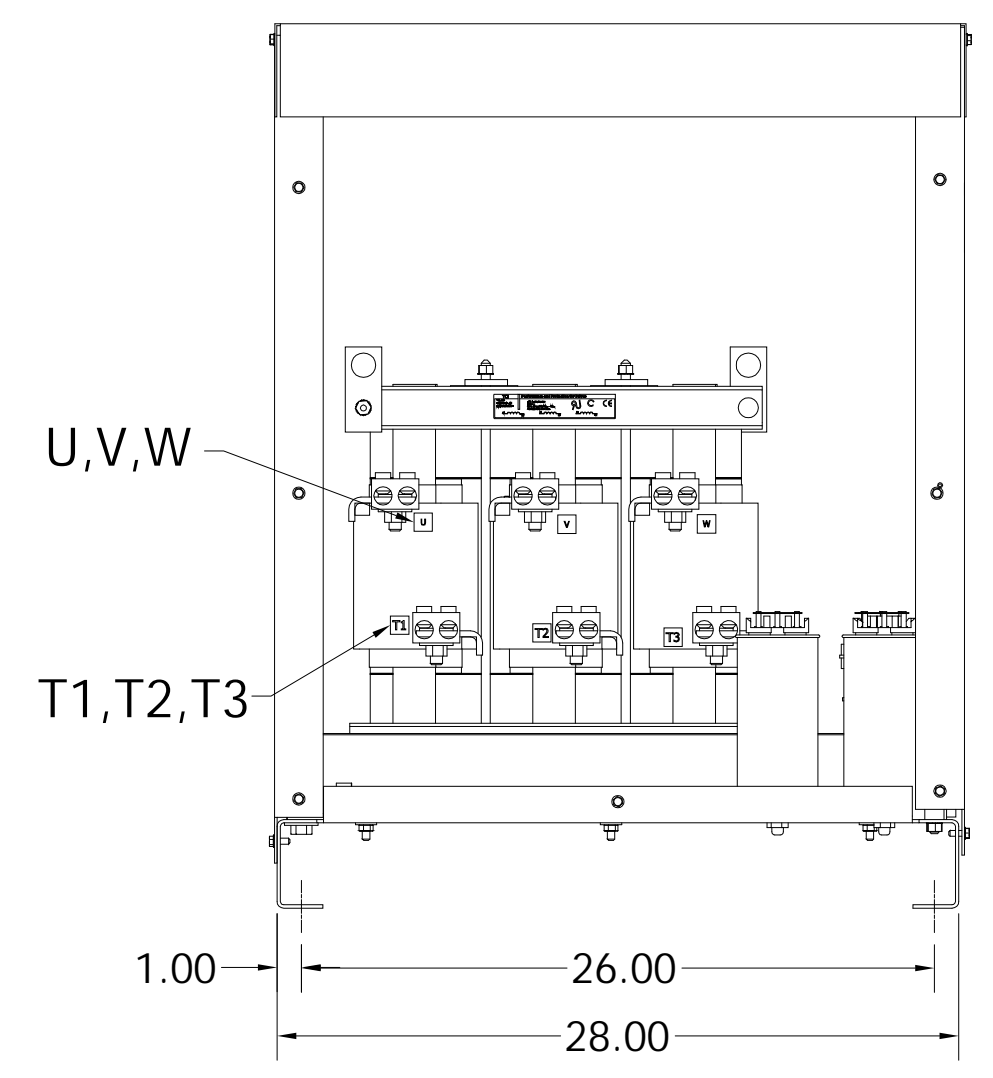
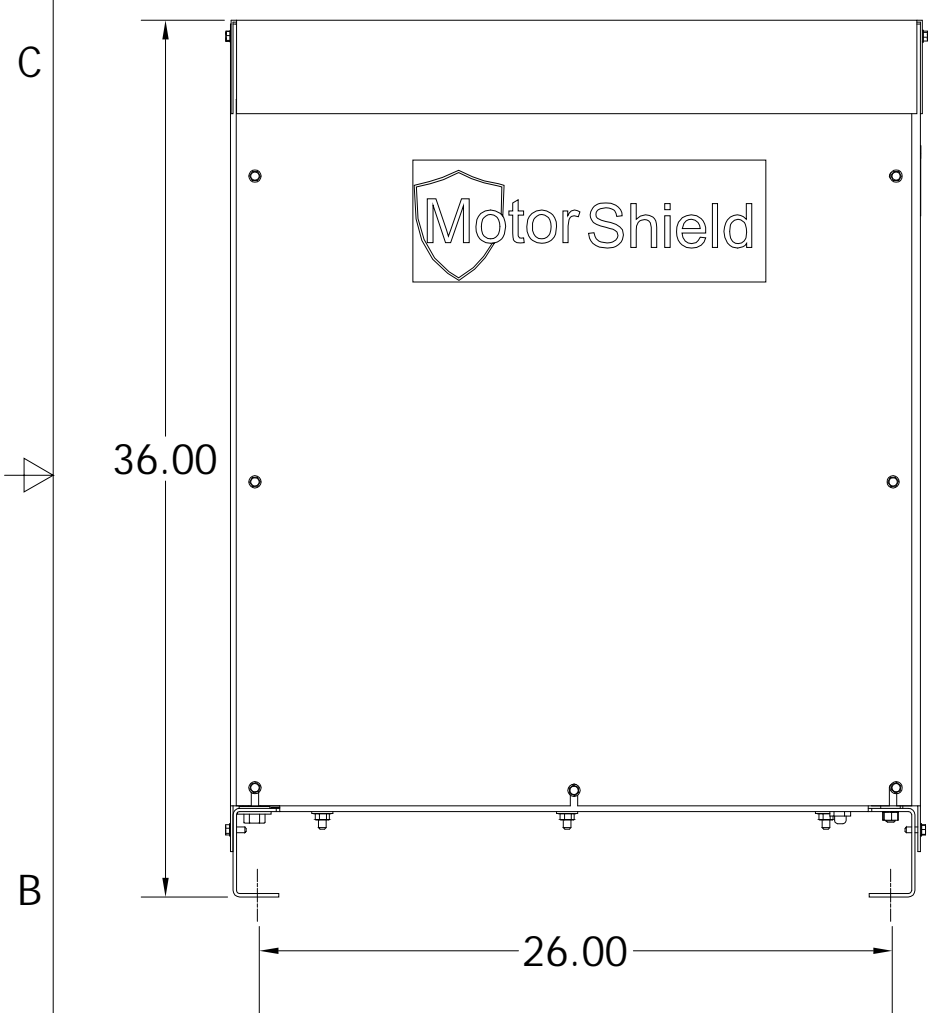
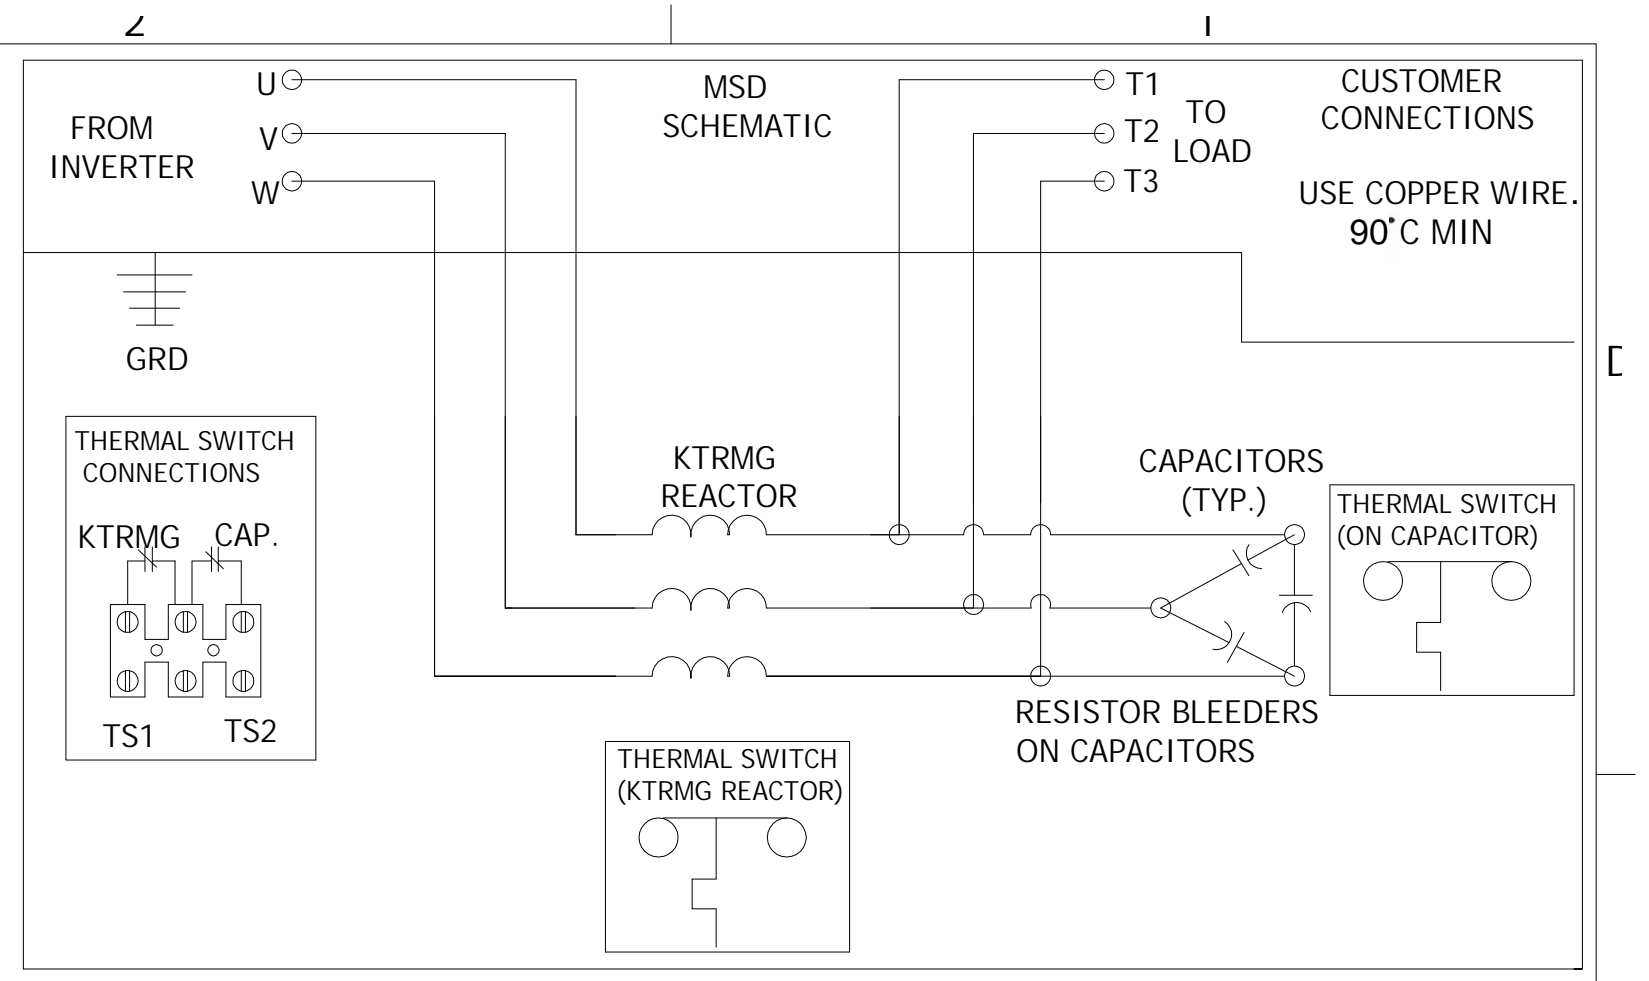


TERMINAL BLOCK ASSEMBLY, MOUNTED ABOVE CAPACITORS



MSD PART NUMBER	HP	VOLTAGE	CURRENT	WEIGHT	PRESSURE	TERMINAL WIRE RANGE
MSD0420A300	350	480V	420 AMPS	575LBS	(2)	600MCM-4AWG

NOTE: FOR TERMINAL TORQUE SEE IOM MANUAL.

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	SCALE	DATE	APRVD.	DWG. No.	SHEET	OF
B	3696 ADD DISCHARGE	8/1/16	DSW	DECIMAL .XX +/- .25 .XXX +/- .10	1/8	5/19/2015		106057DG	1	1
A	AS BUILT	5/19/15	DSW	FRACTIONAL +/- 1/16 ANGULAR +/- 1°						
NO										

**TCI**® W132 N10611 Grant Drive  
 Germantown, WI 53022  
**MSD0420A300**  
 MotorShield Sinewave Filter  
 420 AMPS, 480/3/60, Type 1/3R.