

CUSTOMER CONNECTIONS INTO SINEWAVE FILTER

CUSTOMER CONNECTIONS

480 VOLTS FROM DRIVE  
80Hz MAX

FUSED DISCONNECT OR CIRCUIT BREAKER (CUSTOMER SUPPLIED)


USE COPPER WIRE  
60°C MIN <100 A.  
75°C MIN ≥100 A.

Customer To Supply 480V, Single Phase Power For fans


**DO NOT:**  
Connect Transformer To VFD Output Or Any Filter Terminals

Location of Secondary (Fu6), when used.

POWER SCHEMATIC

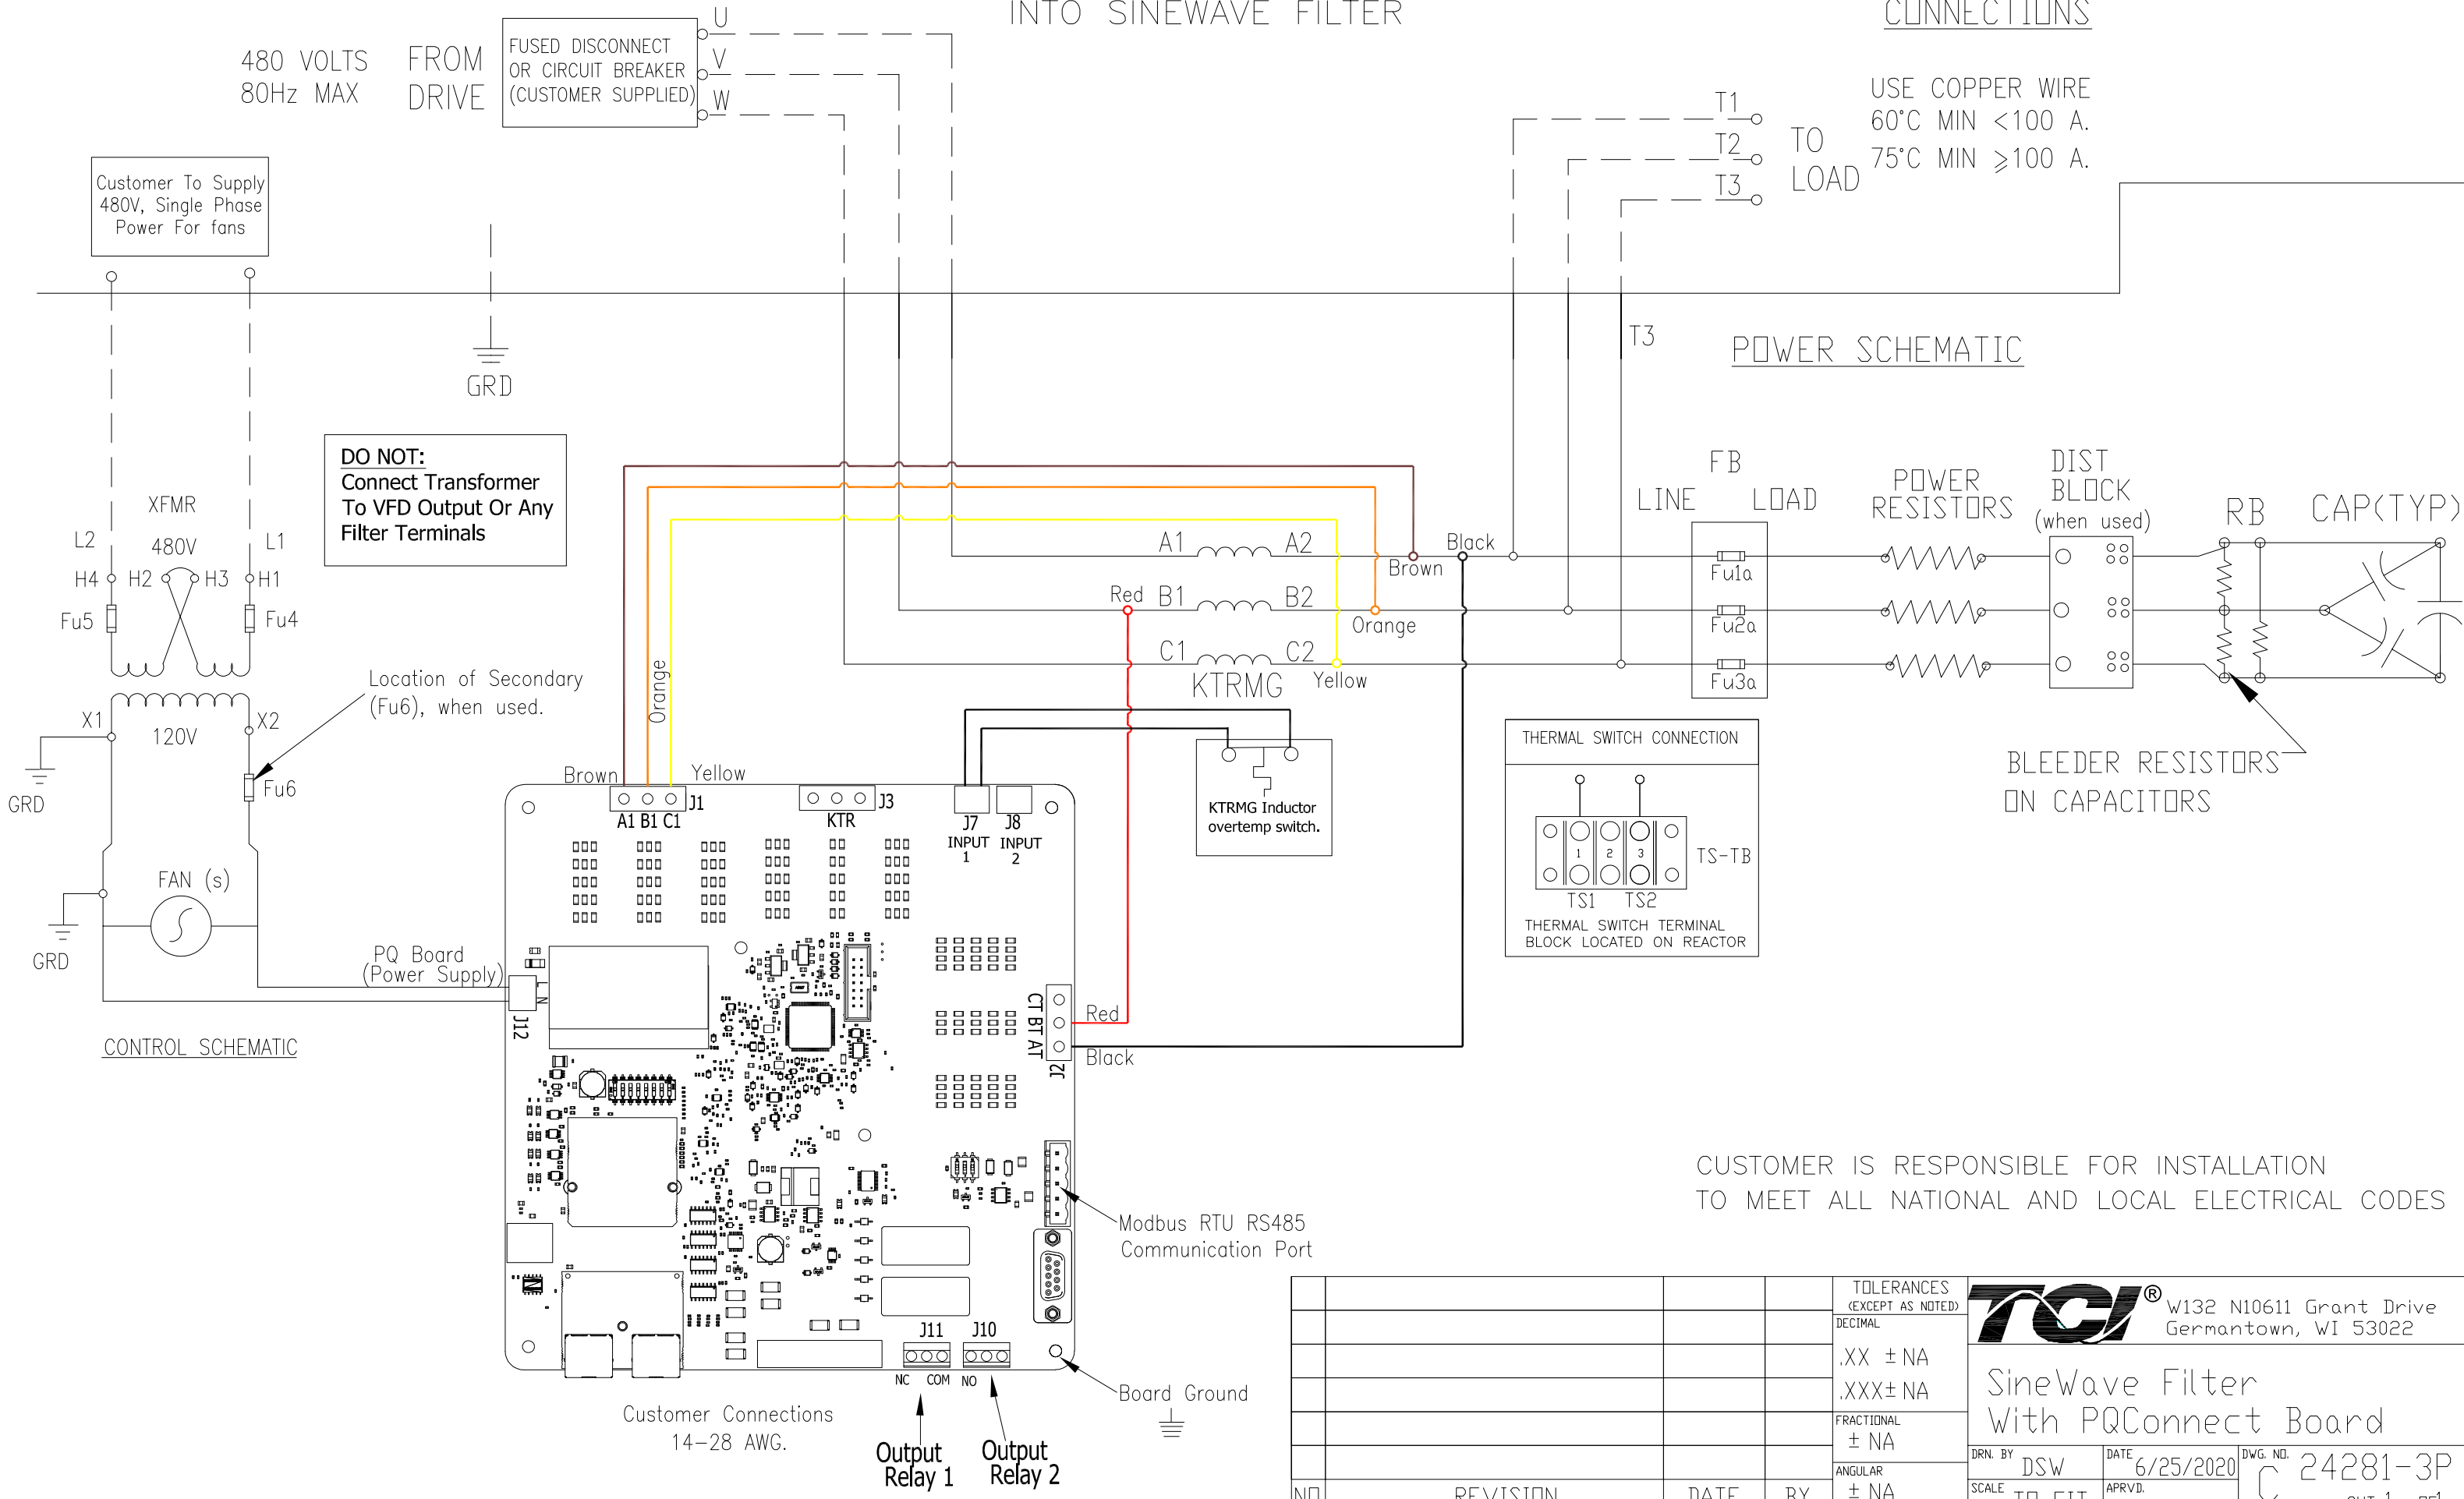

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES

				TOLERANCES (EXCEPT AS NOTED)	 W132 N10611 Grant Drive Germantown, WI 53022
				DECIMAL	
				.XX ± NA	
				.XXX ± NA	
				FRACTIONAL	
				± NA	
				ANGULAR	
				± NA	
NO	REVISION	DATE	BY	DRN. BY DSW	DATE 6/25/2020
				SCALE TO FIT	APRVD.
				DWG. NO. 24281-3P	
				SHT. 1 of 1	