

- NOTES:
- 1) DASHED LINES SURROUND OPTIONAL DISPLAY INTERFACE PCB CIRCUITRY, DOOR MOUNTED HMI CONNECTION, INDICATOR LIGHTS, AND RUN KEY SWITCH WHEN DISPLAY INTERFACE PCB IS INTERNAL TO 3R ENCLOSURE.
  - 2) OPTIONAL REMOTE MOUNTED DISPLAY INTERFACE PCB/HMI ASSEMBLY WITH CUSTOMER SUPPLIED FUSE.
  - 3) REFER TO CUSTOMER CONNECTION DIAGRAMS #25027-3 & 28283-1.

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.


NO	REVISION	DATE	BY
P	update thermostat settings	3/12/19	MJS
N	CIRCUIT UPDATES	10/23/18	MJS
M	Change thermo contacts	4/16/18	RHW
L	Update TB1 12 position	1/25/17	MJS
K	3687 CR5-CR8 pinout update	11/4/16	MJS
J	3687 vibration proof CR2 update	9/2/16	MJS

**TCI**® W132 N10611 Grant Drive  
Germantown, WI 53022

50 to 150A Active Filter  
Bus Applied Type 3R

DRN. BY	RHW	DATE	1/31/13	DWG. NO.	28359
SCALE	N/A	SIZE	B	SHT.1 OF 2	



Enclosure Environment Control Circuit

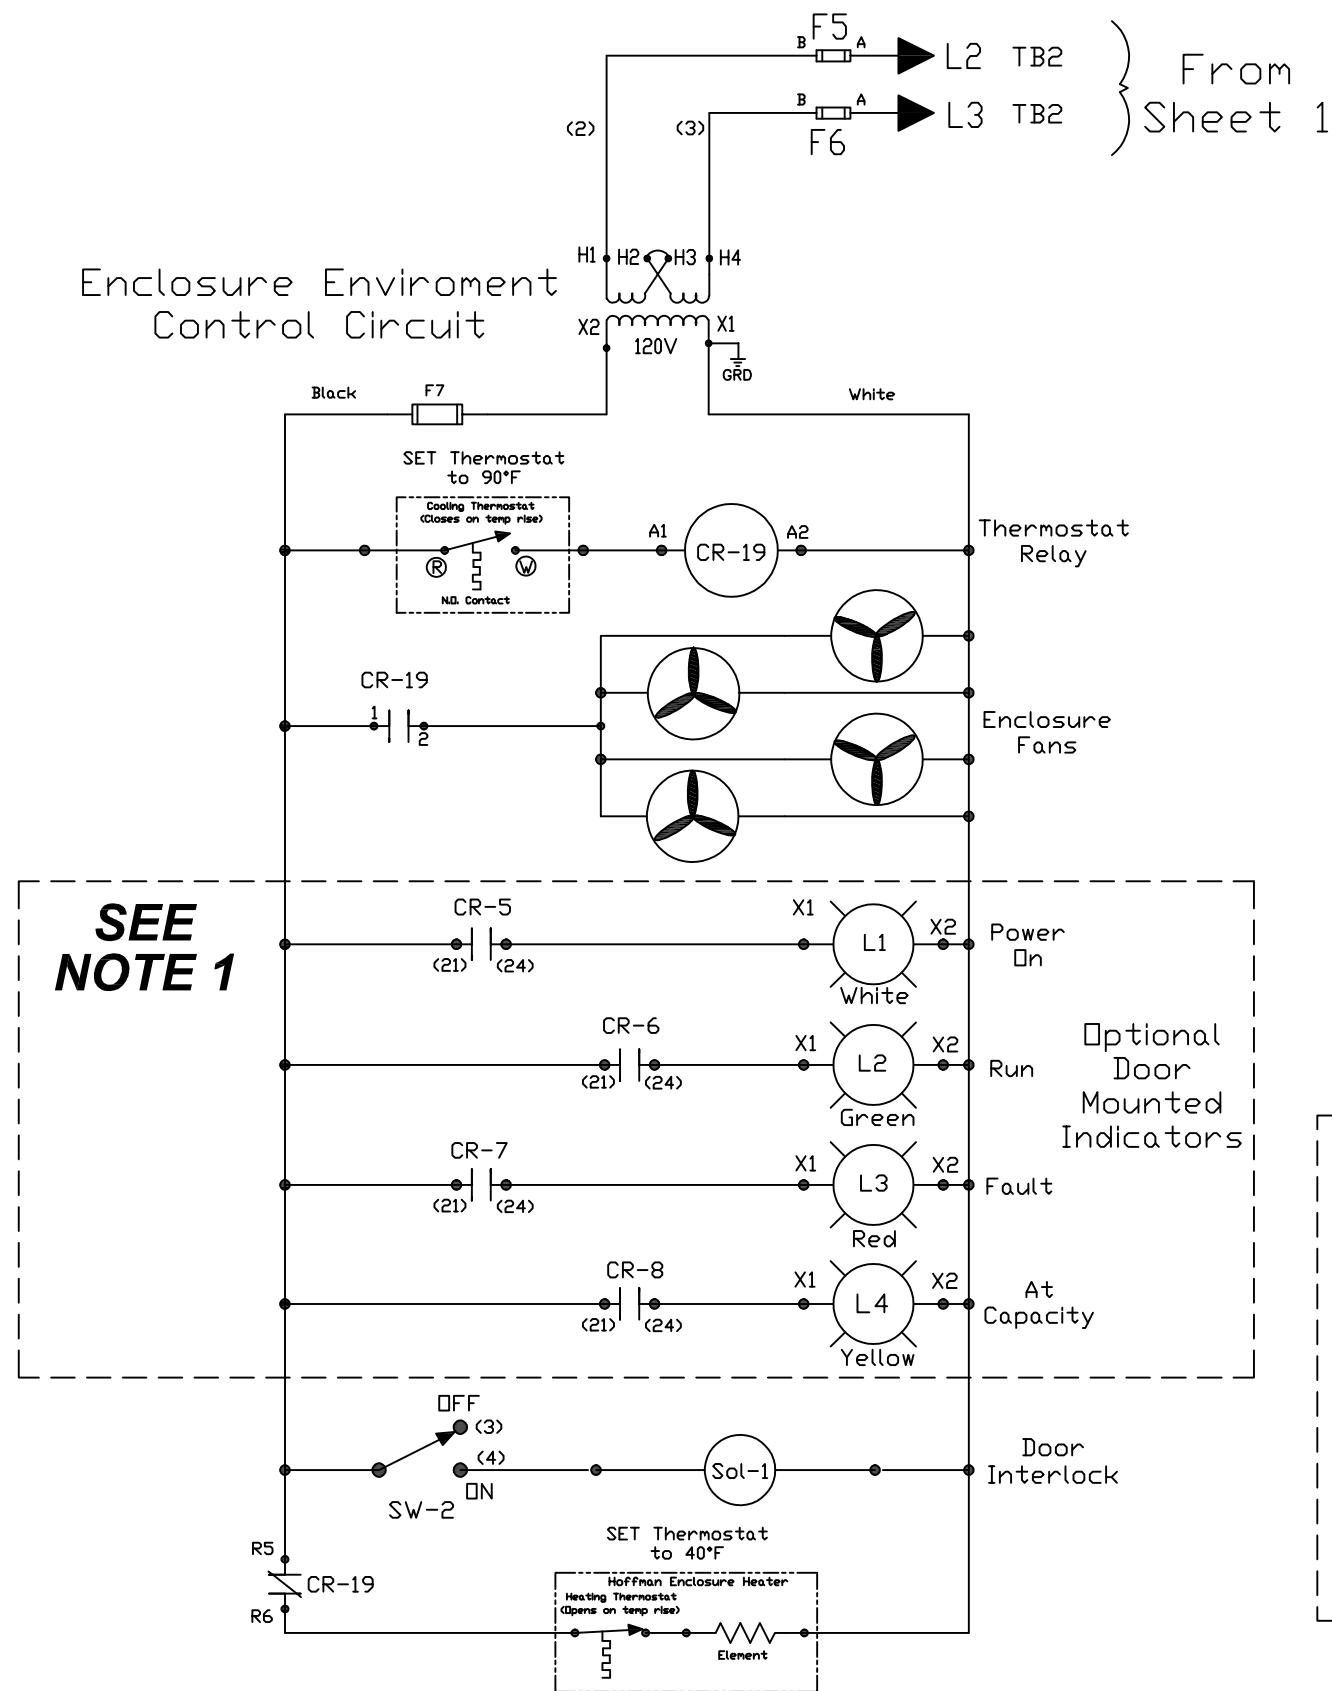

From Sheet 1

**SEE NOTE 1**

**SEE NOTE 1**

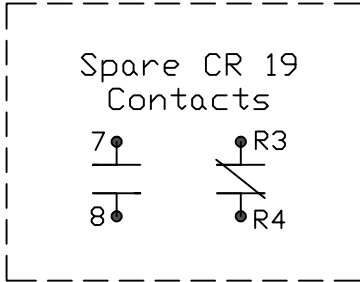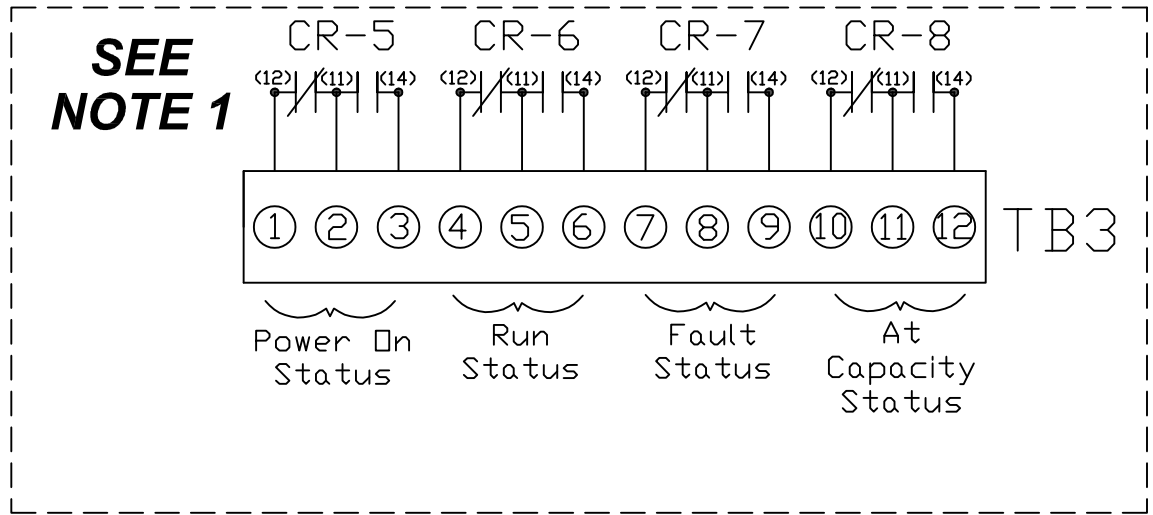

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

					TOLERANCES (EXCEPT AS NOTED)
					DECIMAL
					.XX ± .03
					.XXX ± .010
					FRACTIONAL
					± 1/32
					ANGULAR
					± 1°
NO	REVISION	DATE	BY	See Sheet 1	

**TCL**® W132 N10611 Grant Drive  
Germantown, WI 53022

50 to 150A Active Filter  
Type 3R

DRN. BY	RHW	DATE	1/31/13	DWG. NO.	28359
SCALE	N/A	SIZE	B		SHT. 2 OF 2