



CONTROL CONNECTIONS

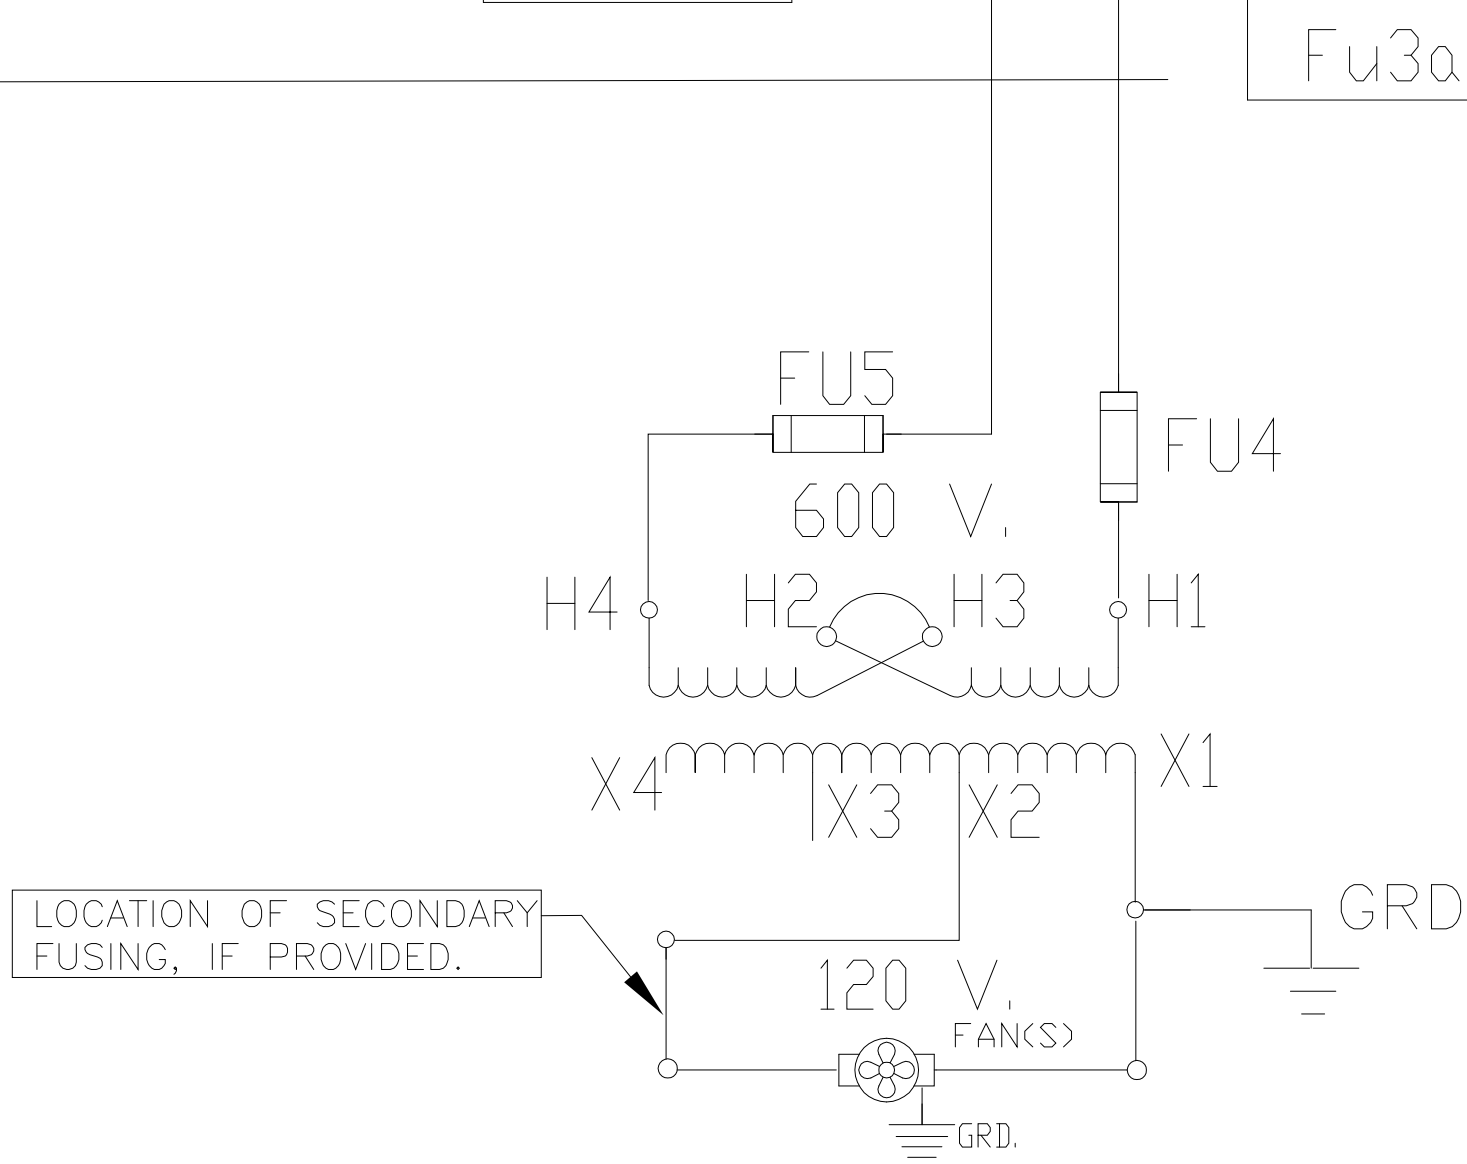

SCHEMATIC FOR FUSE MONITOR, OPTION

CONNECTIONS FOR FUSE MONITOR OPTION

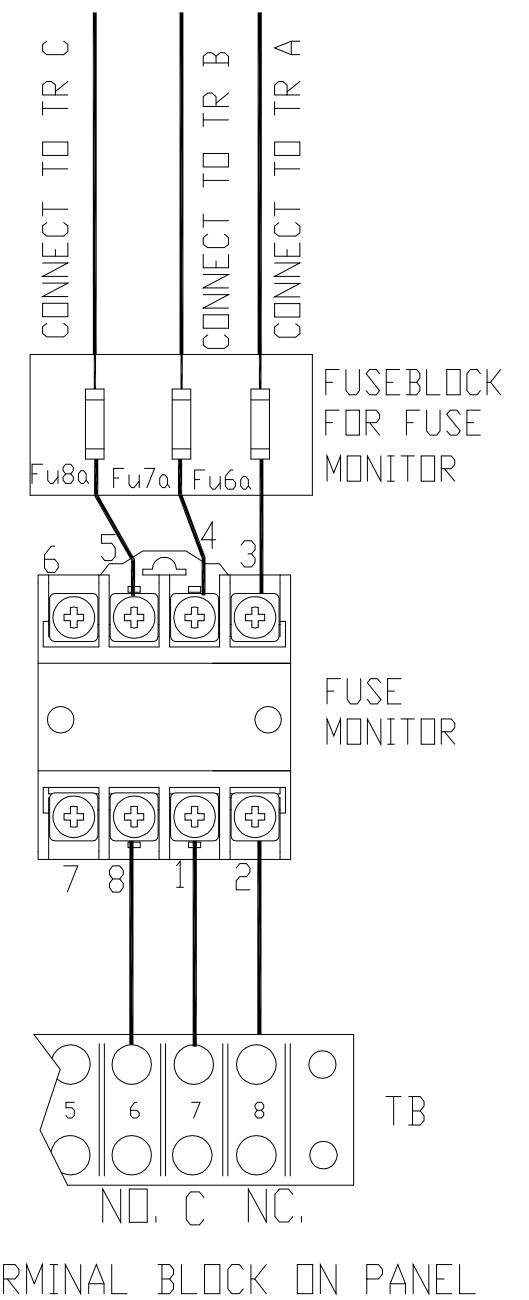

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

TCl, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCl AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCl.

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	.XX ± NA
FRACTIONAL	.XXX ± NA
ANGULAR	± NA

**TCl** W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022  
 HARMONICGUARD PASSIVE 600V SCHEMATIC

DRN BY DSW	DATE 3/17/15	DWG NO. 29474-4
SCALE NONE	SIZE C	SHT.1 OF1