


CUSTOMER CONNECTIONS


75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE

ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

CONTROL CONNECTIONS WITH IF FAN(S) SUPPLIED

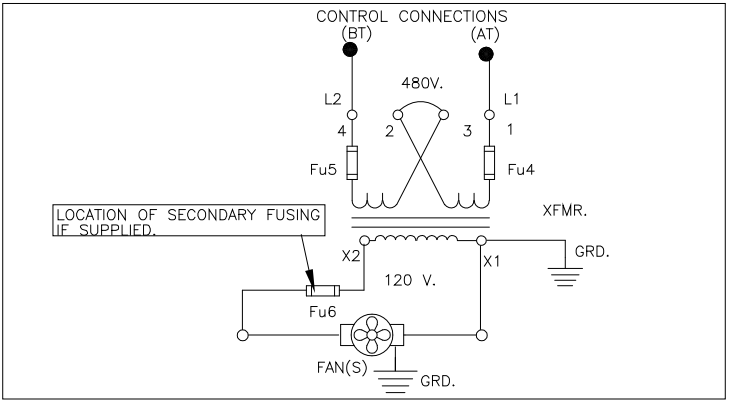

SCHEMATIC FOR FUSE MONITOR, OPTION

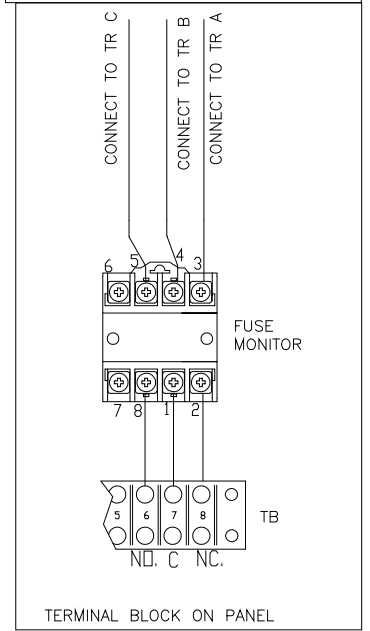

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREDJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.	NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	<p>W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022</p> <p>HGL PASSIVE 480V SCHEMATIC STANDARD VERSION</p> <p>DRN BY DSW DATE 3/31/17 DWG. NO. 30586-1</p> <p>SCALE NONE SIZE C SHT.1 OF 1</p>
					DECIMAL	
					.XX ± NA	
					.XXX ± NA	
					FRACTIONAL ± NA	
				ANGULAR ± NA		