


480V.
60 HZ.
LINE


FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

L1 L2 L3
CUSTOMER CONNECTIONS
T1 T2 T3 LOAD


CUSTOMER CONNECTIONS
75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

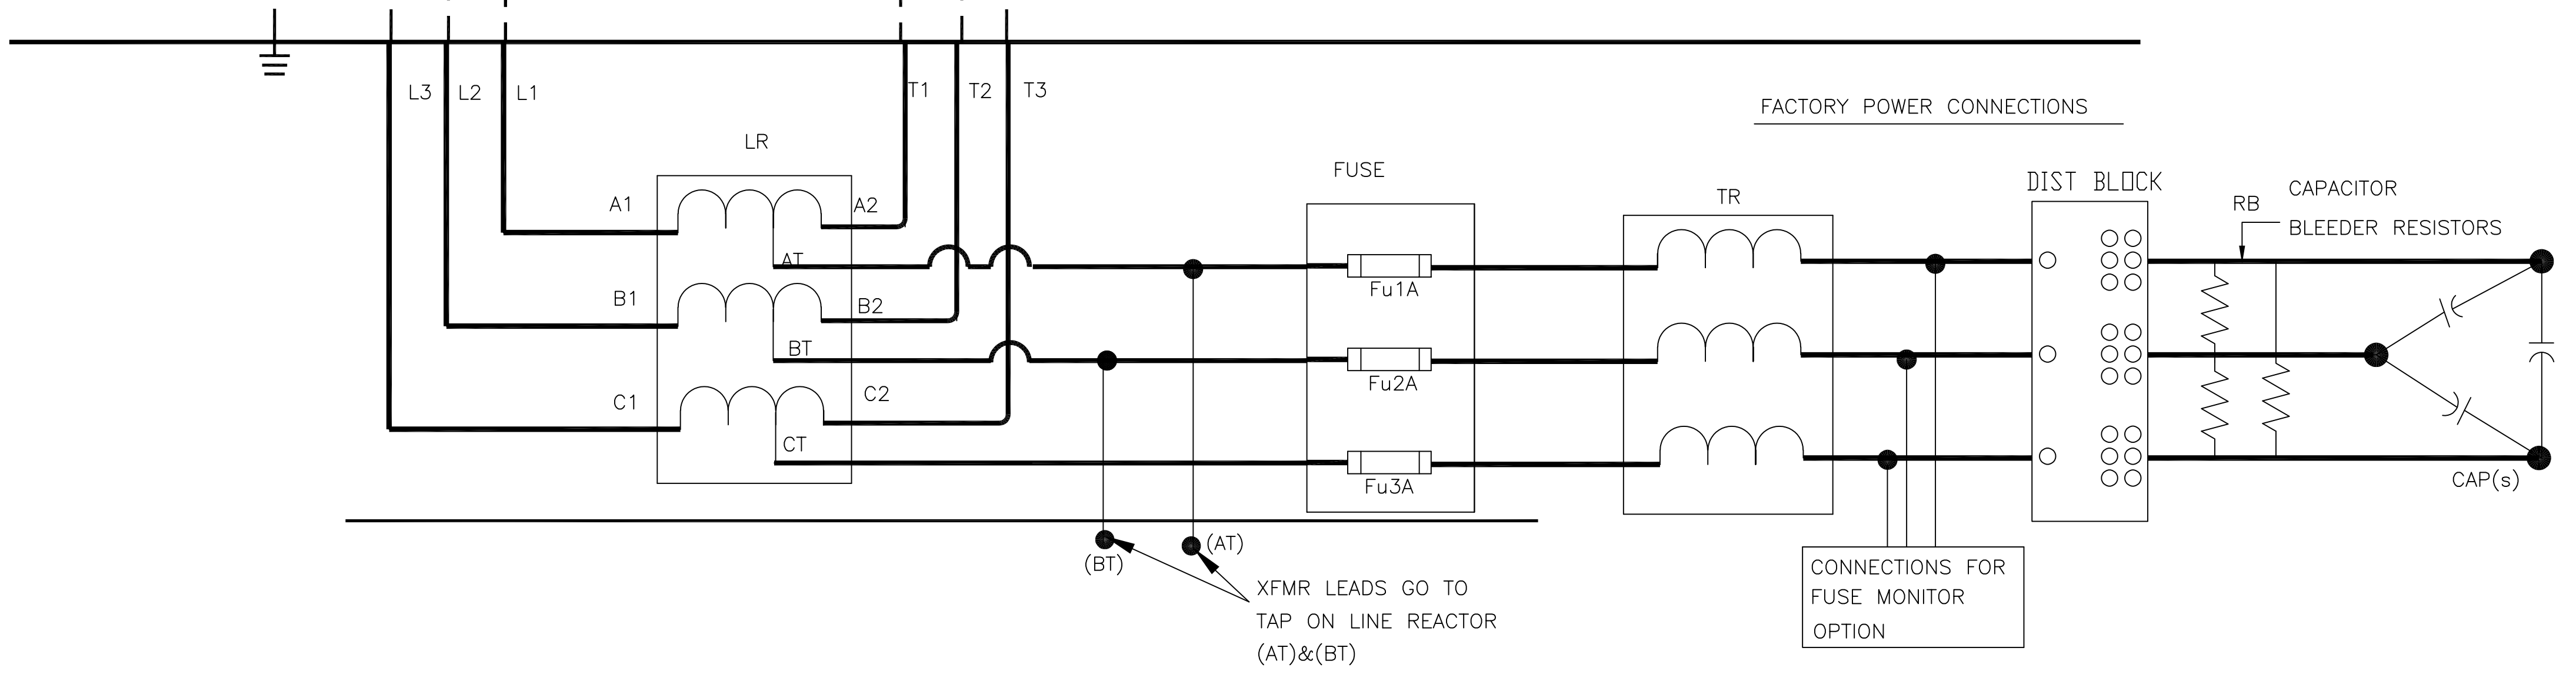

CONTROL CONNECTIONS WITH IF FAN(S) SUPPLIED

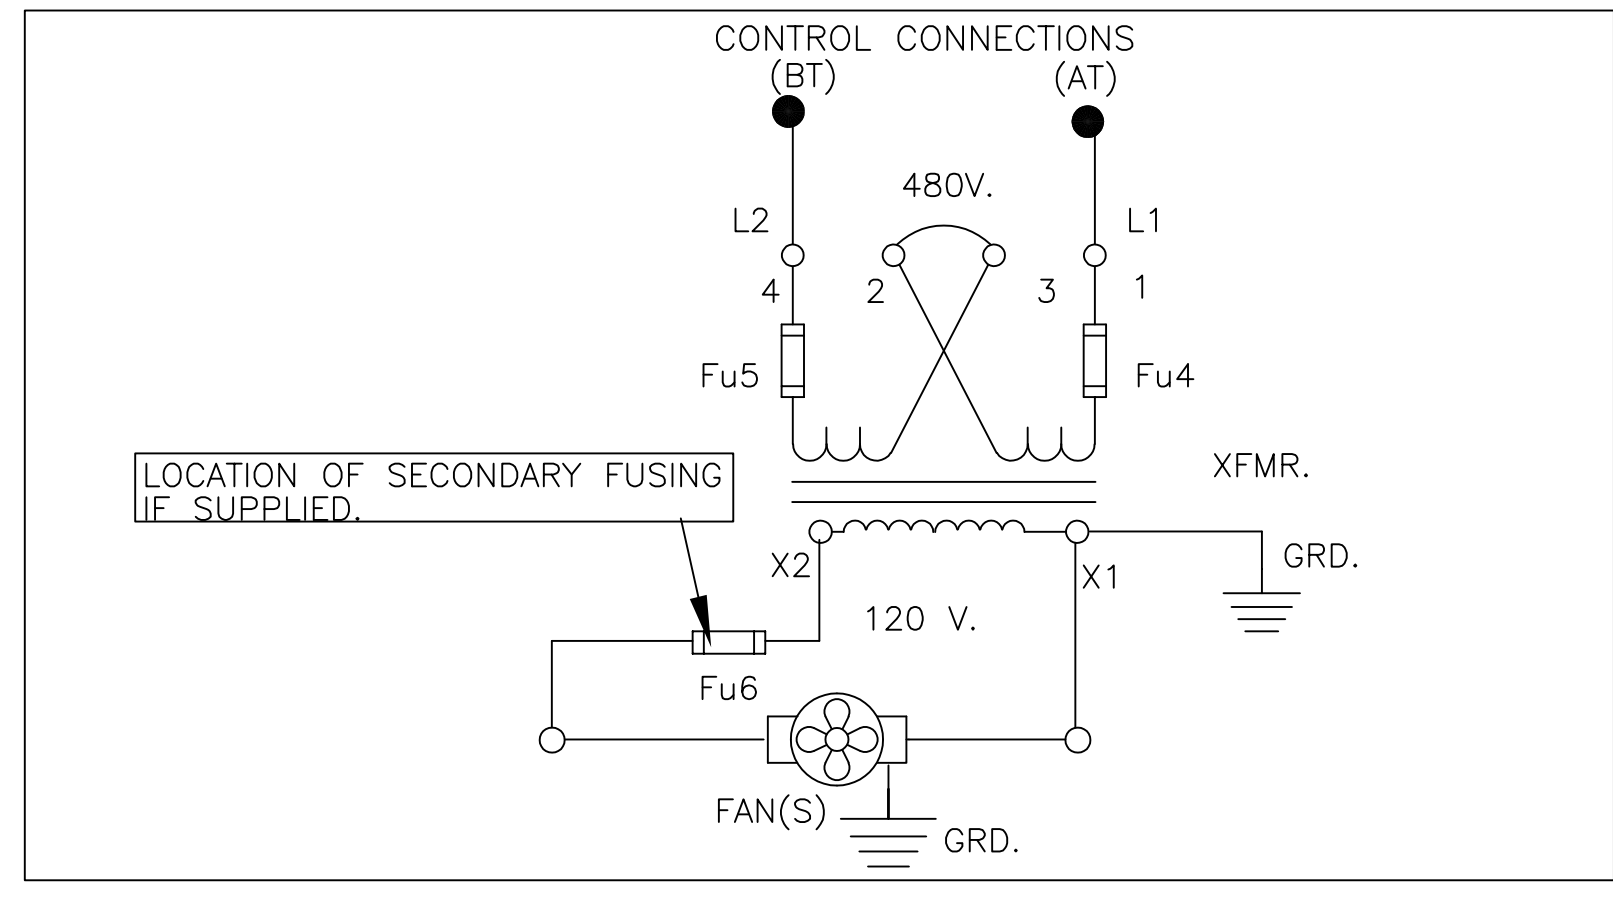

SCHEMATIC FOR FUSE MONITOR, OPTION

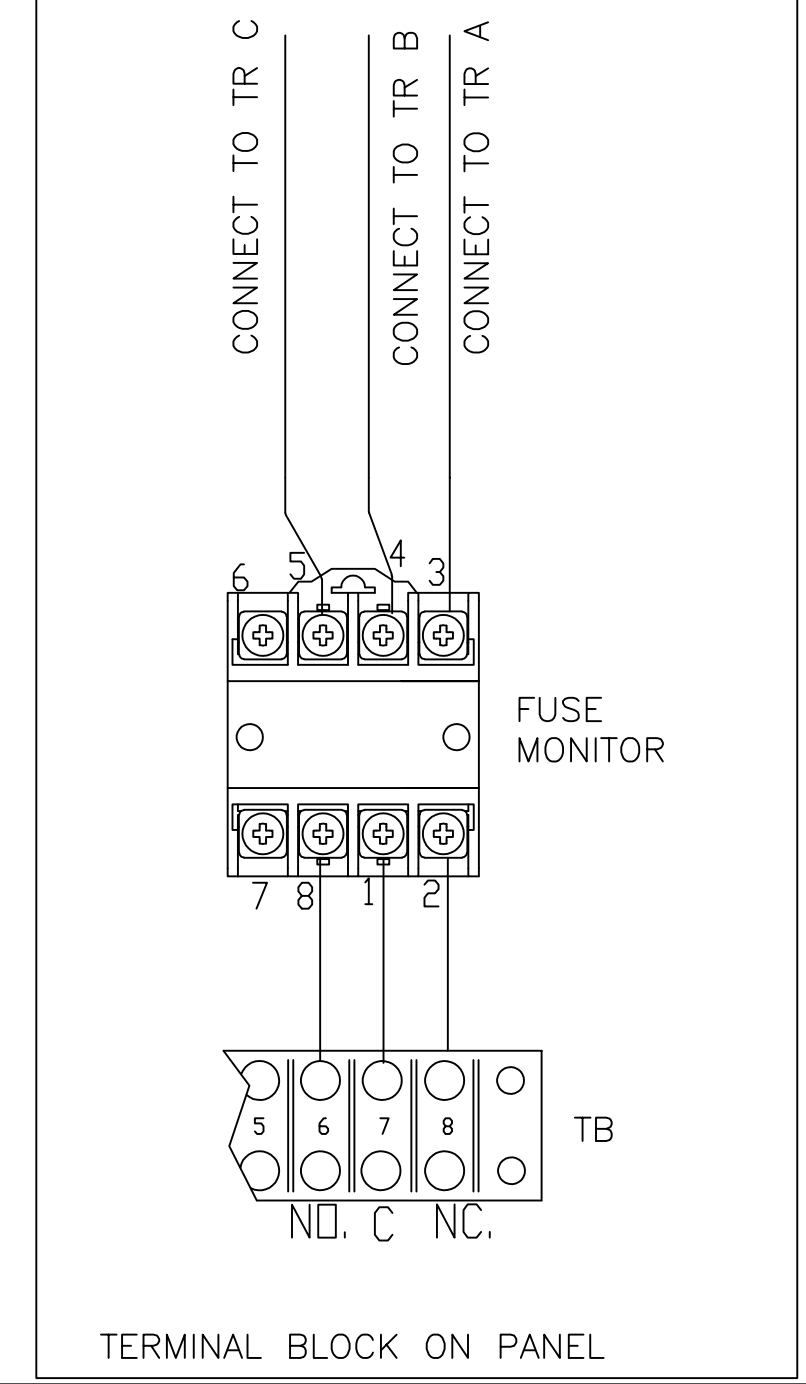

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.					TOLERANCES (EXCEPT AS NOTED)	W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022 HGL PASSIVE 480V SCHEMATIC STANDARD VERSION DRN. BY DSW DATE 3/31/17 DWG. NO. 30586-1S SCALE NONE SIZE C SHT. 1 OF 1
					DECIMAL	
					.XX ± NA	
					.XXX ± NA	
					FRACTIONAL ± NA	
				ANGULAR ± NA		
NO	REVISION	DATE	BY			