

480V.
60 HZ.
LINE


FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

CUSTOMER CONNECTIONS

CUSTOMER CONNECTIONS



75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

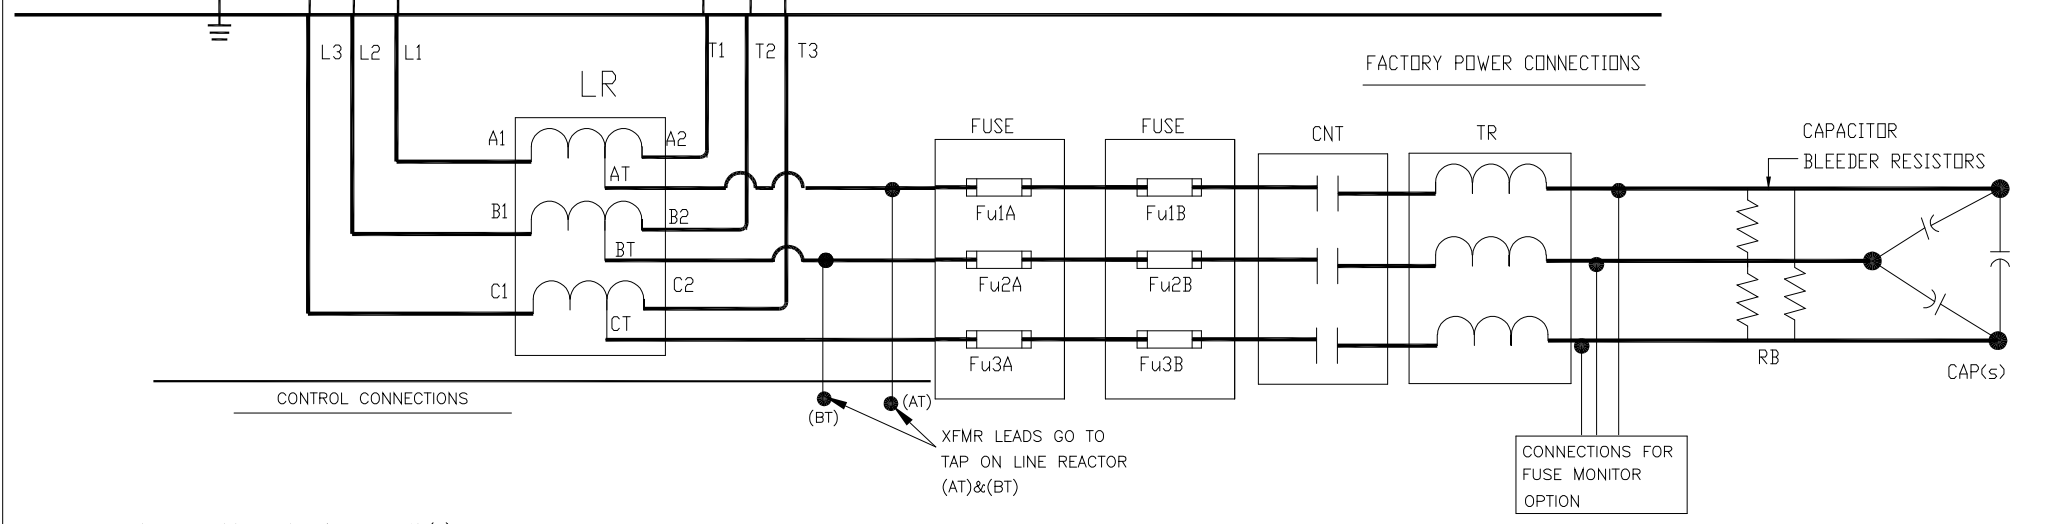


CONTROL CONNECTIONS WITHOUT FAN(S)

CONTROL CONNECTIONS WITH FAN(S)

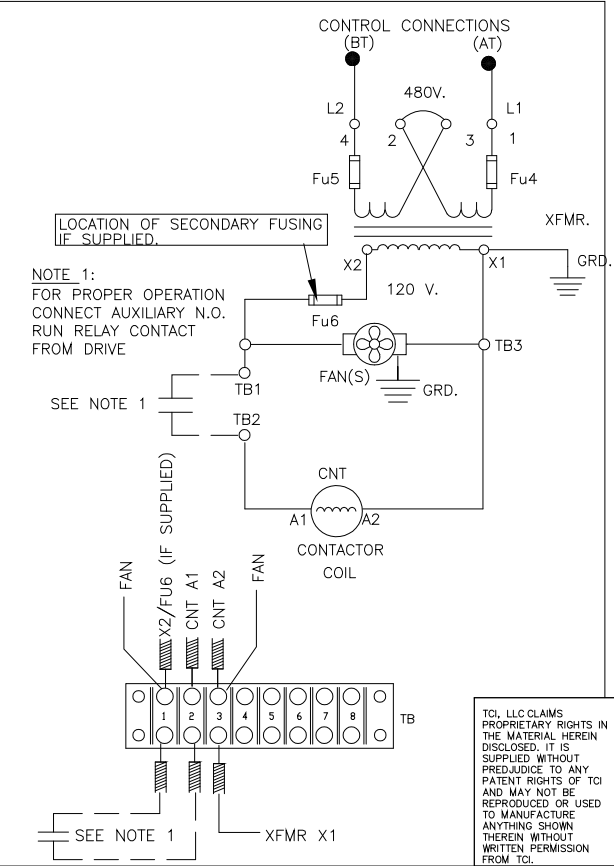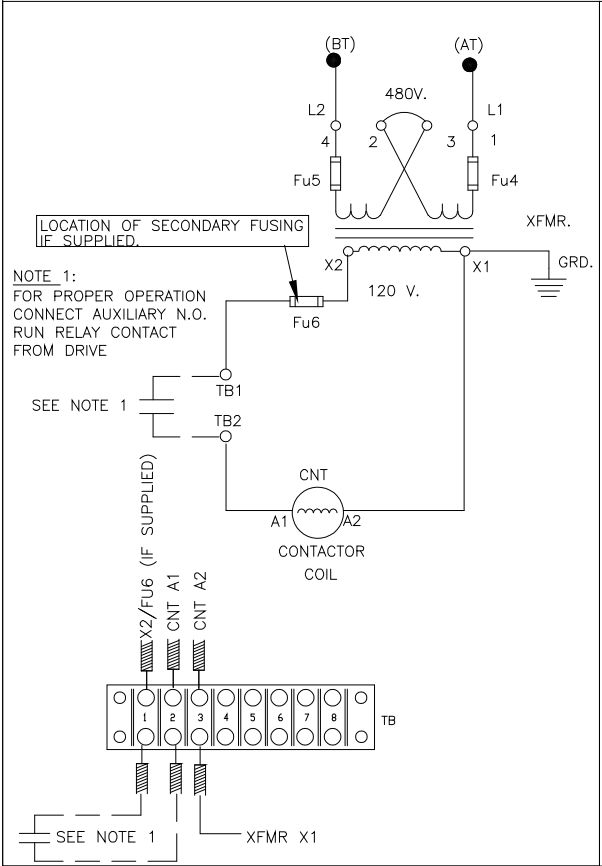

SCHEMATIC FOR FUSE MONITOR, OPTION

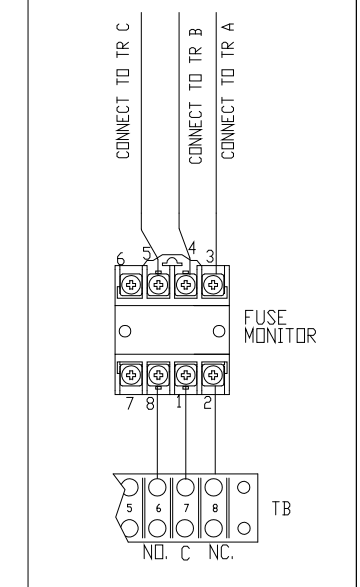

TERMINAL BLOCK ON PANEL

TOL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREDJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ± NA .XXX ± NA FRACTIONAL ± NA ANGULAR ± NA		W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022 HGL PASSIVE 40HP, 50HP, 480V SCHEMATIC CONTACTOR VERSION DRN BY DSW DATE 3/31/17 SCALE NONE SIZE C DWG NO. 30586-C SHT.1 OF1	
NO	REVISION	DATE	BY				