
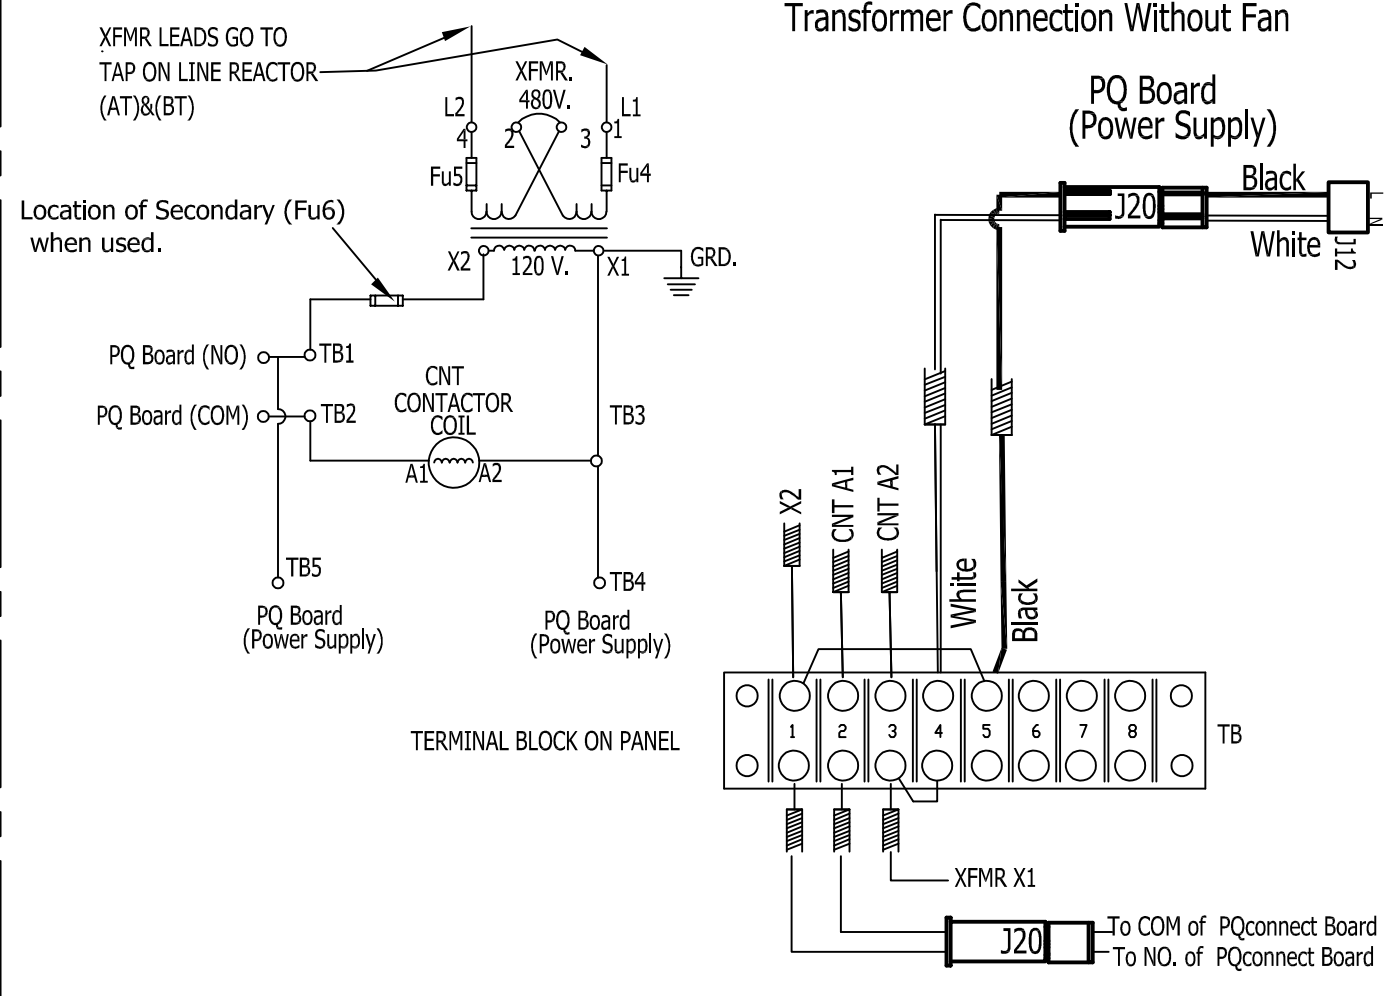
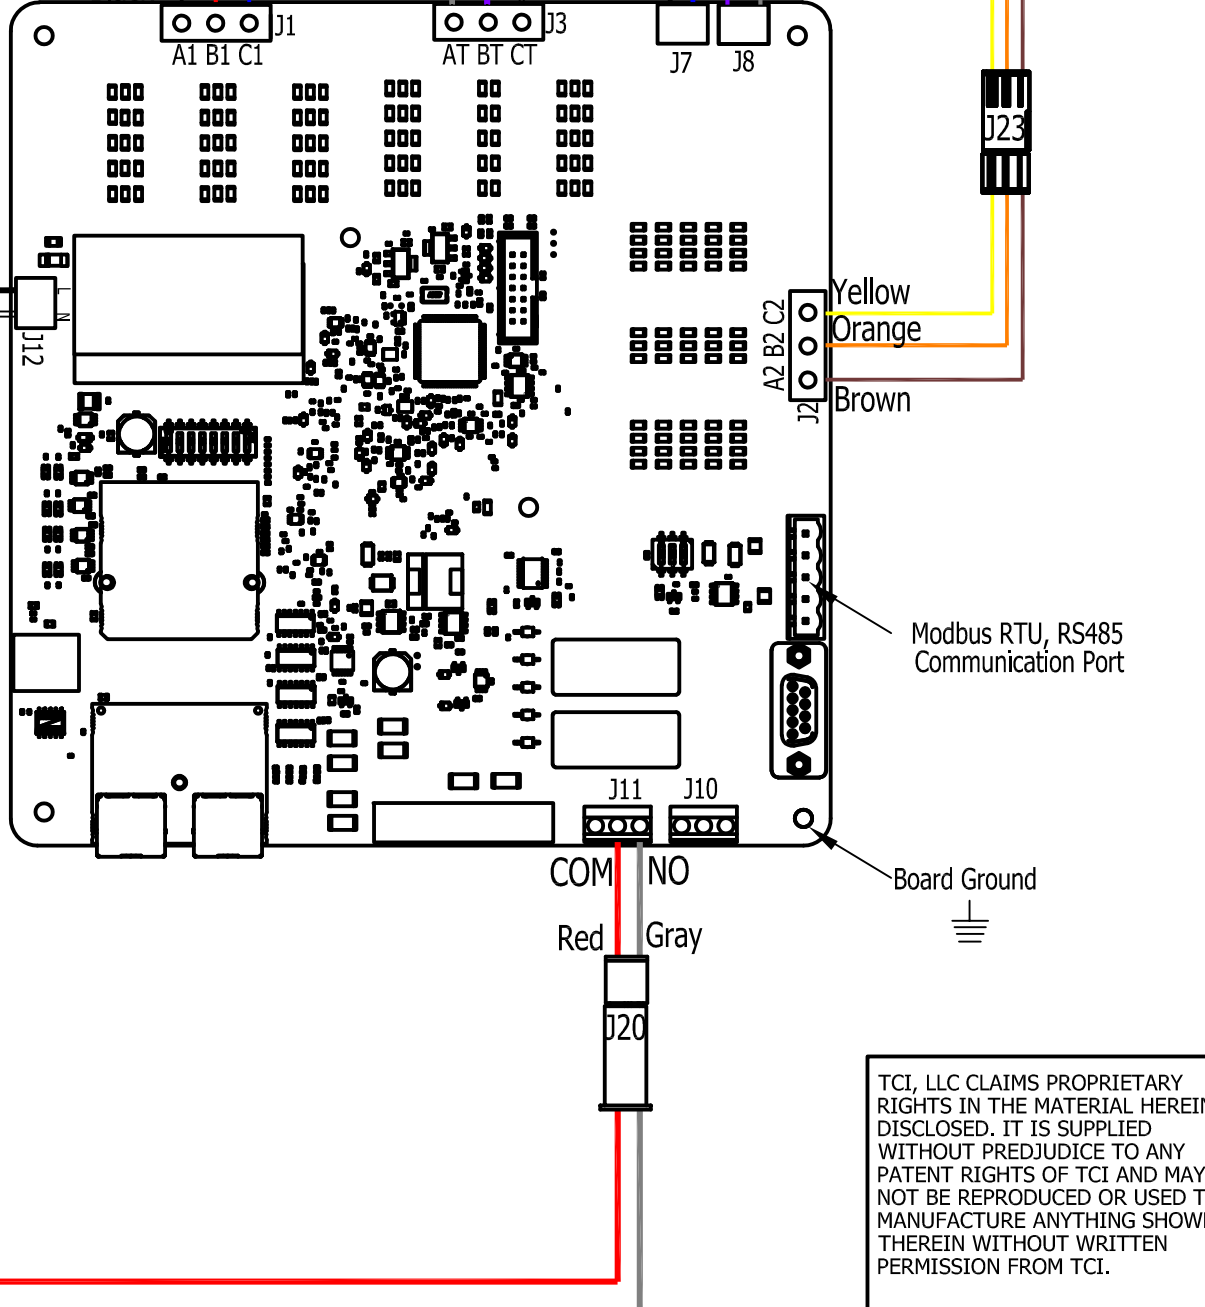
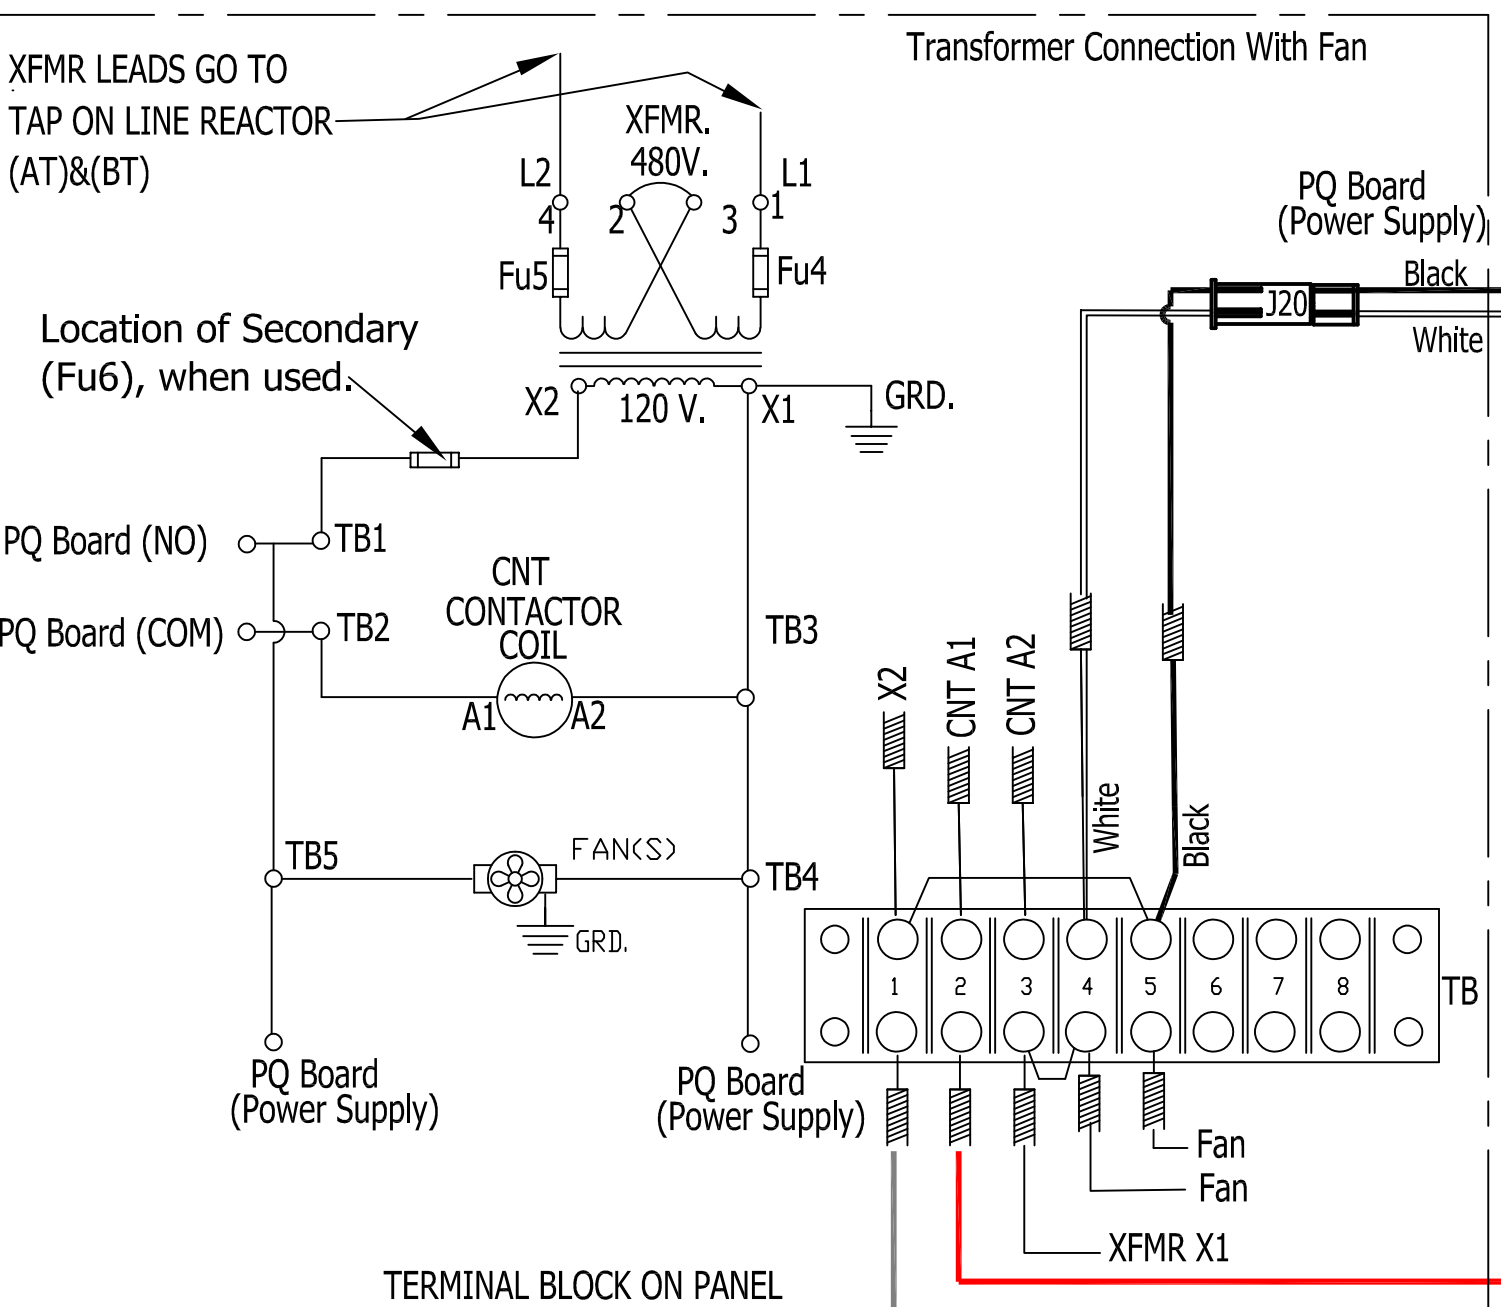


CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

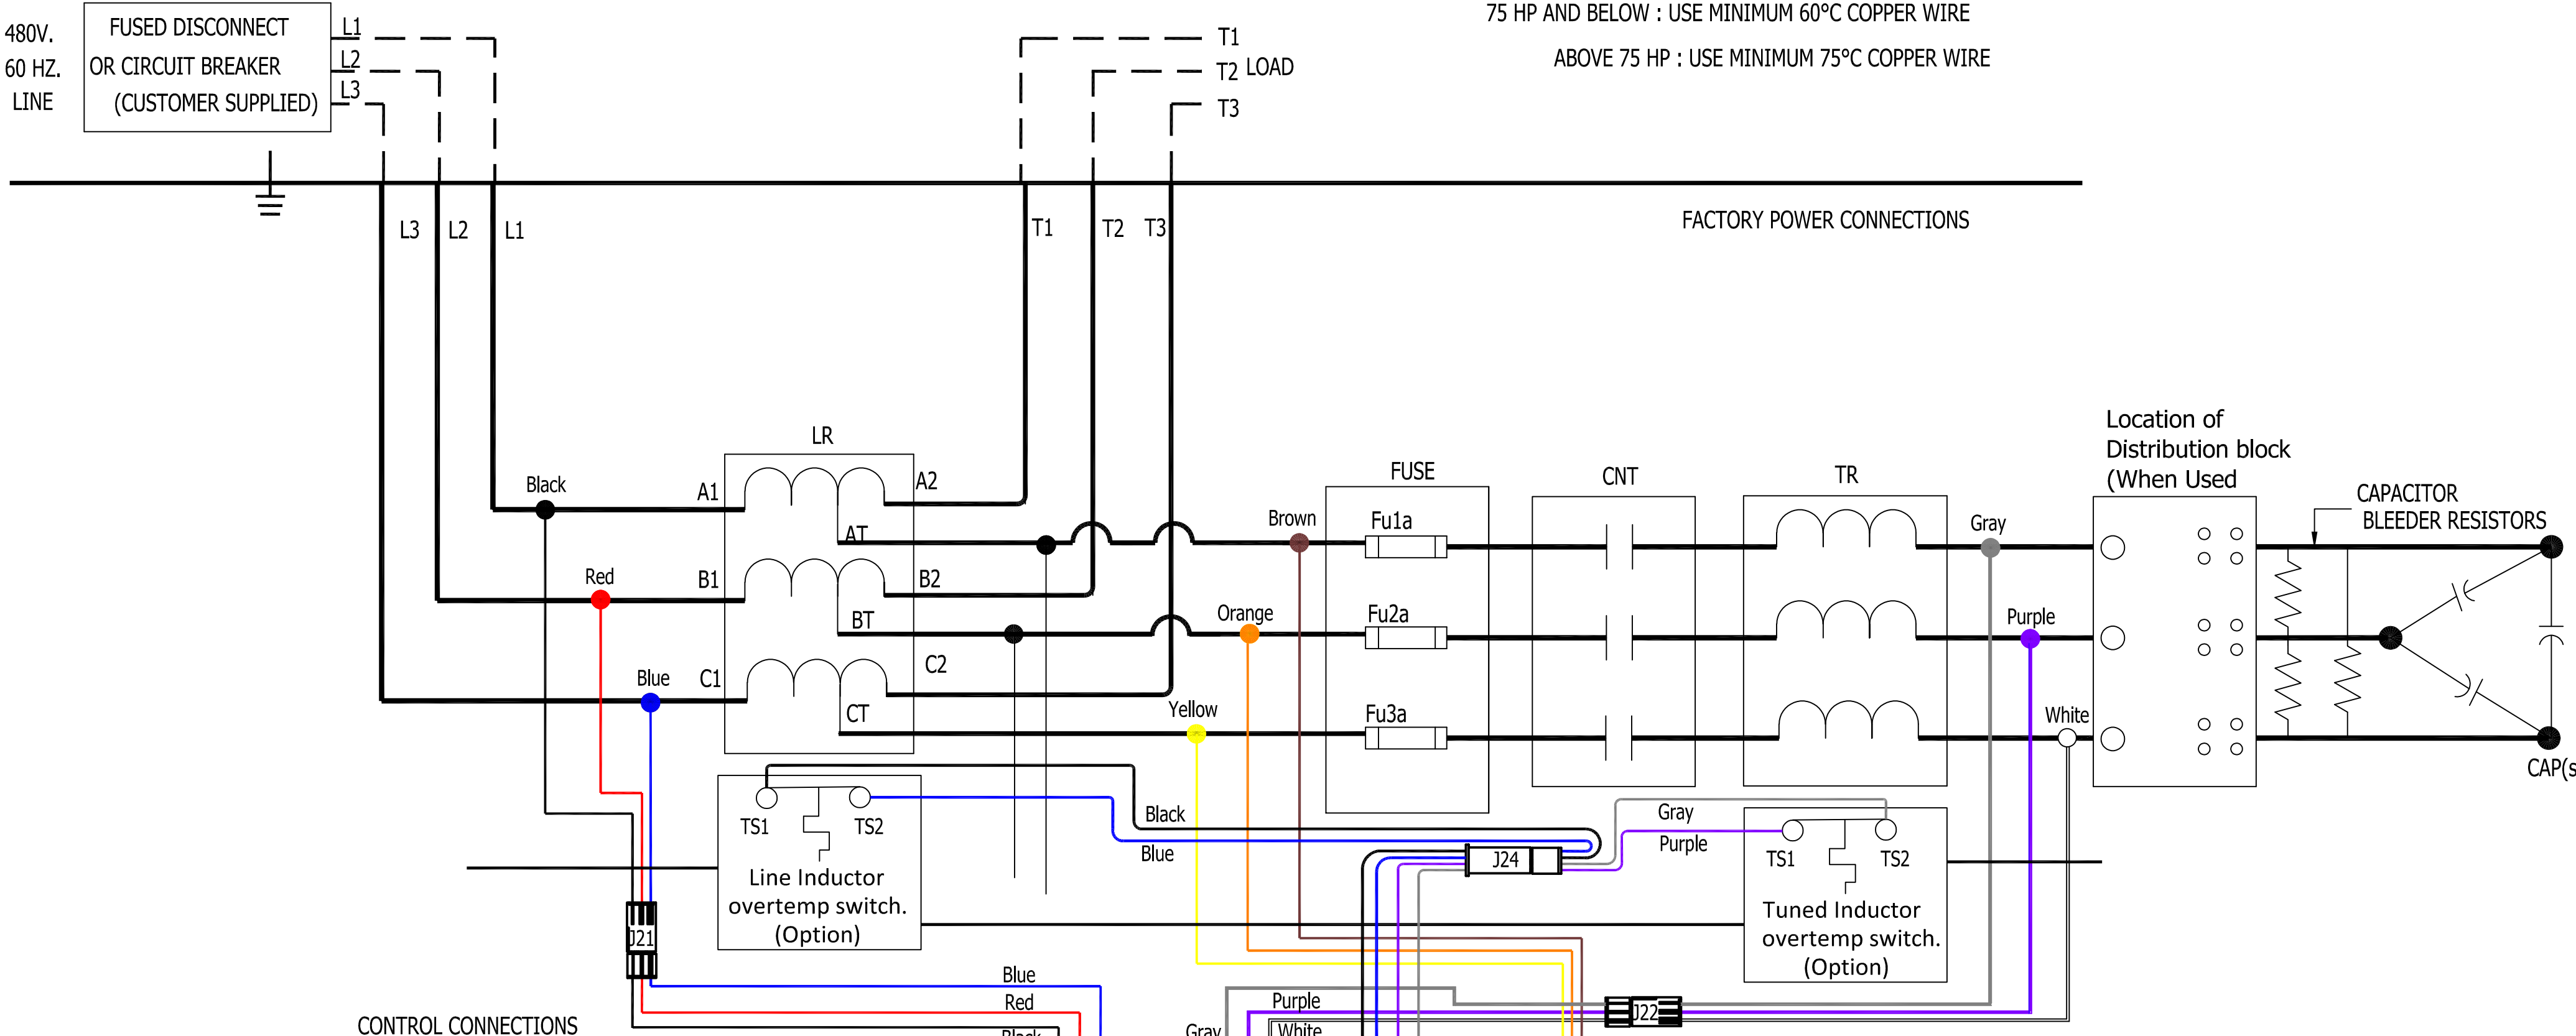

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± NA .XXX ± NA		W132 N10611 Grant Drive Germantown, WI 53022	
B	Corrected Title Block Desc	01/17/20	JRN	FRACTIONAL NA	HarmonicGuard Low Capacitance 480V Contactor/PQconnect, Two Thermal Switches		
A	As Designed	05/01/19	JRN	ANGULAR NA	DRN BY JRN	DATE: 05/01/19	30586-PQ6
NO	REVISION	DATE	BY	SCALE: NA	APRVD:	C	SHT. 1 OF 1