

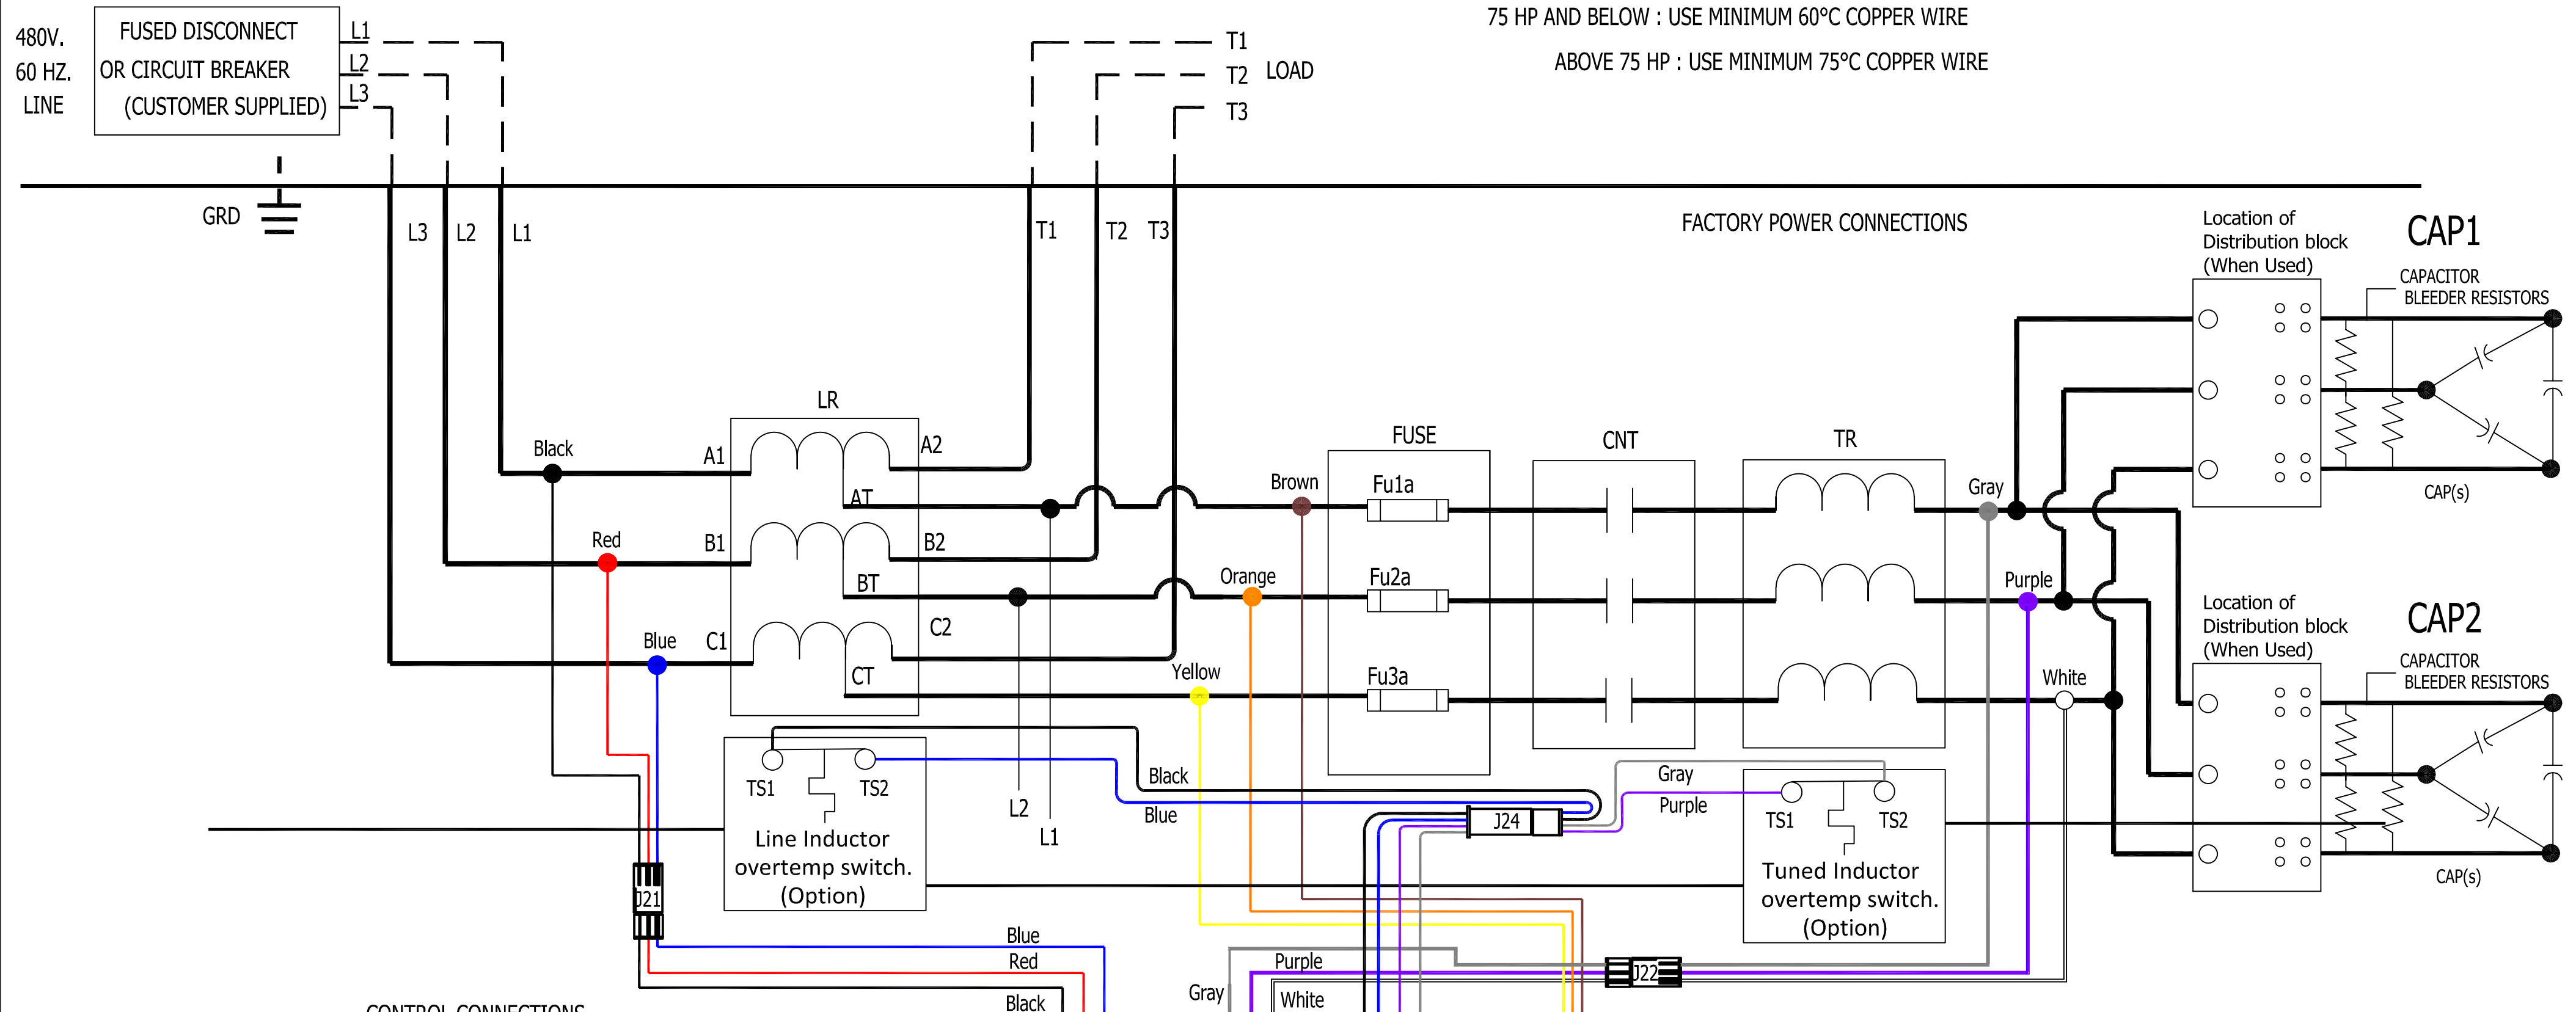
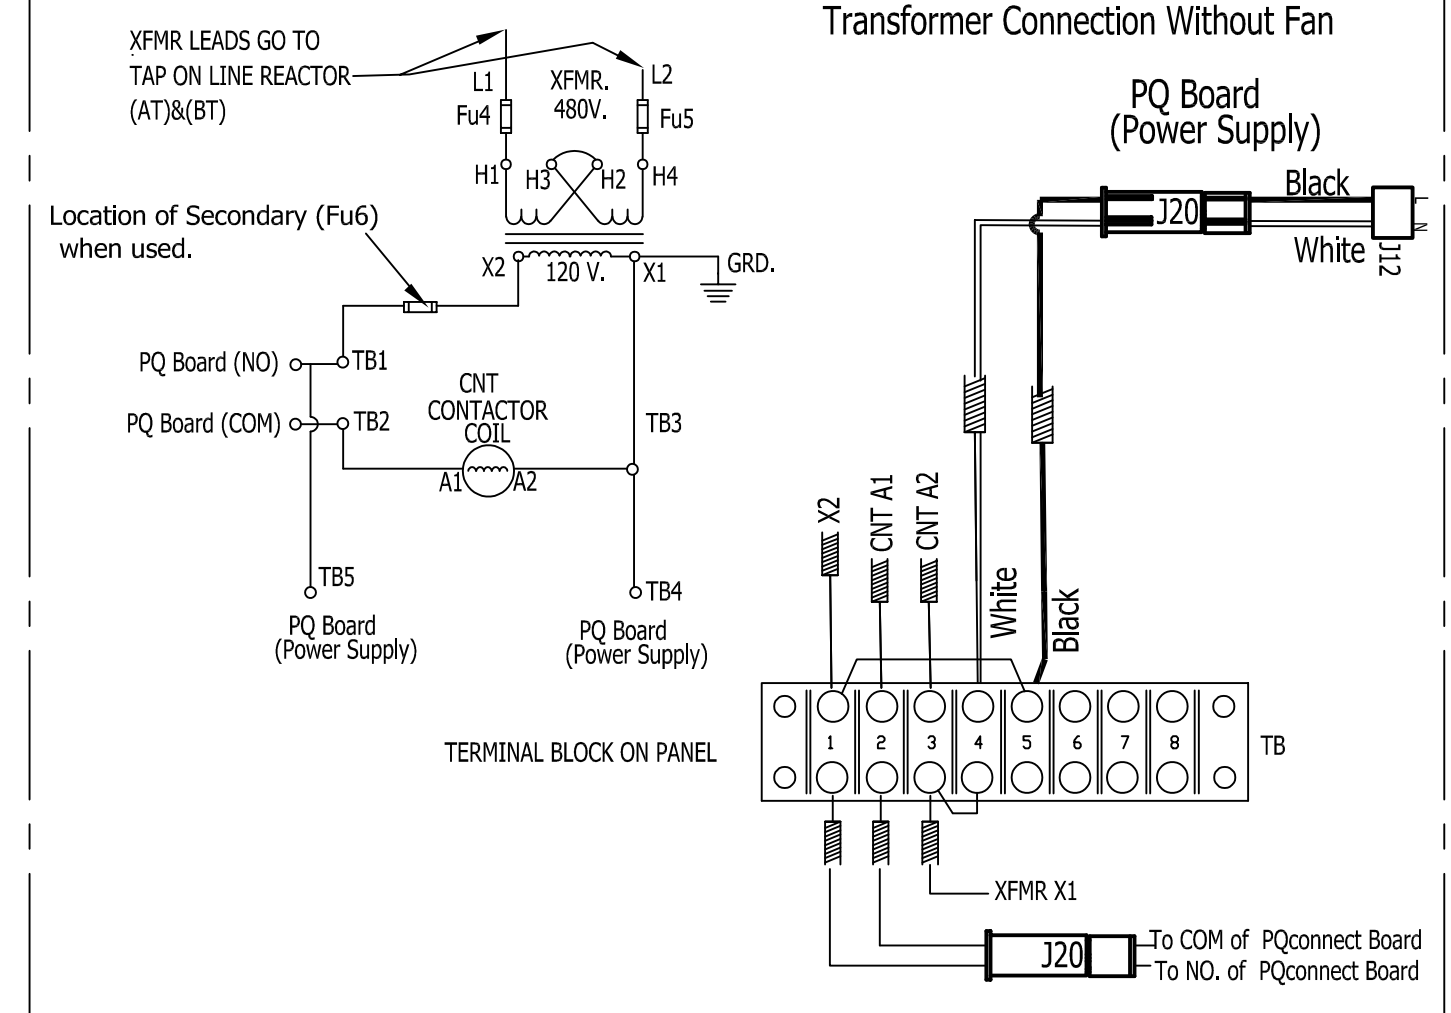


CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

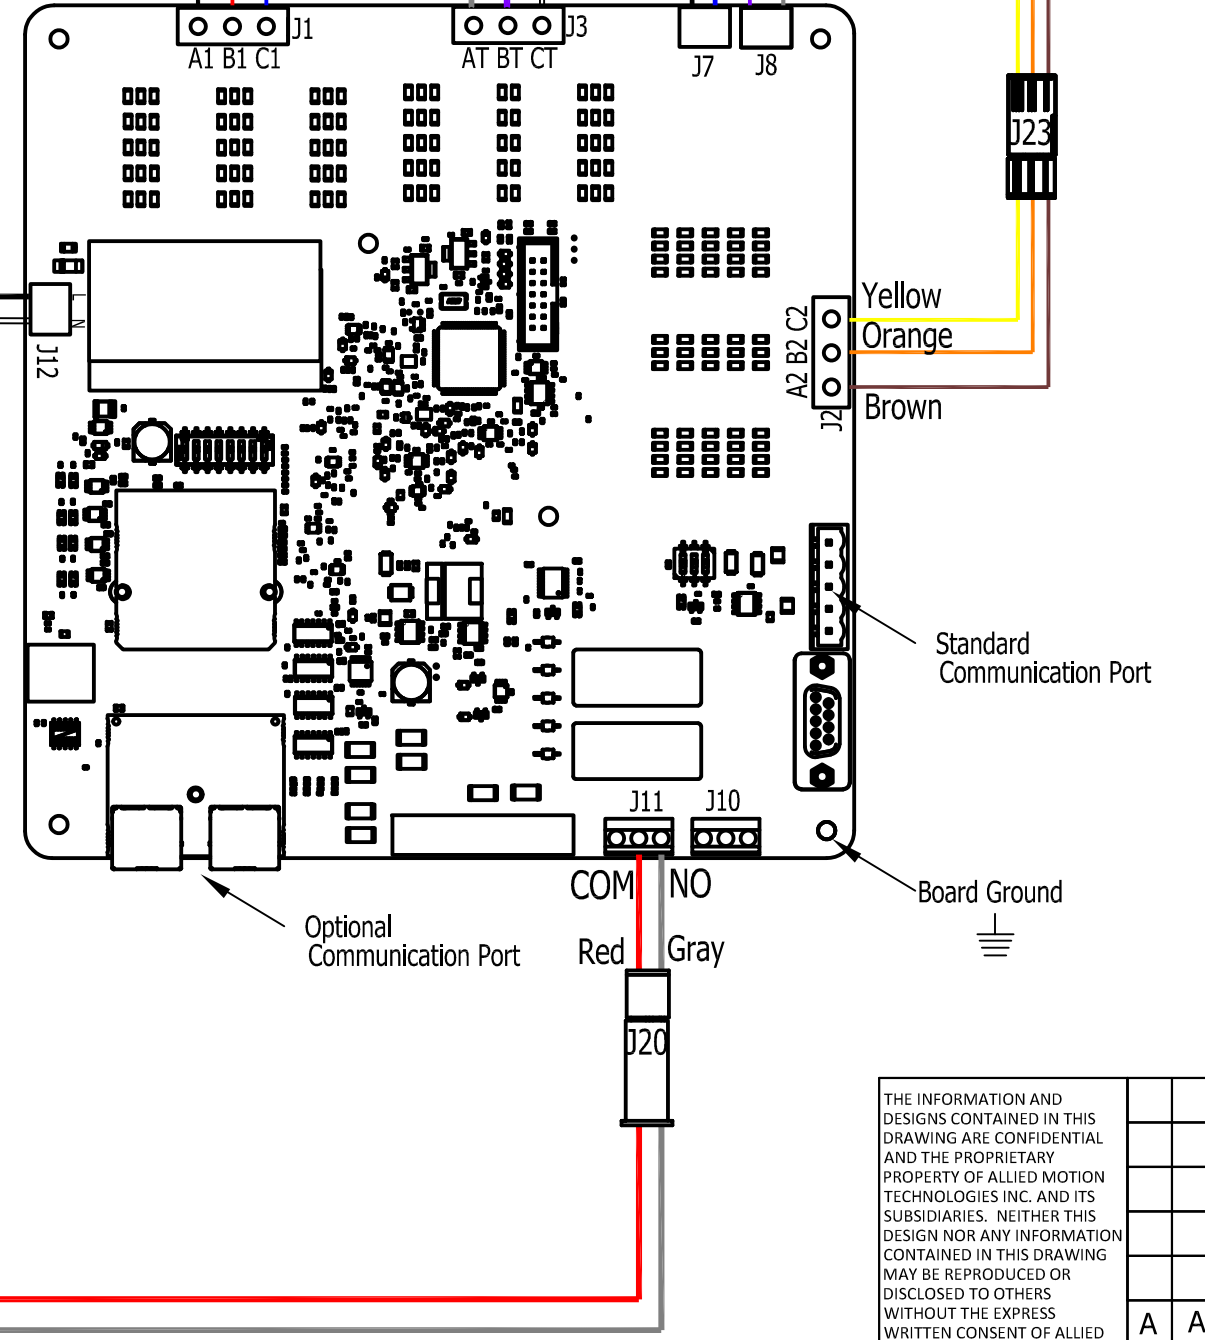

CONTROL CONNECTIONS

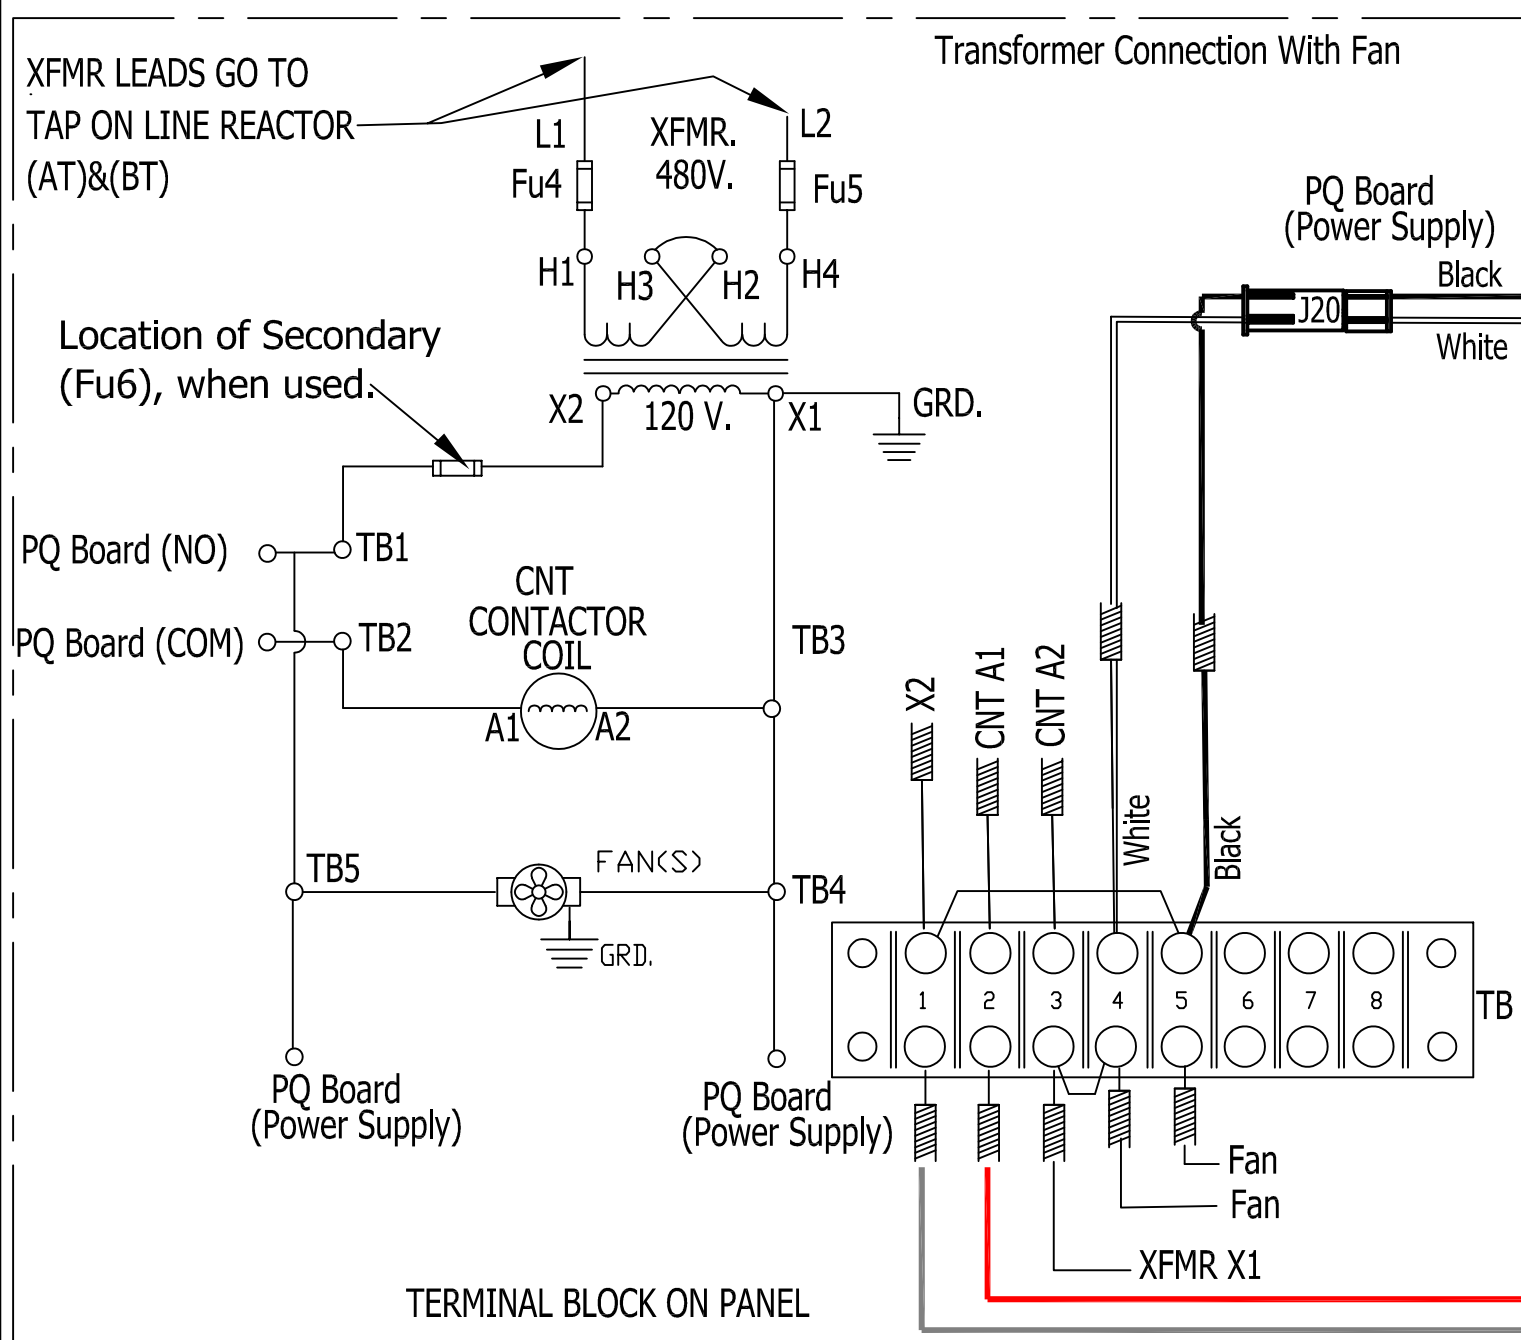

Material(s) Shall be RoHS Compliant

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

NO	REVISION	DATE	BY
A	As Designed	03/21/24	JRN

TOLERANCES (EXCEPT AS NOTED)	
DECIMAL	.XX ± NA
FRACTIONAL	.XXX ± NA
ANGULAR	± NA

TCI W132 N10611 Grant Drive
 Germantown, WI 53022
 © TCI, 2024
 An Allied Motion Company
 HarmonicGuard Low Capacitance
 480V Contactor/PQconnect, 2 Cap Banks
 DRN. BY JRN DATE 03/21/24 DWG. NO. 30586-PQ7
 SCALE NA SIZE C SHT. 1 OF 7