



CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE


ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

CONTROL CONNECTIONS WITHOUT FAN(S)



CONTROL CONNECTIONS WITH FAN(S)

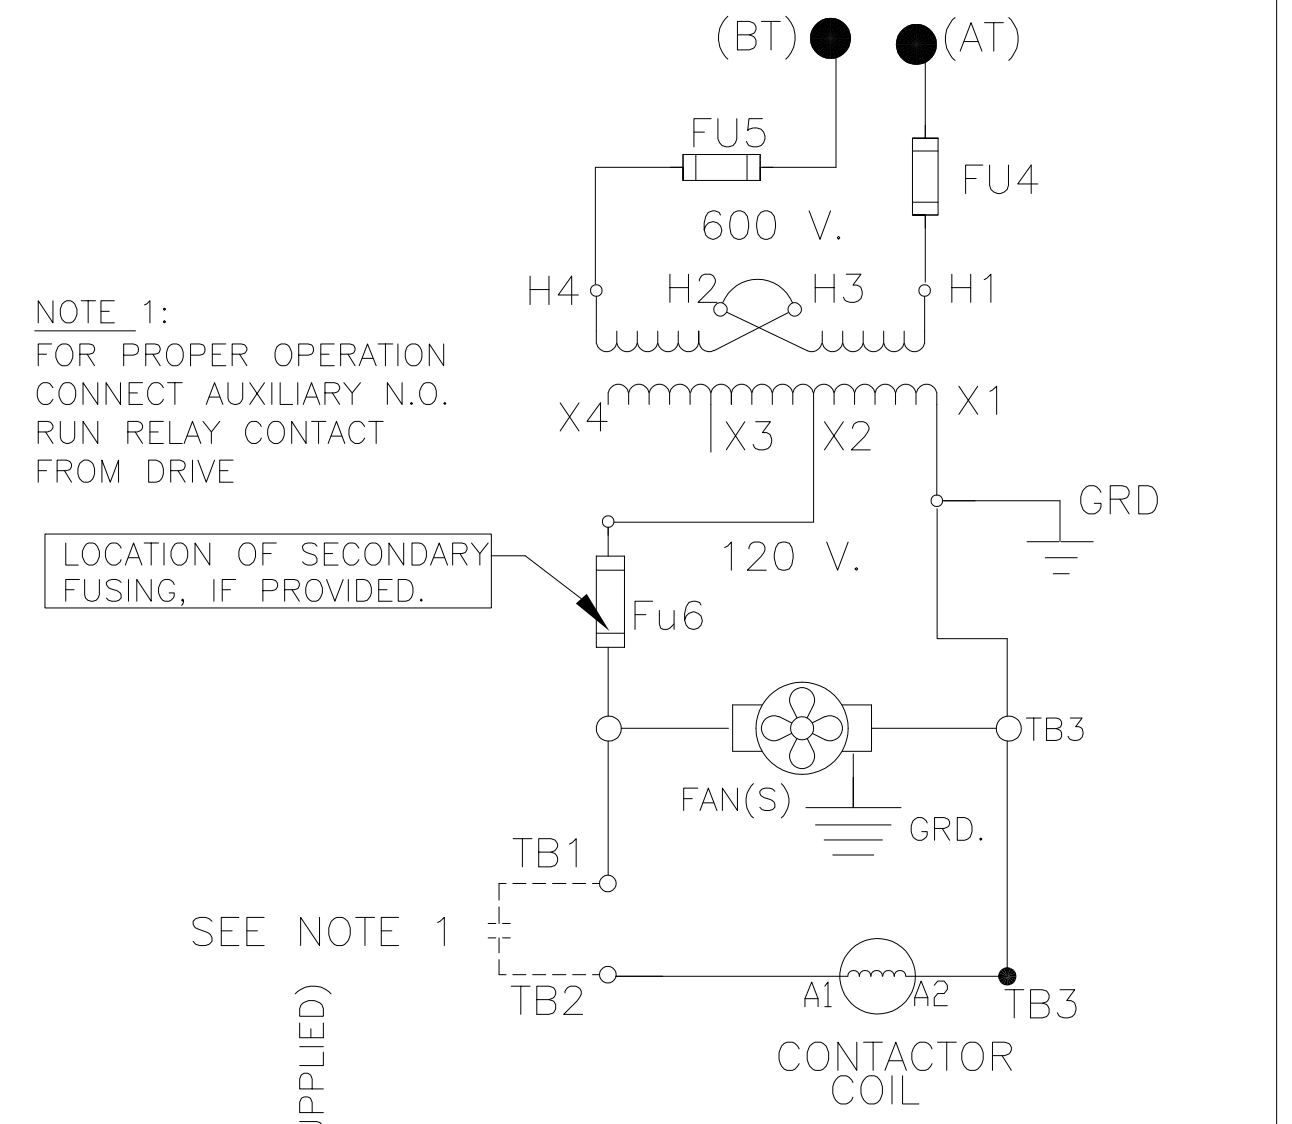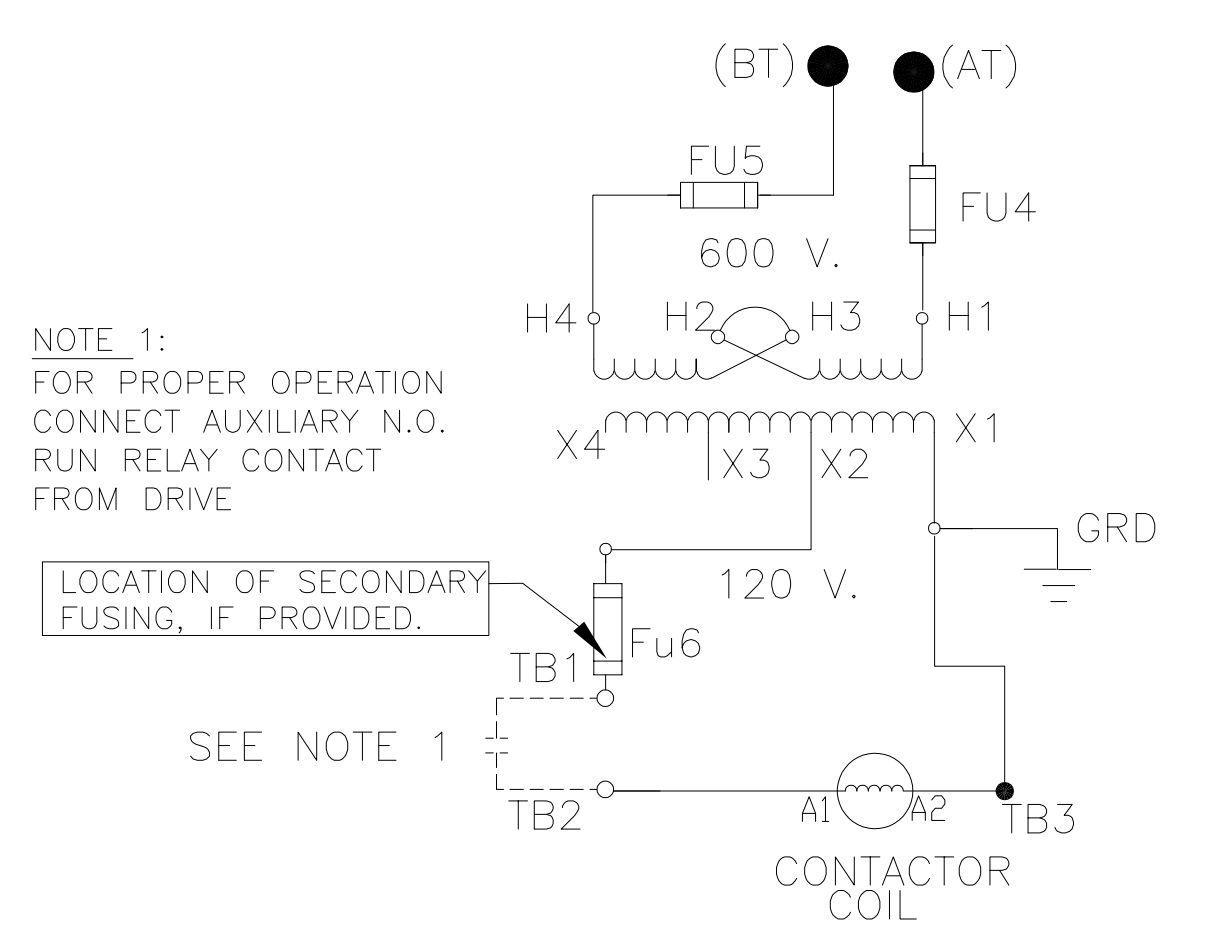

SCHEMATIC FOR FUSE MONITOR, OPTION

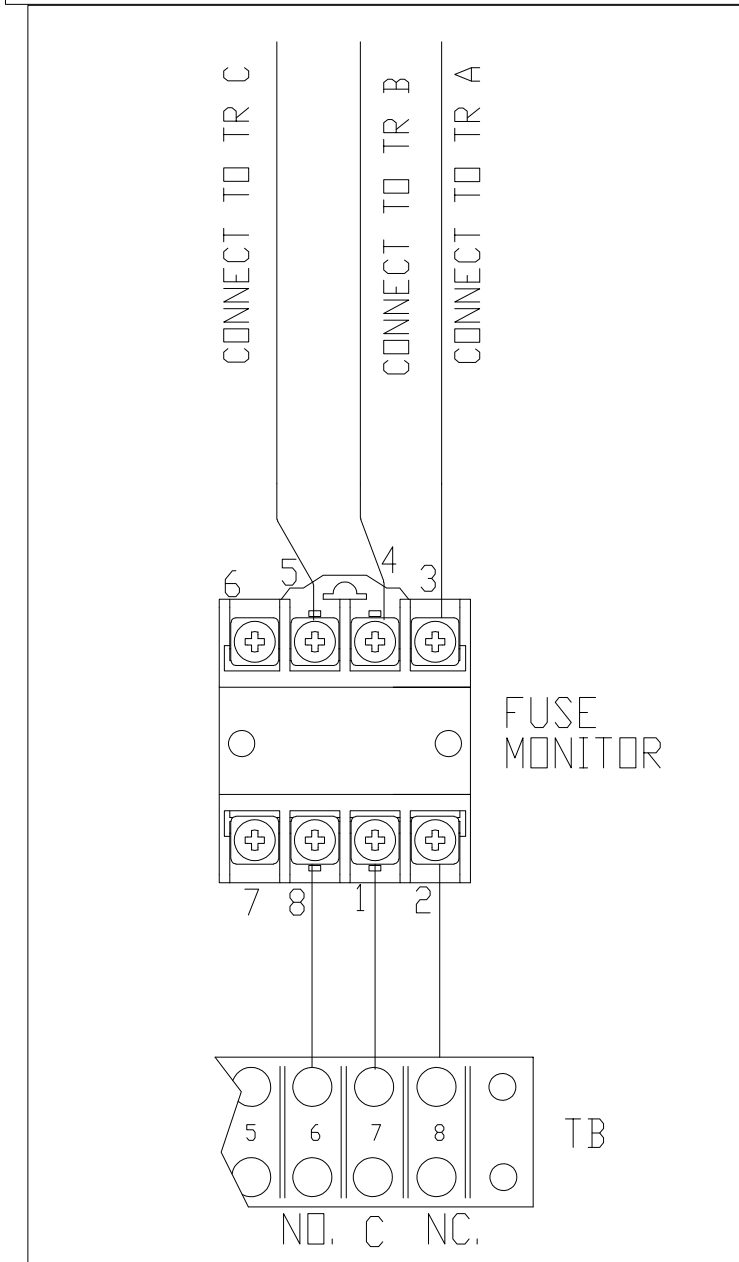

TERMINAL BLOCK ON PANEL

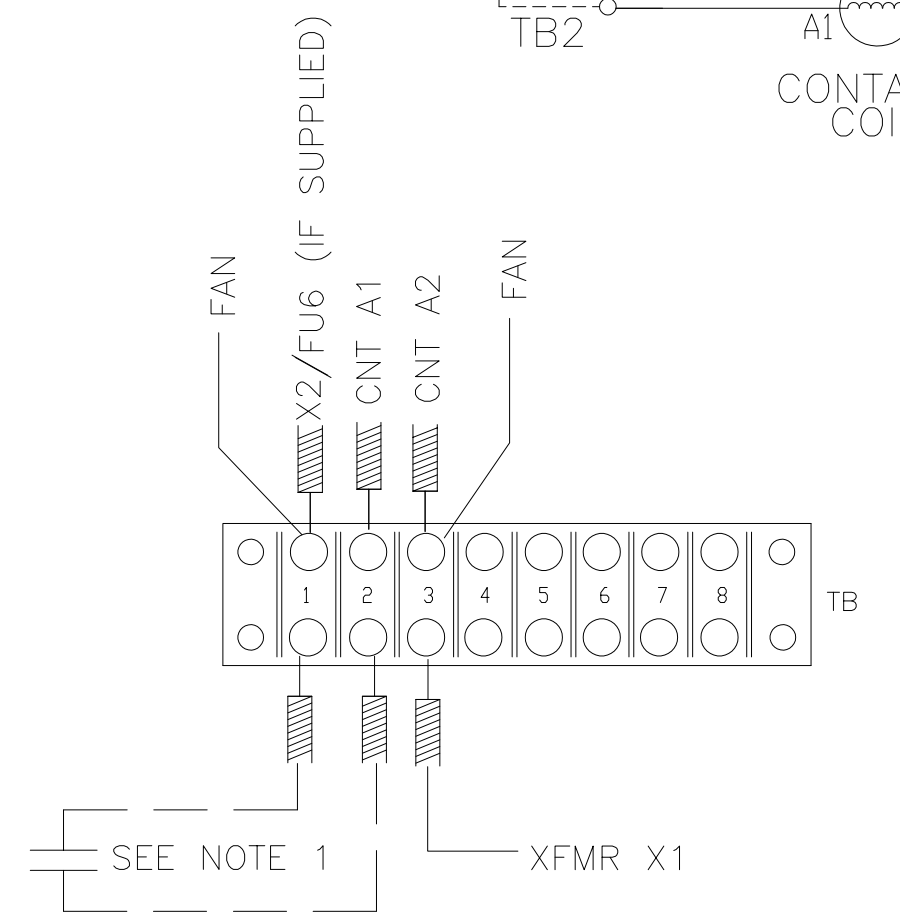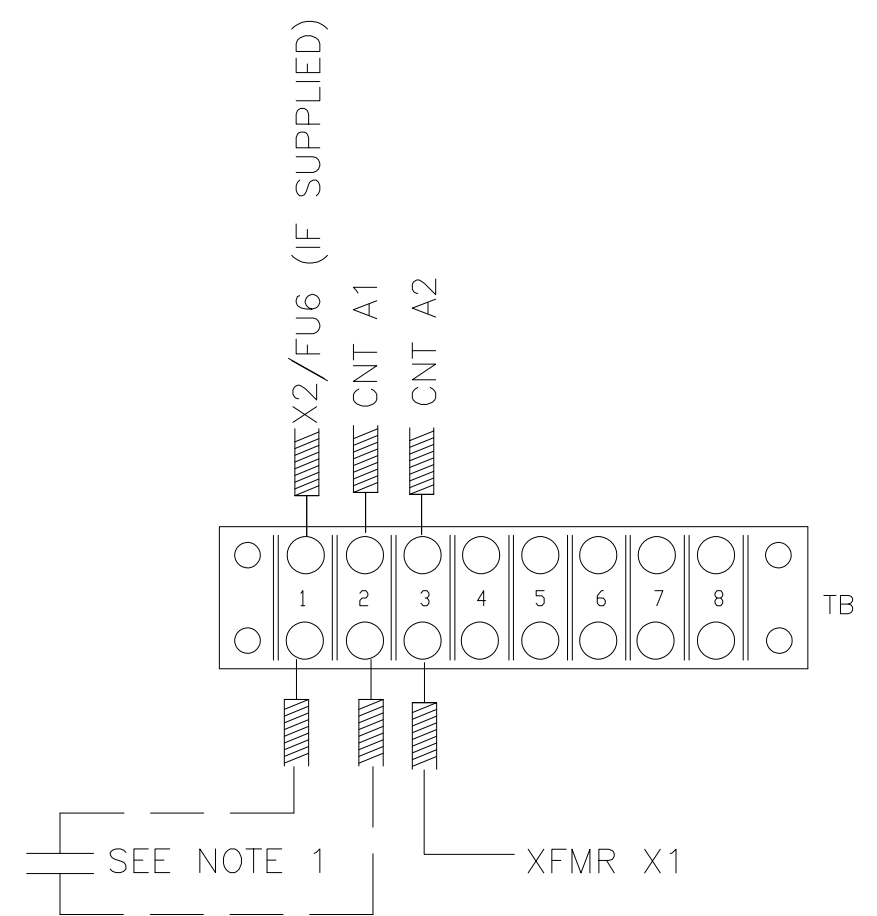

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED):  
DECIMAL  
.XX ± NA  
.XXX ± NA  
FRACTIONAL  
± NA  
ANGULAR  
± NA

**TCI** W132 N10611 GRANT DRIVE  
GERMANTOWN, WI 53022

HGL PASSIVE  
25HP, 600V SCHEMATIC  
CONTACTOR VERSION

DRN. BY DSW DATE 10/10/17 DWG. NO. 30807-2C  
SCALE NONE SIZE C SHT. 1 OF 1