
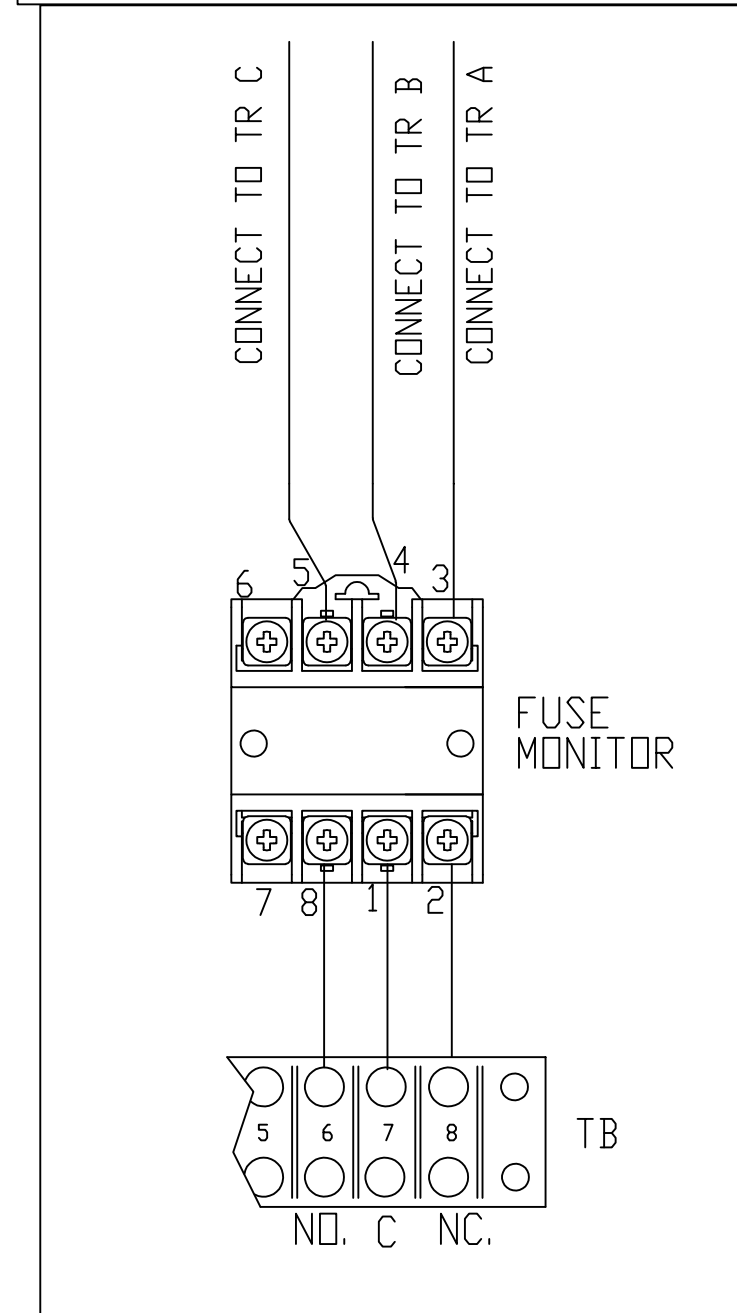
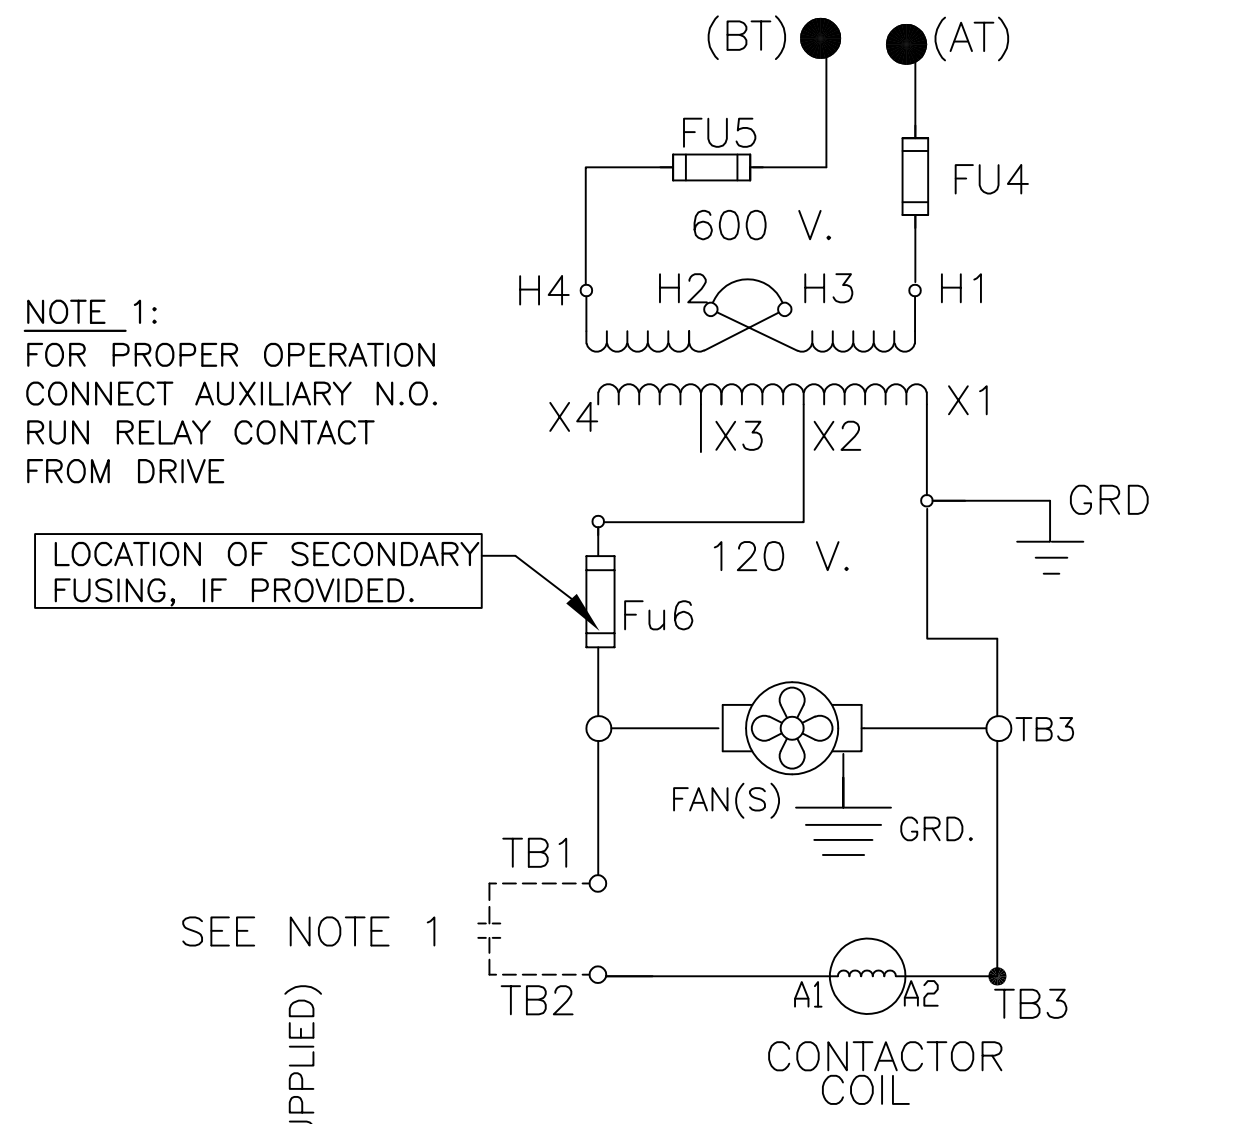




CONTROL CONNECTIONS WITHOUT FAN(S)

CONTROL CONNECTIONS WITH FAN(S)

SCHEMATIC FOR FUSE MONITOR, OPTION

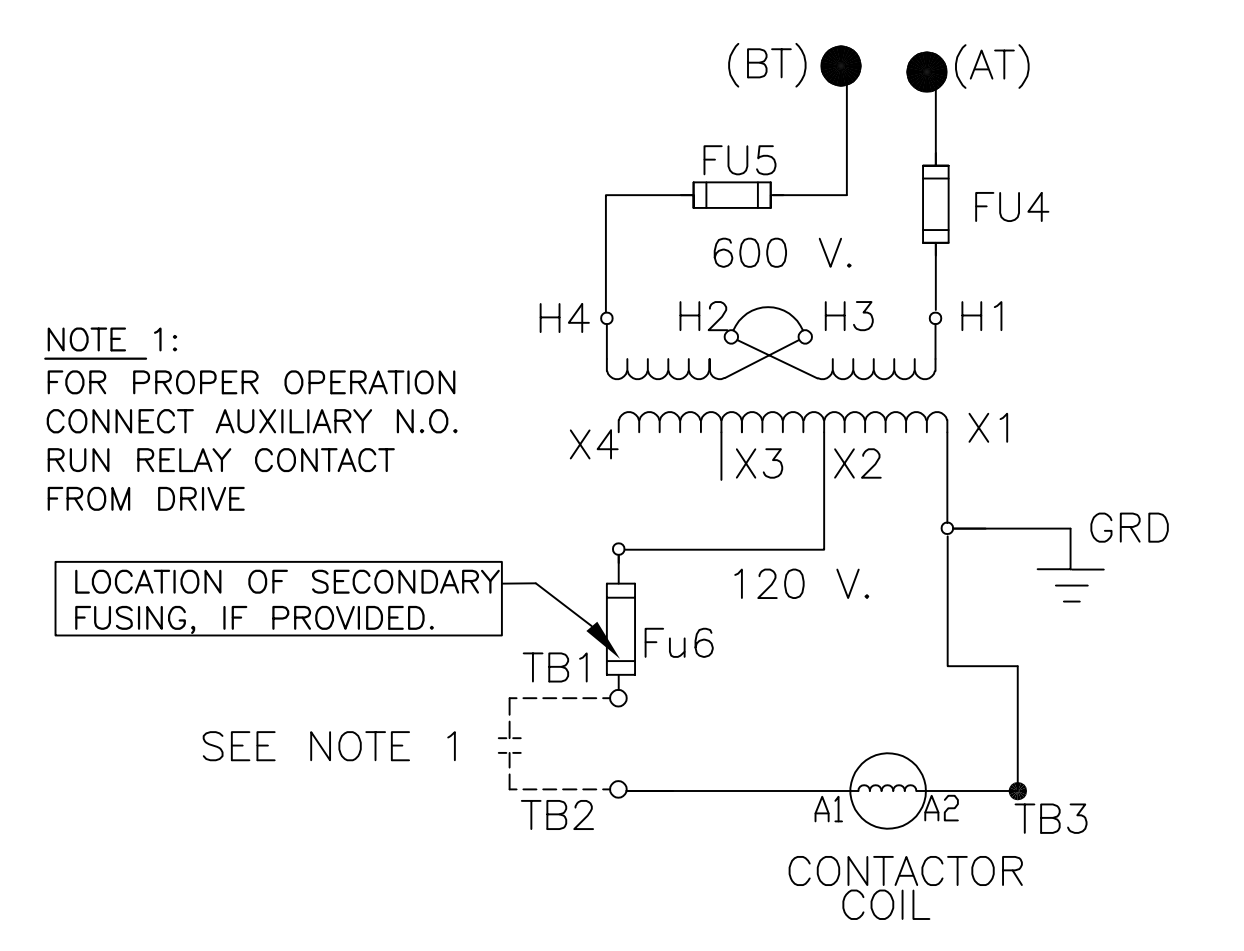

TERMINAL BLOCK ON PANEL

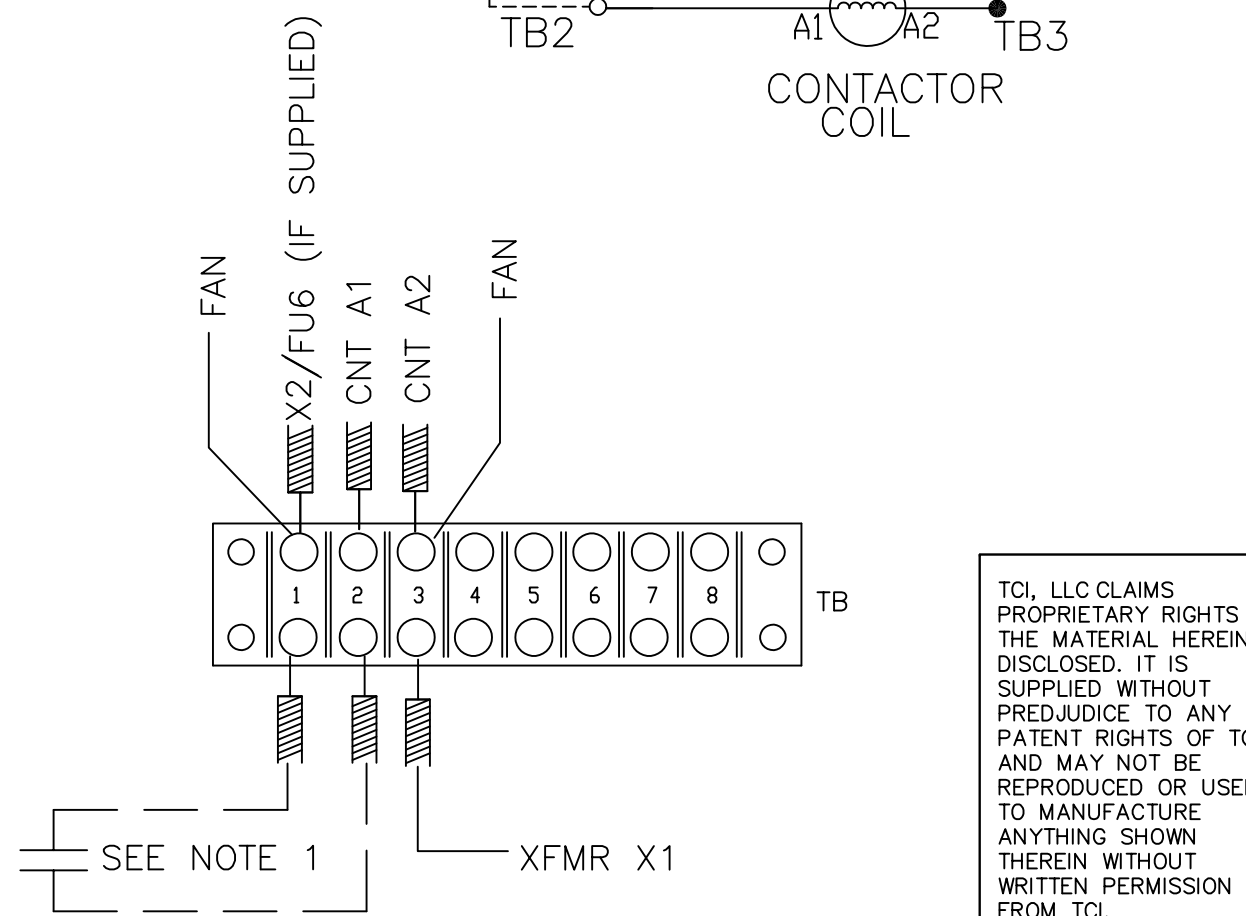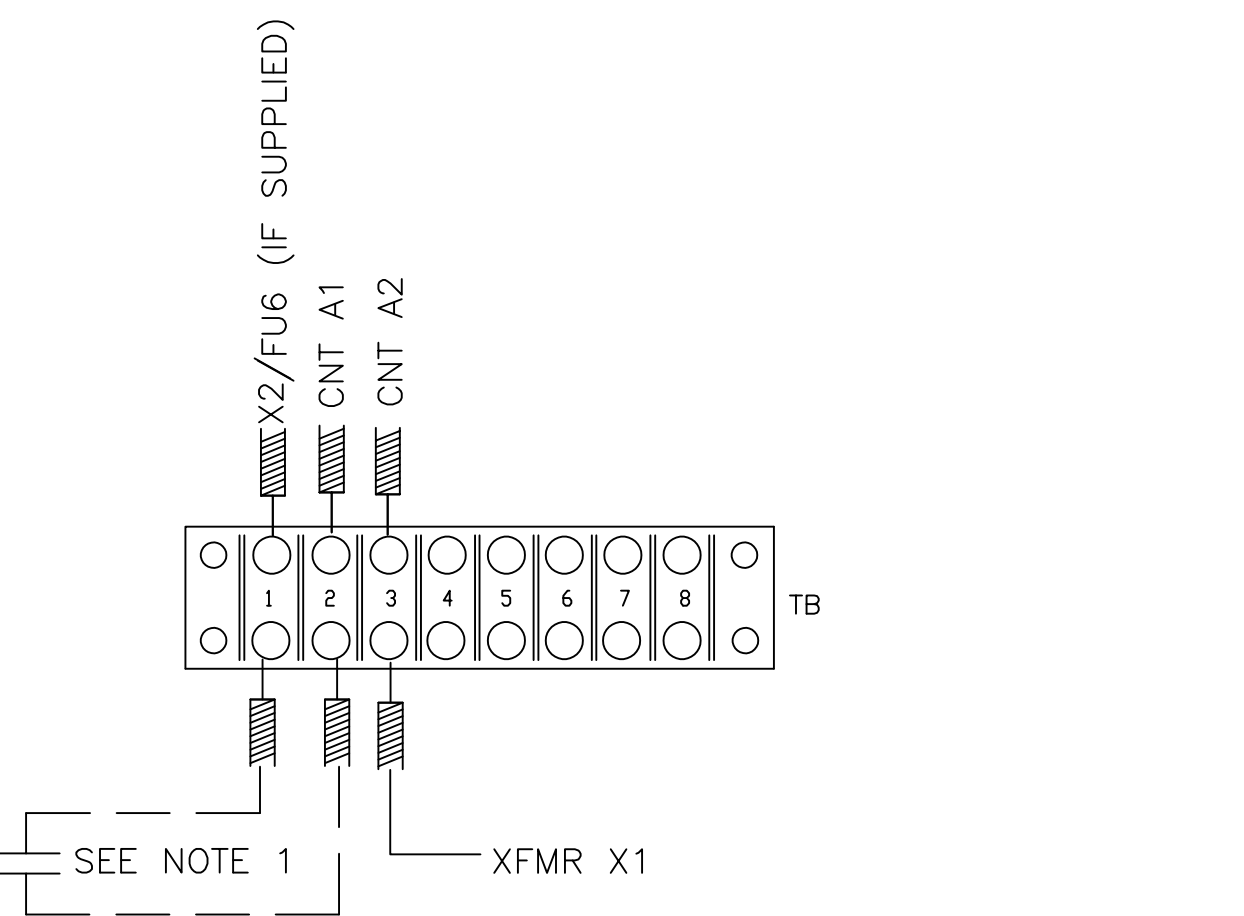

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

NO	REVISION	DATE	BY

TOLERANCES (EXCEPT AS NOTED)

DECIMAL .XX ± NA .XXX ± NA

FRACTIONAL ± NA

ANGULAR ± NA

**TCL** W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022

HGL PASSIVE 40HP, 600V SCHEMATIC CONTACTOR VERSION

DRN. BY DSW DATE 3/31/17 DWG. NO. 30807-40C

SCALE NONE SIZE C

SHT. 1 OF 1