

480V.
60 HZ.
LINE


FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

L1
L2
L3
CUSTOMER CONNECTIONS
T1
T2
T3
LOAD

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE


FACTORY POWER CONNECTIONS

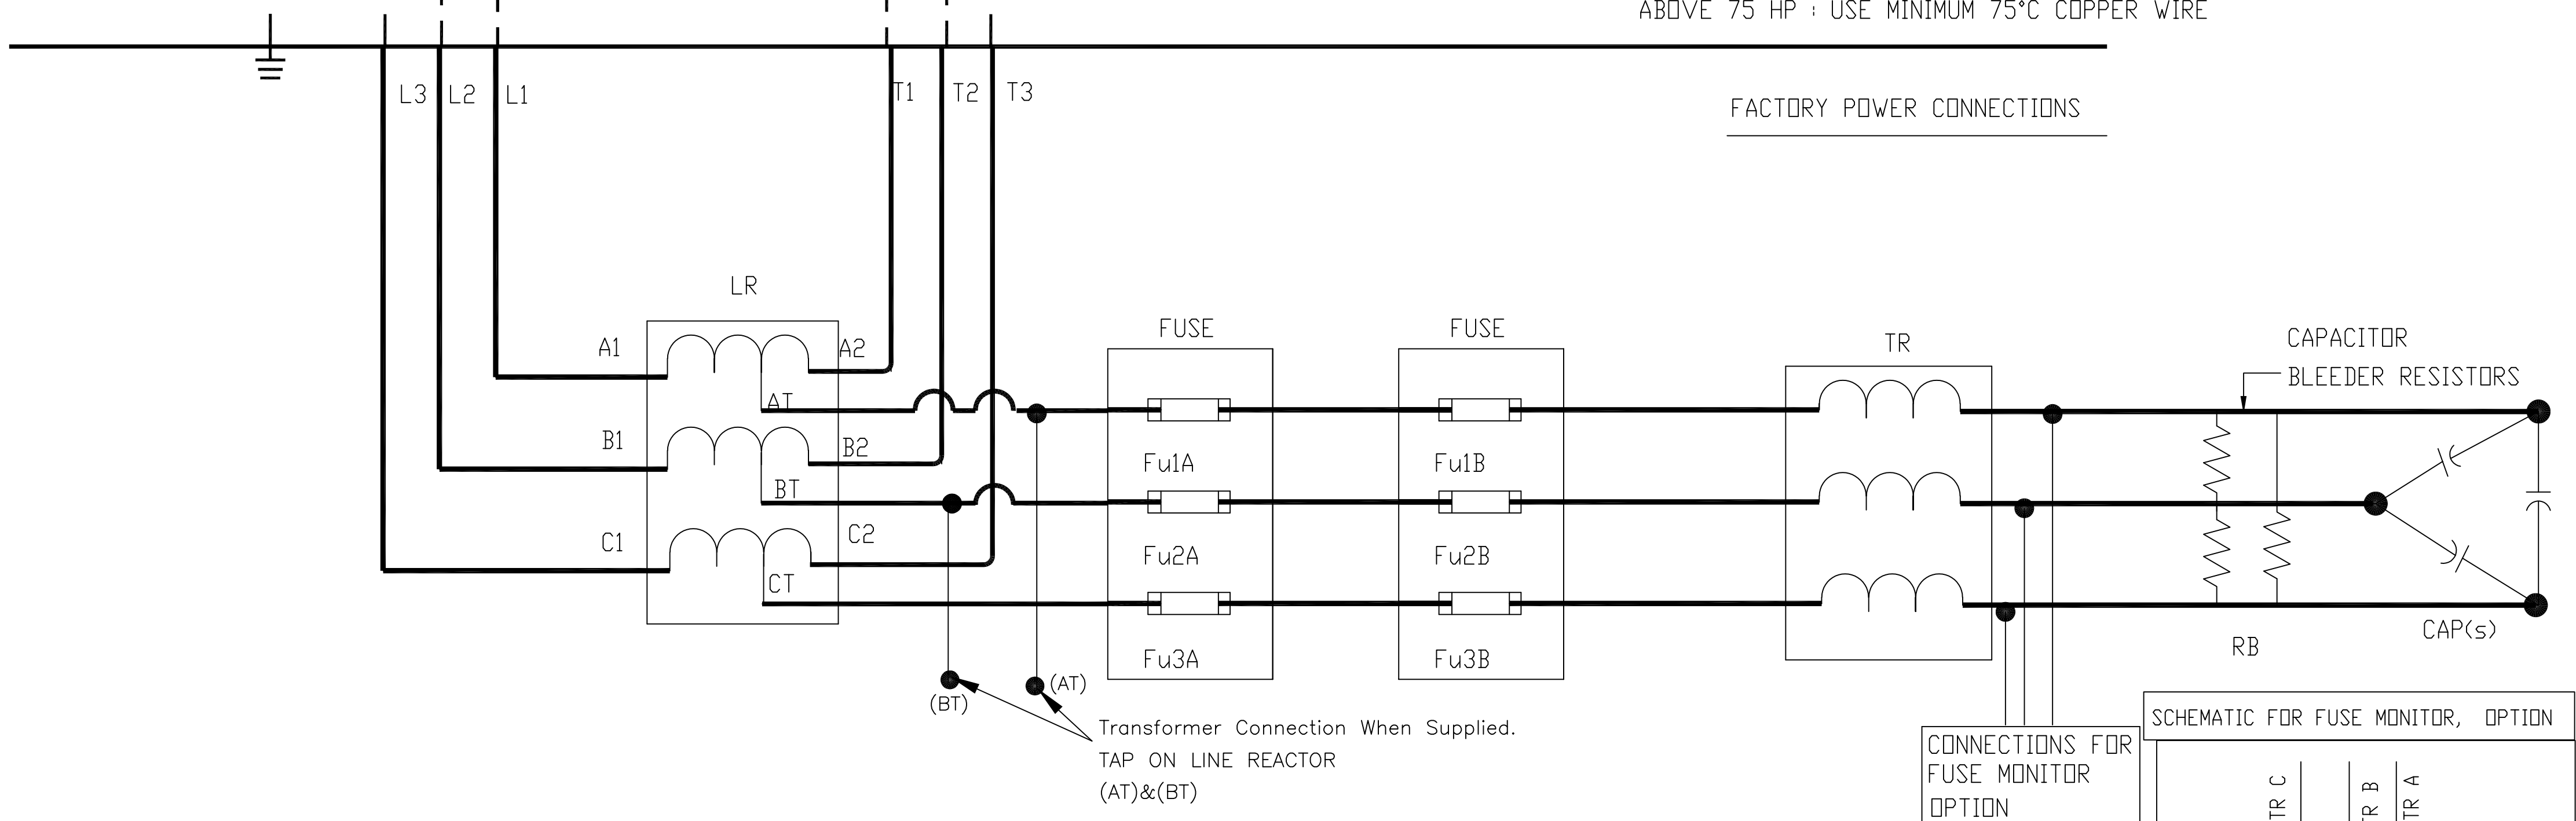


(BT) (AT)
Transformer Connection When Supplied.
TAP ON LINE REACTOR
(AT)&(BT)

CONNECTIONS FOR
FUZE MONITOR
OPTION

SCHEMATIC FOR FUZE MONITOR, OPTION

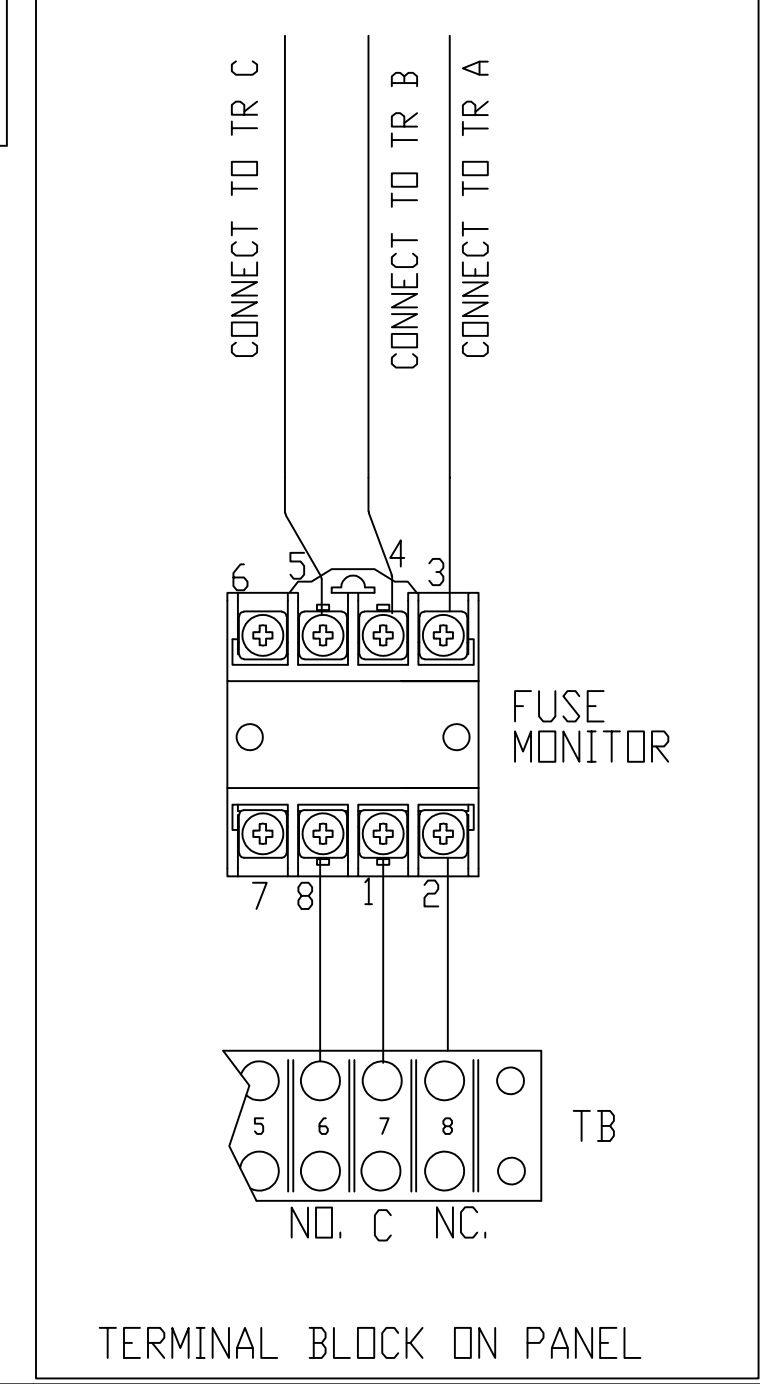

CONTROL CONNECTIONS WITH IF FAN(S) SUPPLIED

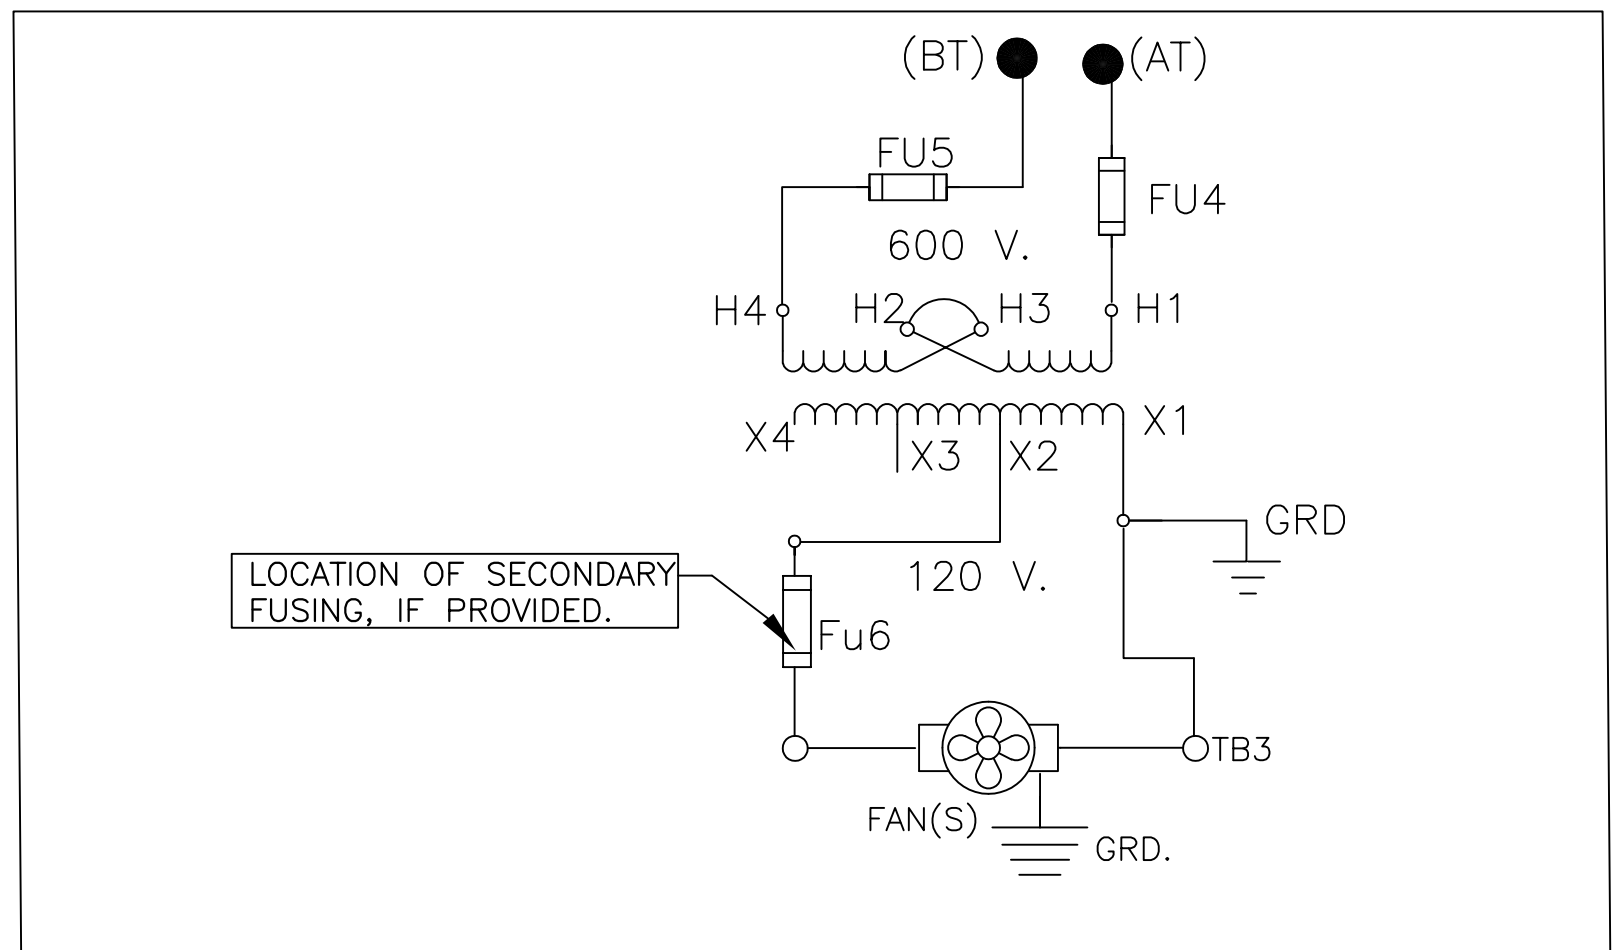

LOCATION OF SECONDARY
FUSING, IF PROVIDED.

TOLERANCES
(EXCEPT AS NOTED)
DECIMAL
.XX ± NA
.XXX ± NA
FRACTIONAL
± NA
ANGULAR
± NA

NO	REVISION	DATE	BY

TCL W132 N10611 GRANT DRIVE
GERMANTOWN, WI 53022

HGL PASSIVE
40HP, 600V SCHEMATIC
Standard VERSION

DRN. BY DSW DATE 10/11/17 DWG. NO. 30807-40S
SCALE NONE SIZE C SHT. 1 OF 1