
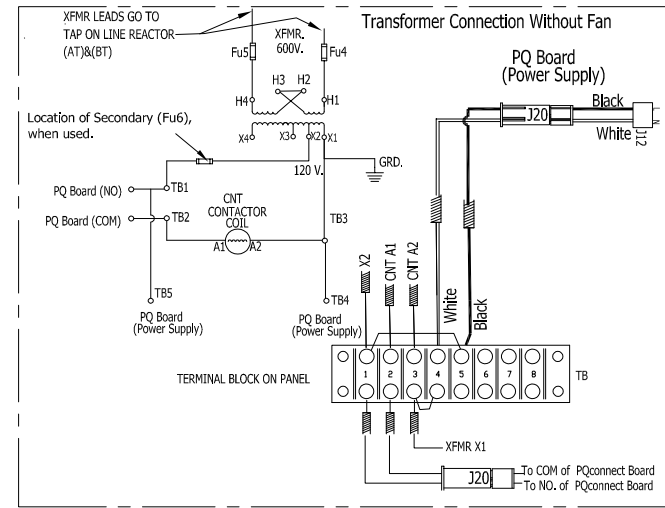
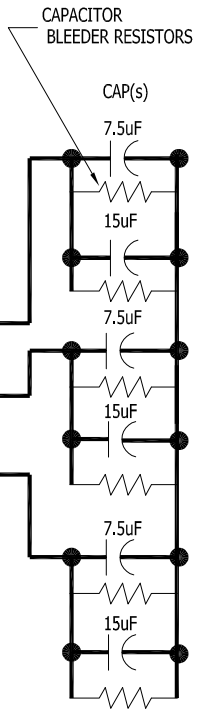
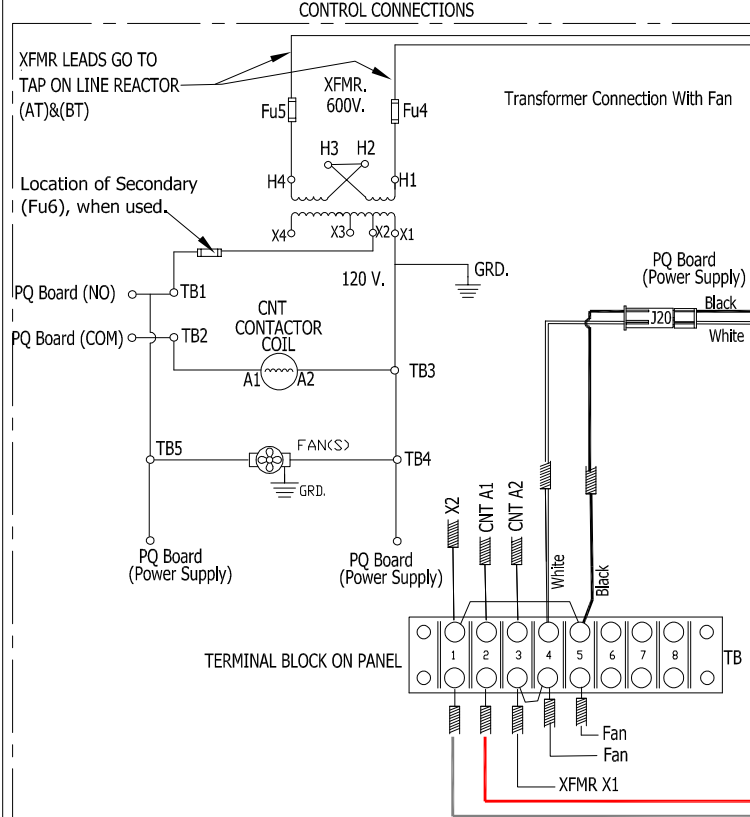
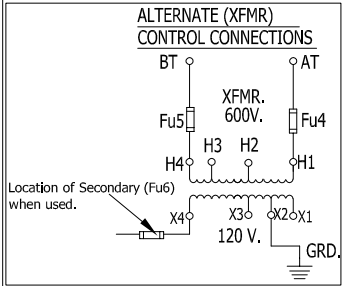


CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

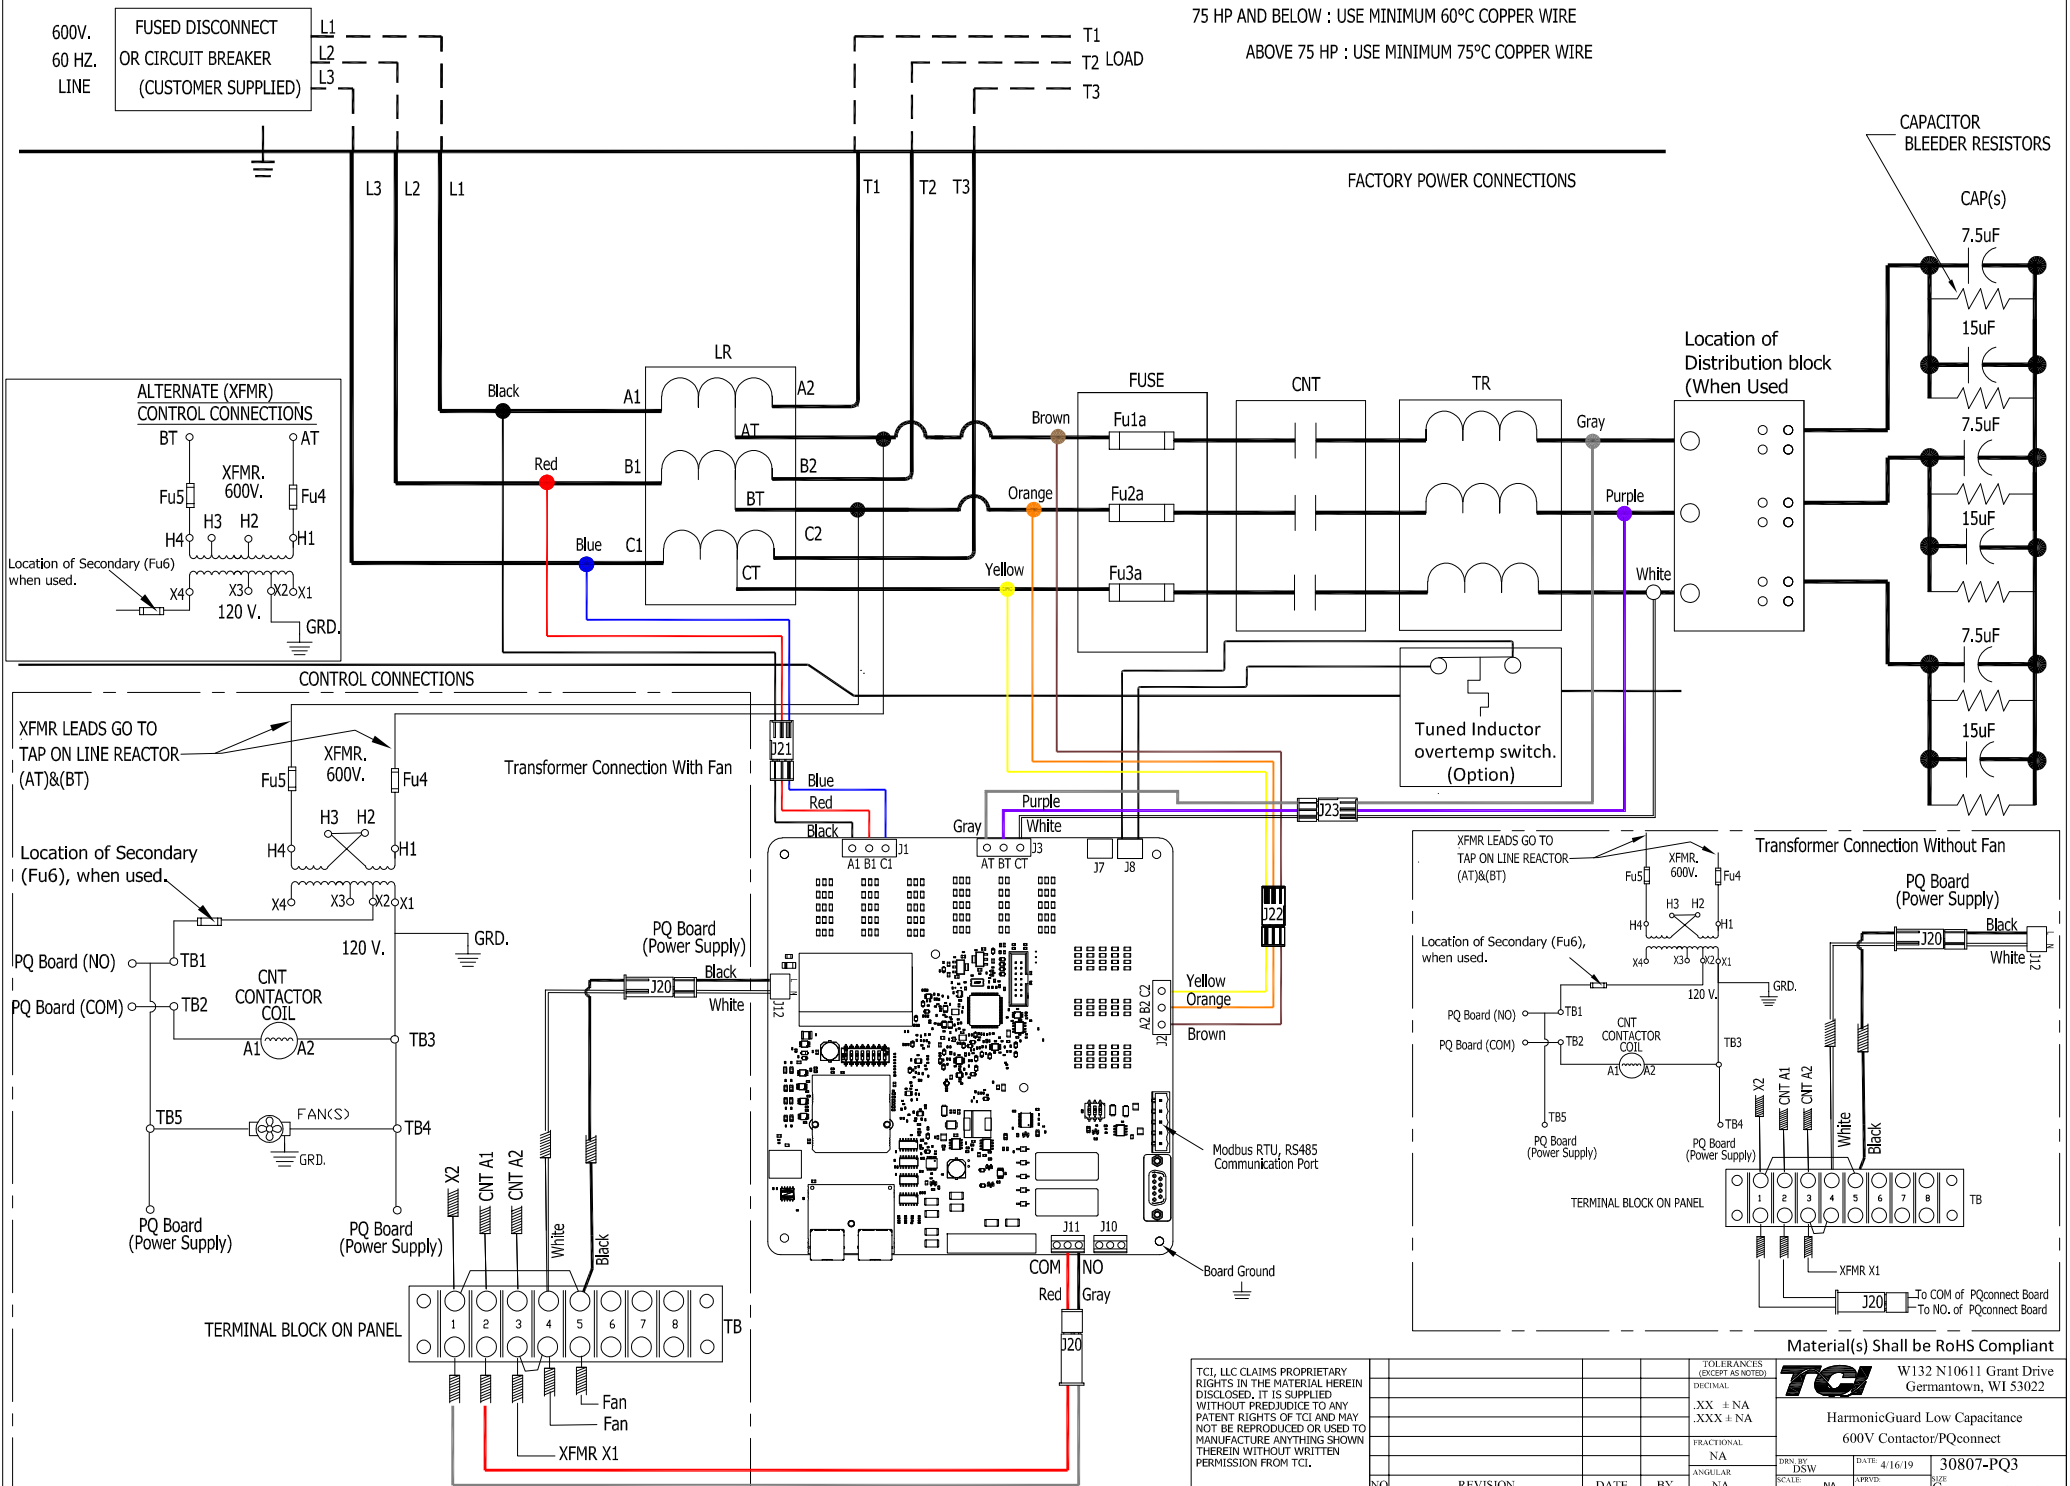

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

REVISION	DATE	BY	SCALE	APPROVED

Material(s) Shall be RoHS Compliant

TOLERANCES (EXCEPT AS NOTED)
 DECIMAL
 .XX + NA
 .XXX + NA

FRACTIONAL
 NA

ANGULAR
 NA

DRY BY DSW
 SCALE NA

DATE 4/16/19
 APPROVED

W132 N10611 Grant Drive
 Germantown, WI 53022

HarmonicGuard Low Capacitance
 600V Contactor/PQconnect

30807-PQ3

SHT.1 OF 1