

480V.
60 HZ.
LINE


FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

L1
L2
L3
CUSTOMER CONNECTIONS
T1
T2
T3
LOAD

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE


FACTORY POWER CONNECTIONS

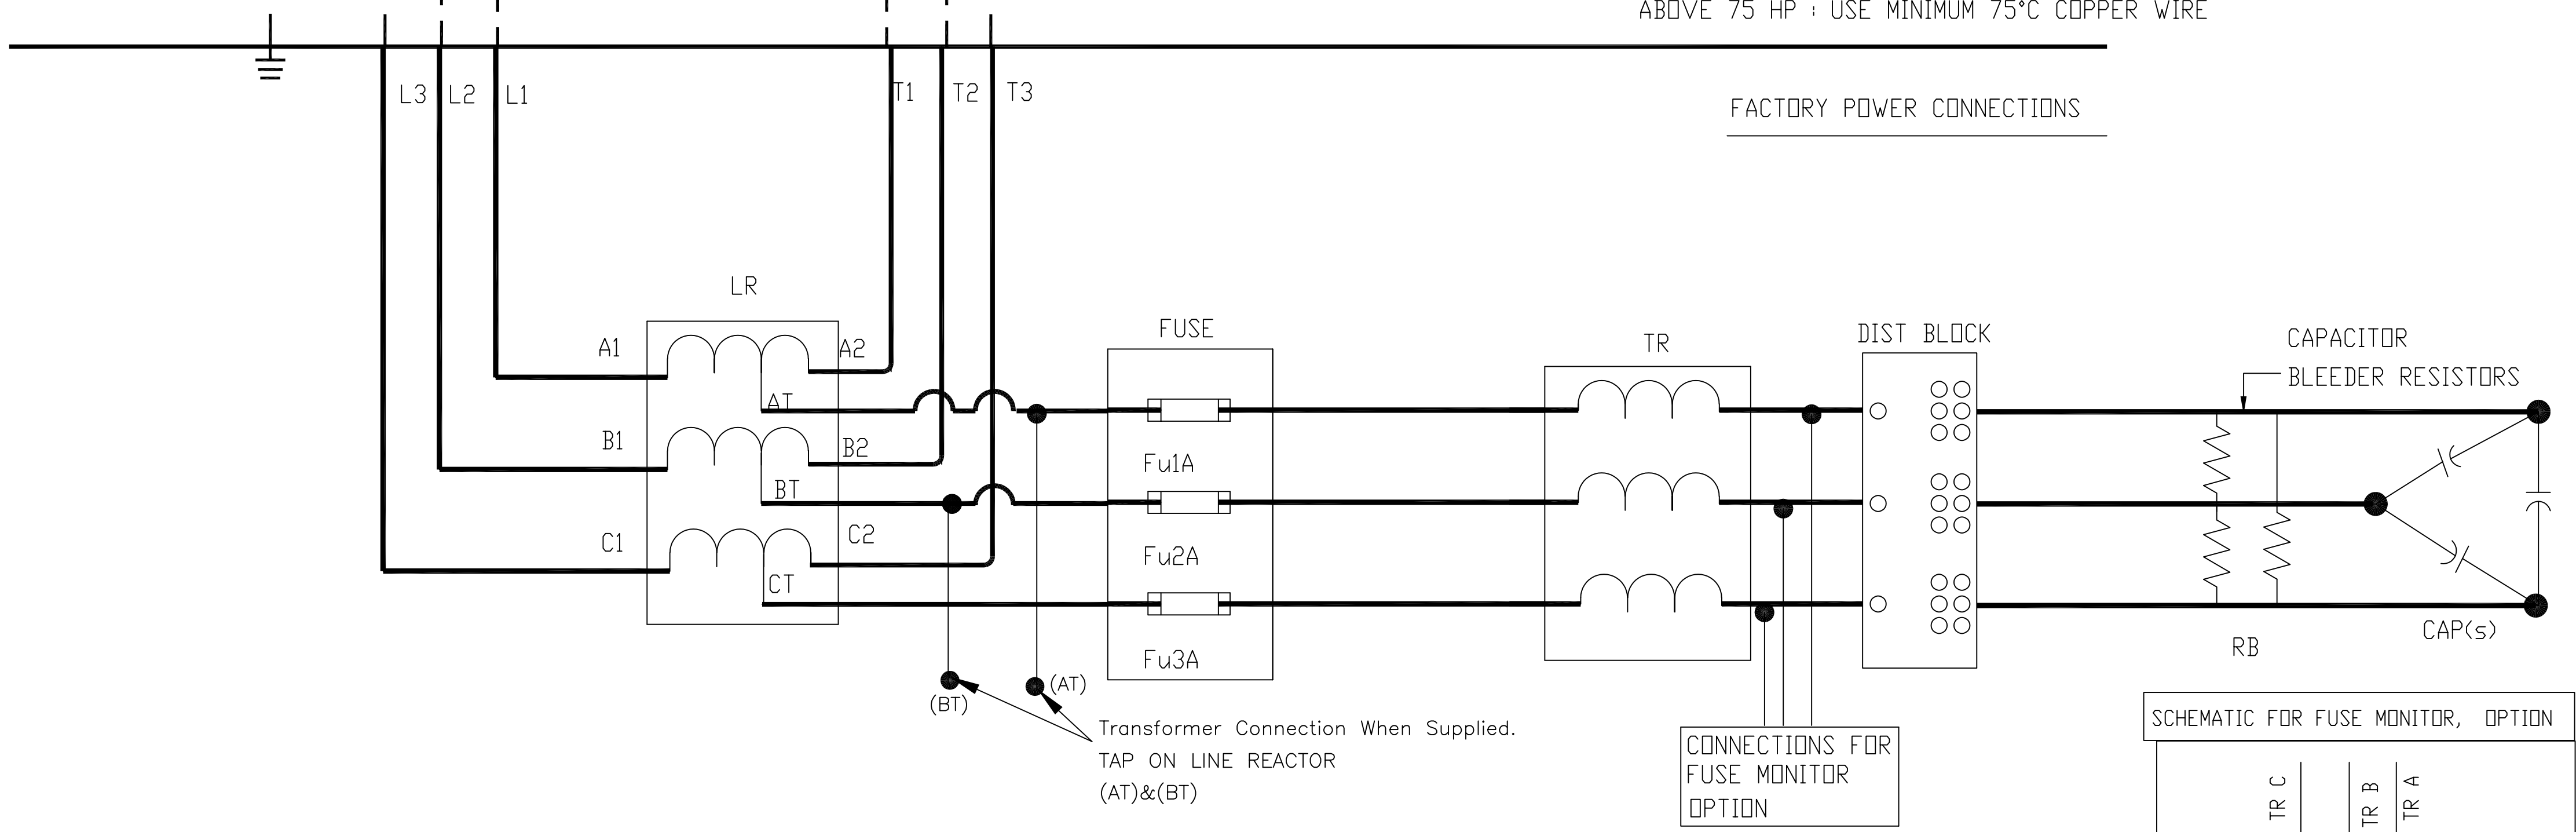


(BT) (AT)
Transformer Connection When Supplied.
TAP ON LINE REACTOR
(AT)&(BT)

CONNECTIONS FOR
FUZE MONITOR
OPTION

SCHEMATIC FOR FUZE MONITOR, OPTION

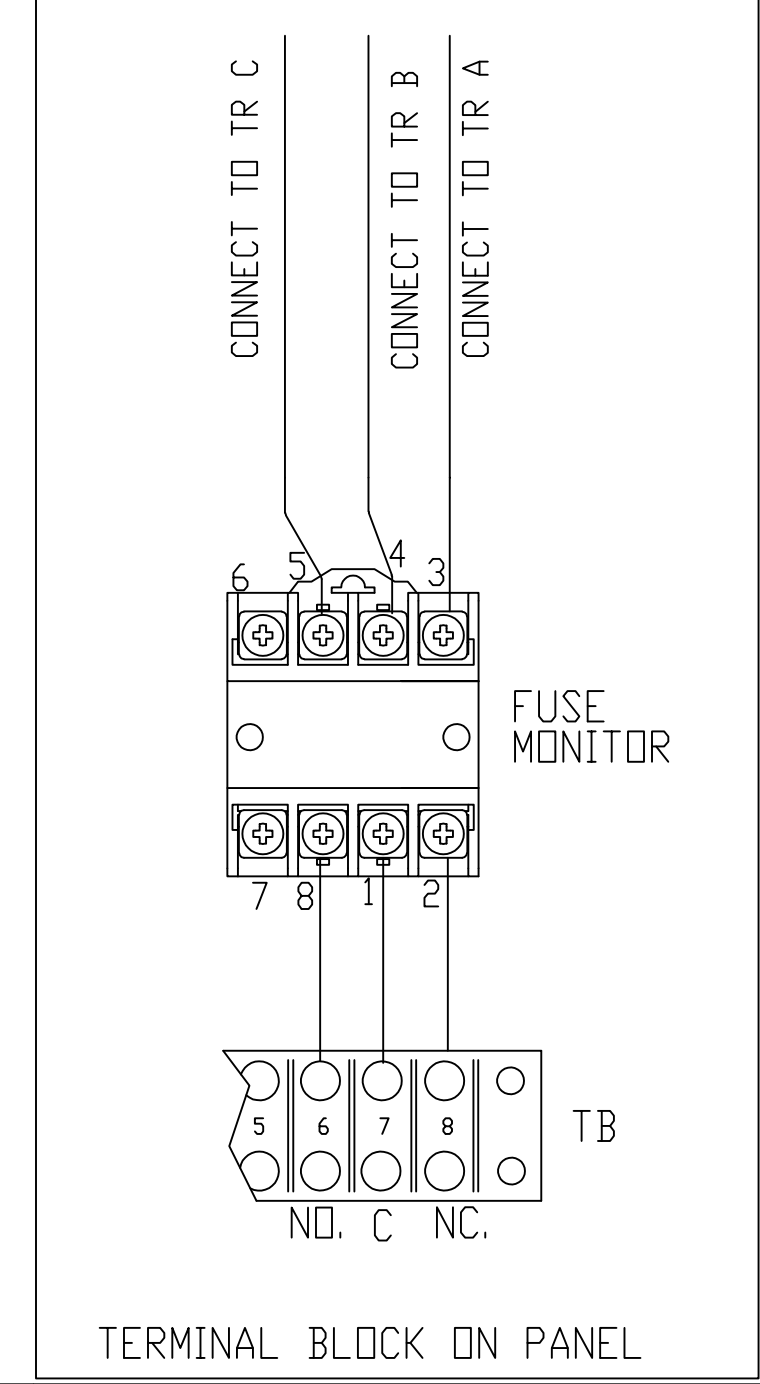

CONTROL CONNECTIONS WITH IF FAN(S) SUPPLIED

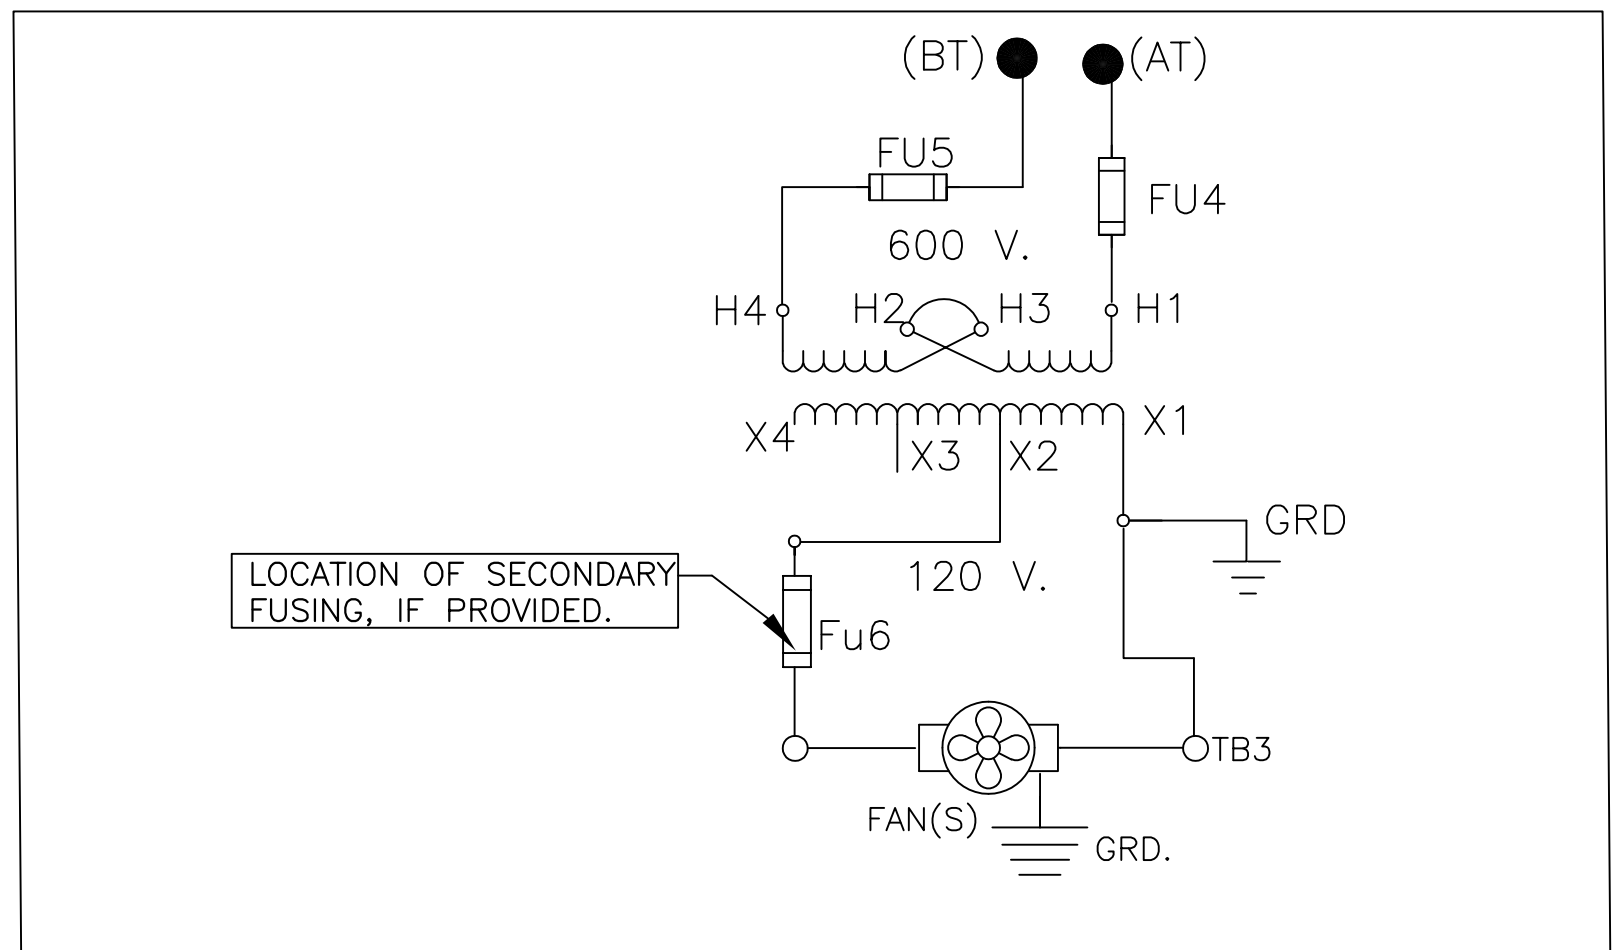

<p>TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.</p>	NO	REVISION	DATE	BY	TOLERANCES (EXCEPT AS NOTED)	<p>TCI W132 N10611 GRANT DRIVE GERMANTOWN, WI 53022</p> <p>HGL PASSIVE 600V SCHEMATIC Standard VERSION</p> <p>DRN. BY DSW DATE 10/11/17 DWG. NO. 30807-S SCALE NONE SIZE C SHT.1 OF1</p>
					DECIMAL	
					.XX ± NA	
					.XXX ± NA	
					FRACTIONAL ± NA	
				ANGULAR ± NA		