

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

480V.
60 HZ.
LINE

FUSED DISCONNECT
OR CIRCUIT BREAKER
(CUSTOMER SUPPLIED)

L1
L2
L3

CUSTOMER LOAD

T1 CHILLER
T2 VFD LOAD
T3

FACTORY POWER CONNECTIONS

60A FUSED DISCONNECT
60A FUSES INSTALLED

Black

Red

Blue

LR

A1

B1

C1

A2

B2

C2

L1

L2

L3

AT

BT

CT

T1

T2

T3

Brown

Orange

Yellow

Black

Blue

FUSE

Fu1a

Fu2a

Fu3a

CNT

TR

Location of
Distribution block
(When Used)

CAPACITOR
BLEEDER RESISTORS

CAP(s)

TS1

TS2

Line Inductor
overtemp switch.
(Option)

TS1

TS2

Tuned Inductor
overtemp switch.
(Option)

CONTROL CONNECTIONS

XFMR LEADS GO TO
TAP ON LINE REACTOR
(AT)&(BT)

Location of Secondary
(Fu6), when supplied





PQ Board (NO)

PQ Board (COM)

PQ Board
(Power Supply)

PQ Board
(Power Supply)

Transformer Connection With Fan

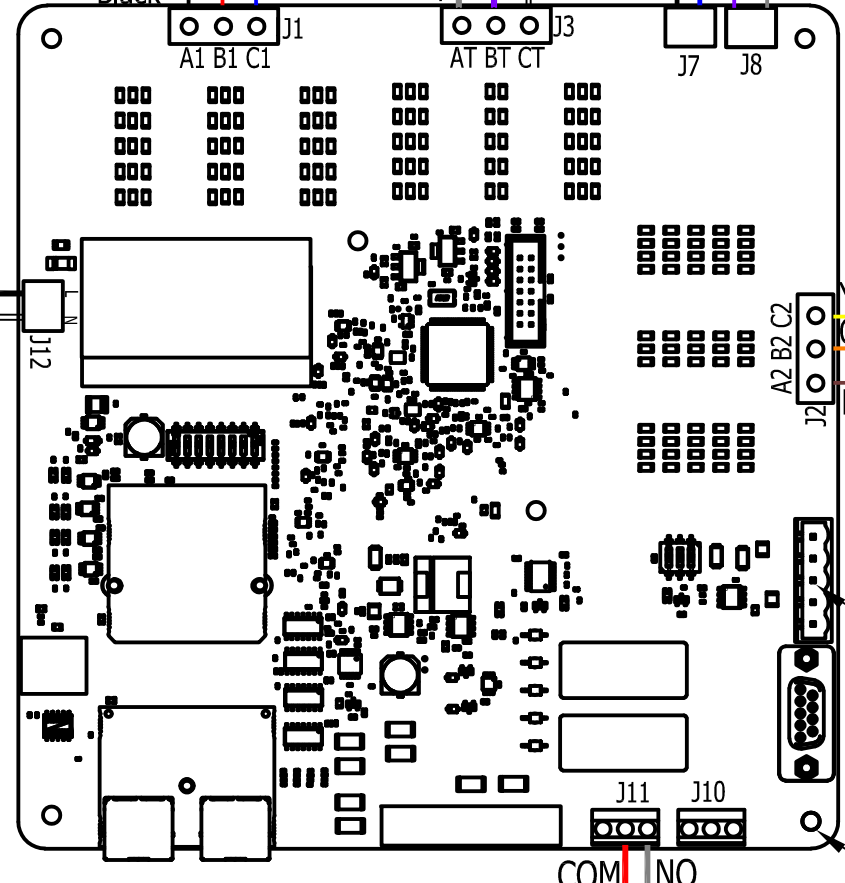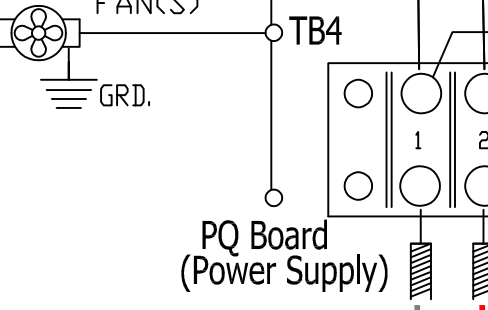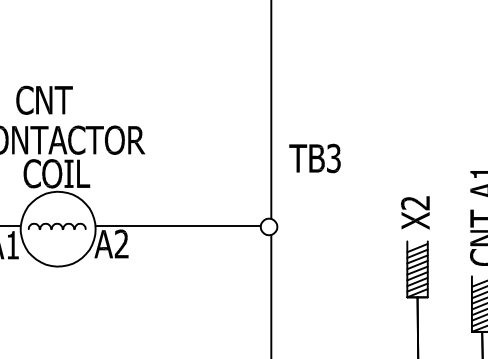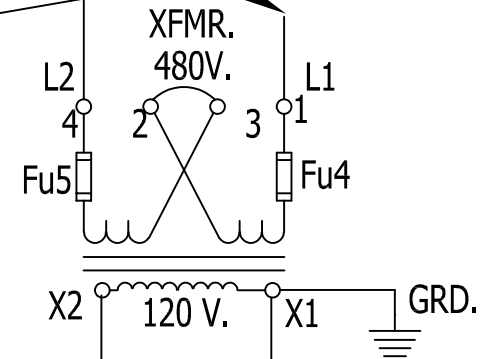

TOL, LLC CLAIMS
PROPRIETARY RIGHTS IN
THE MATERIAL HEREIN
DISCLOSED. IT IS
SUPPLIED WITHOUT
PREJUDICE TO ANY
PATENT RIGHTS OF TCI
AND MAY NOT BE
REPRODUCED OR USED
TO MANUFACTURE
ANYTHING SHOWN
THEREIN WITHOUT
WRITTEN PERMISSION
FROM TCI.

AS DESIGNED	05/14/21	JRN	± N/A
REVISION	DATE	BY	± N/A

TOLERANCES (EXCEPT AS NOTED)		TCI® W132 N10611 Grant Drive Germentown, WI 53022	
DECIMAL		HARMONICGUARD LOW CAPACITANCE	
.XX ± N/A		480V SCHEMATIC	
.XXX ± N/A		FAN, FUSED DISCONNECT, CONTACTOR CONTROL VERSION	
FRACTIONAL ± N/A		DRN. BY	DATE
ANGULAR		JRN	05/14/21
± N/A		SCALE	SIZE
		NONE	C 31462-60-1
			SHT. 1 of 1