



CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

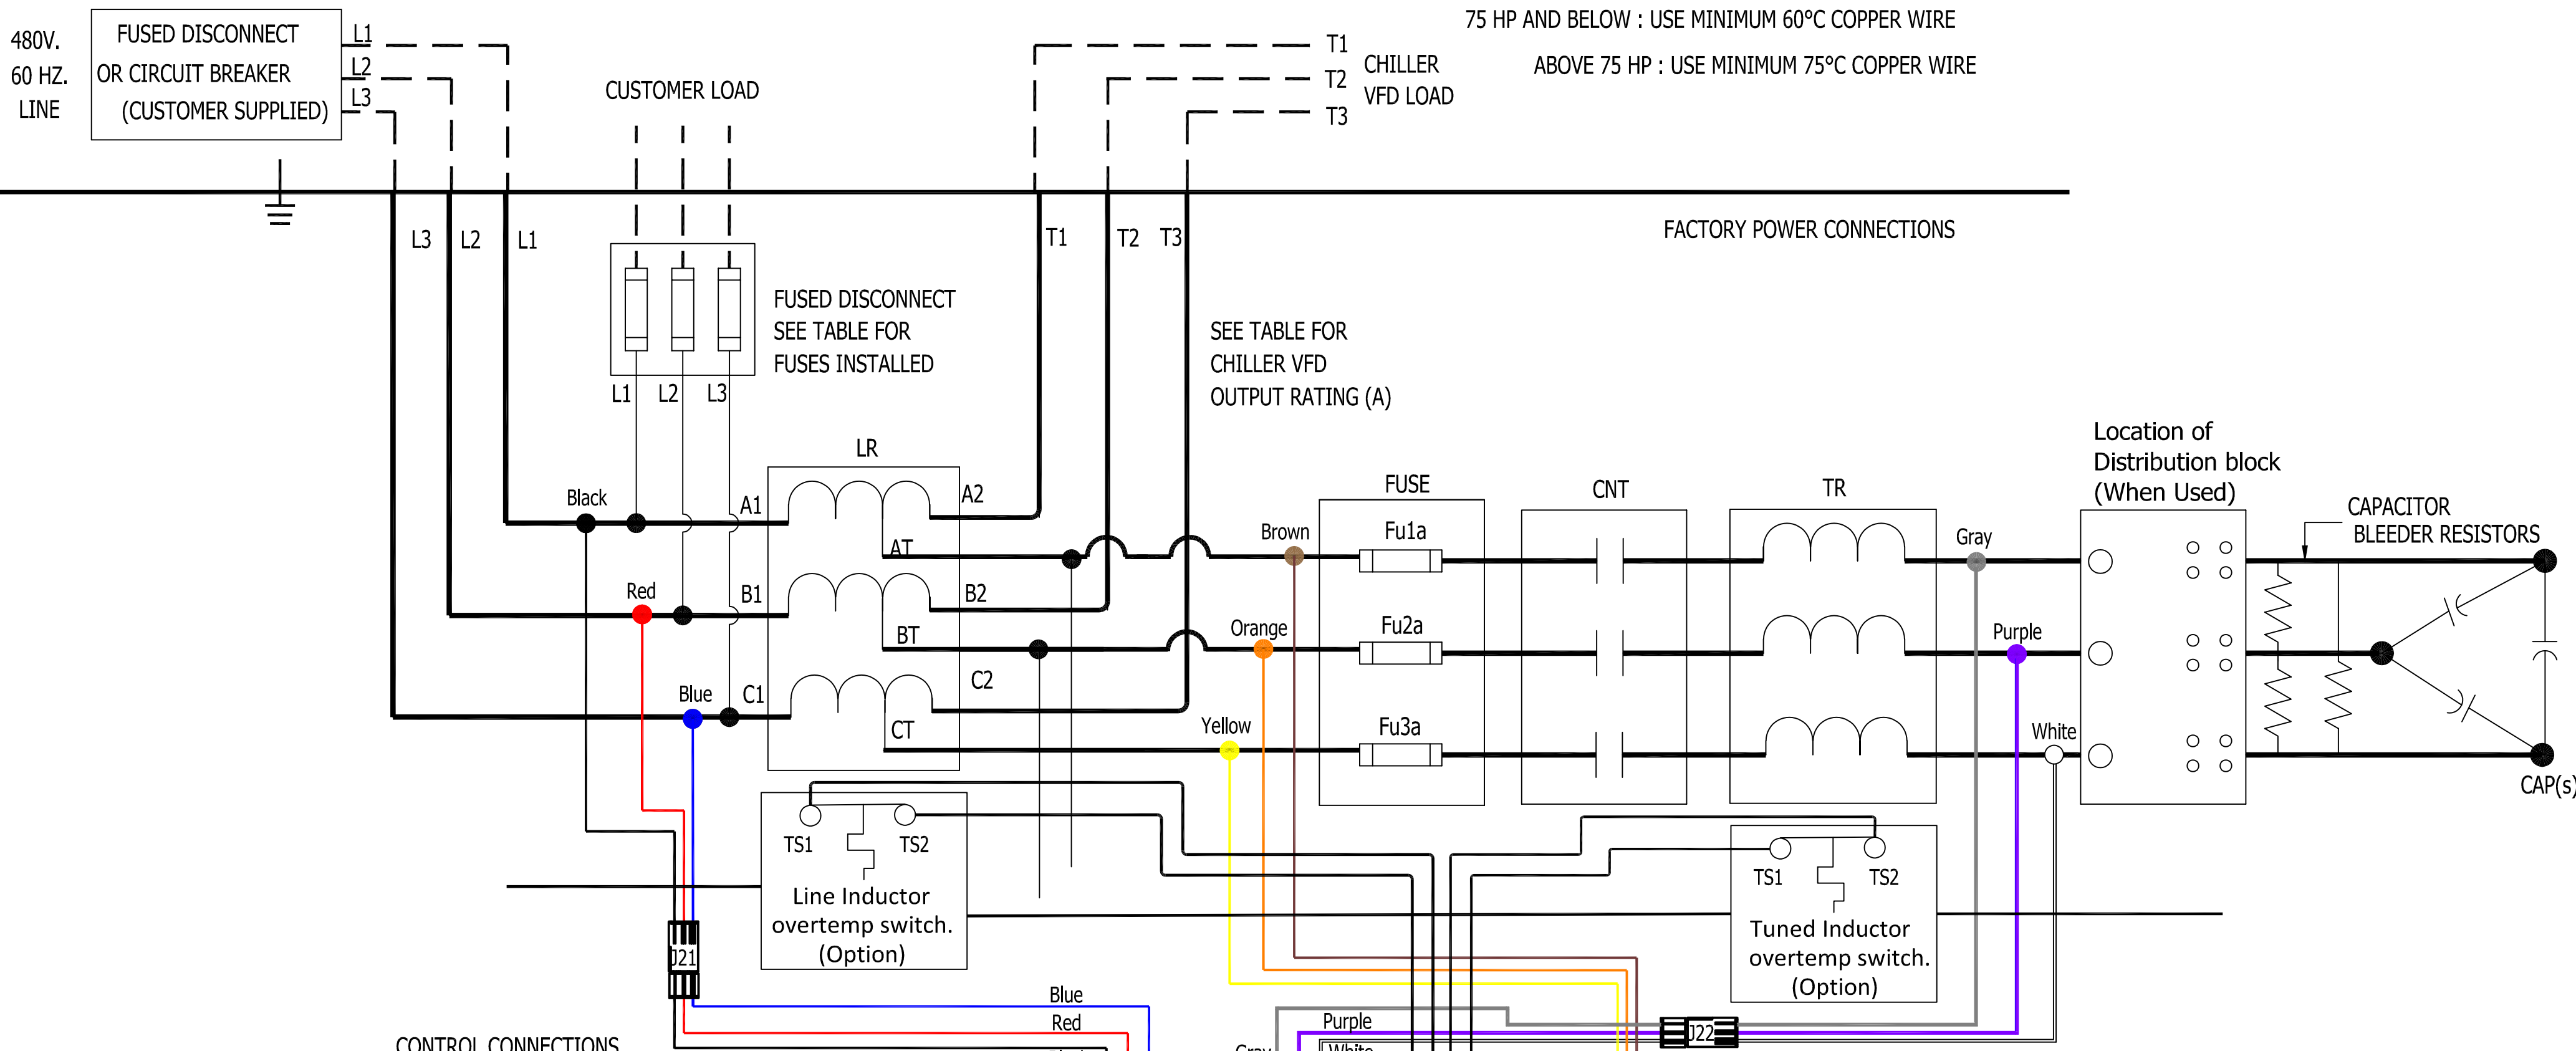

CONTROL CONNECTIONS

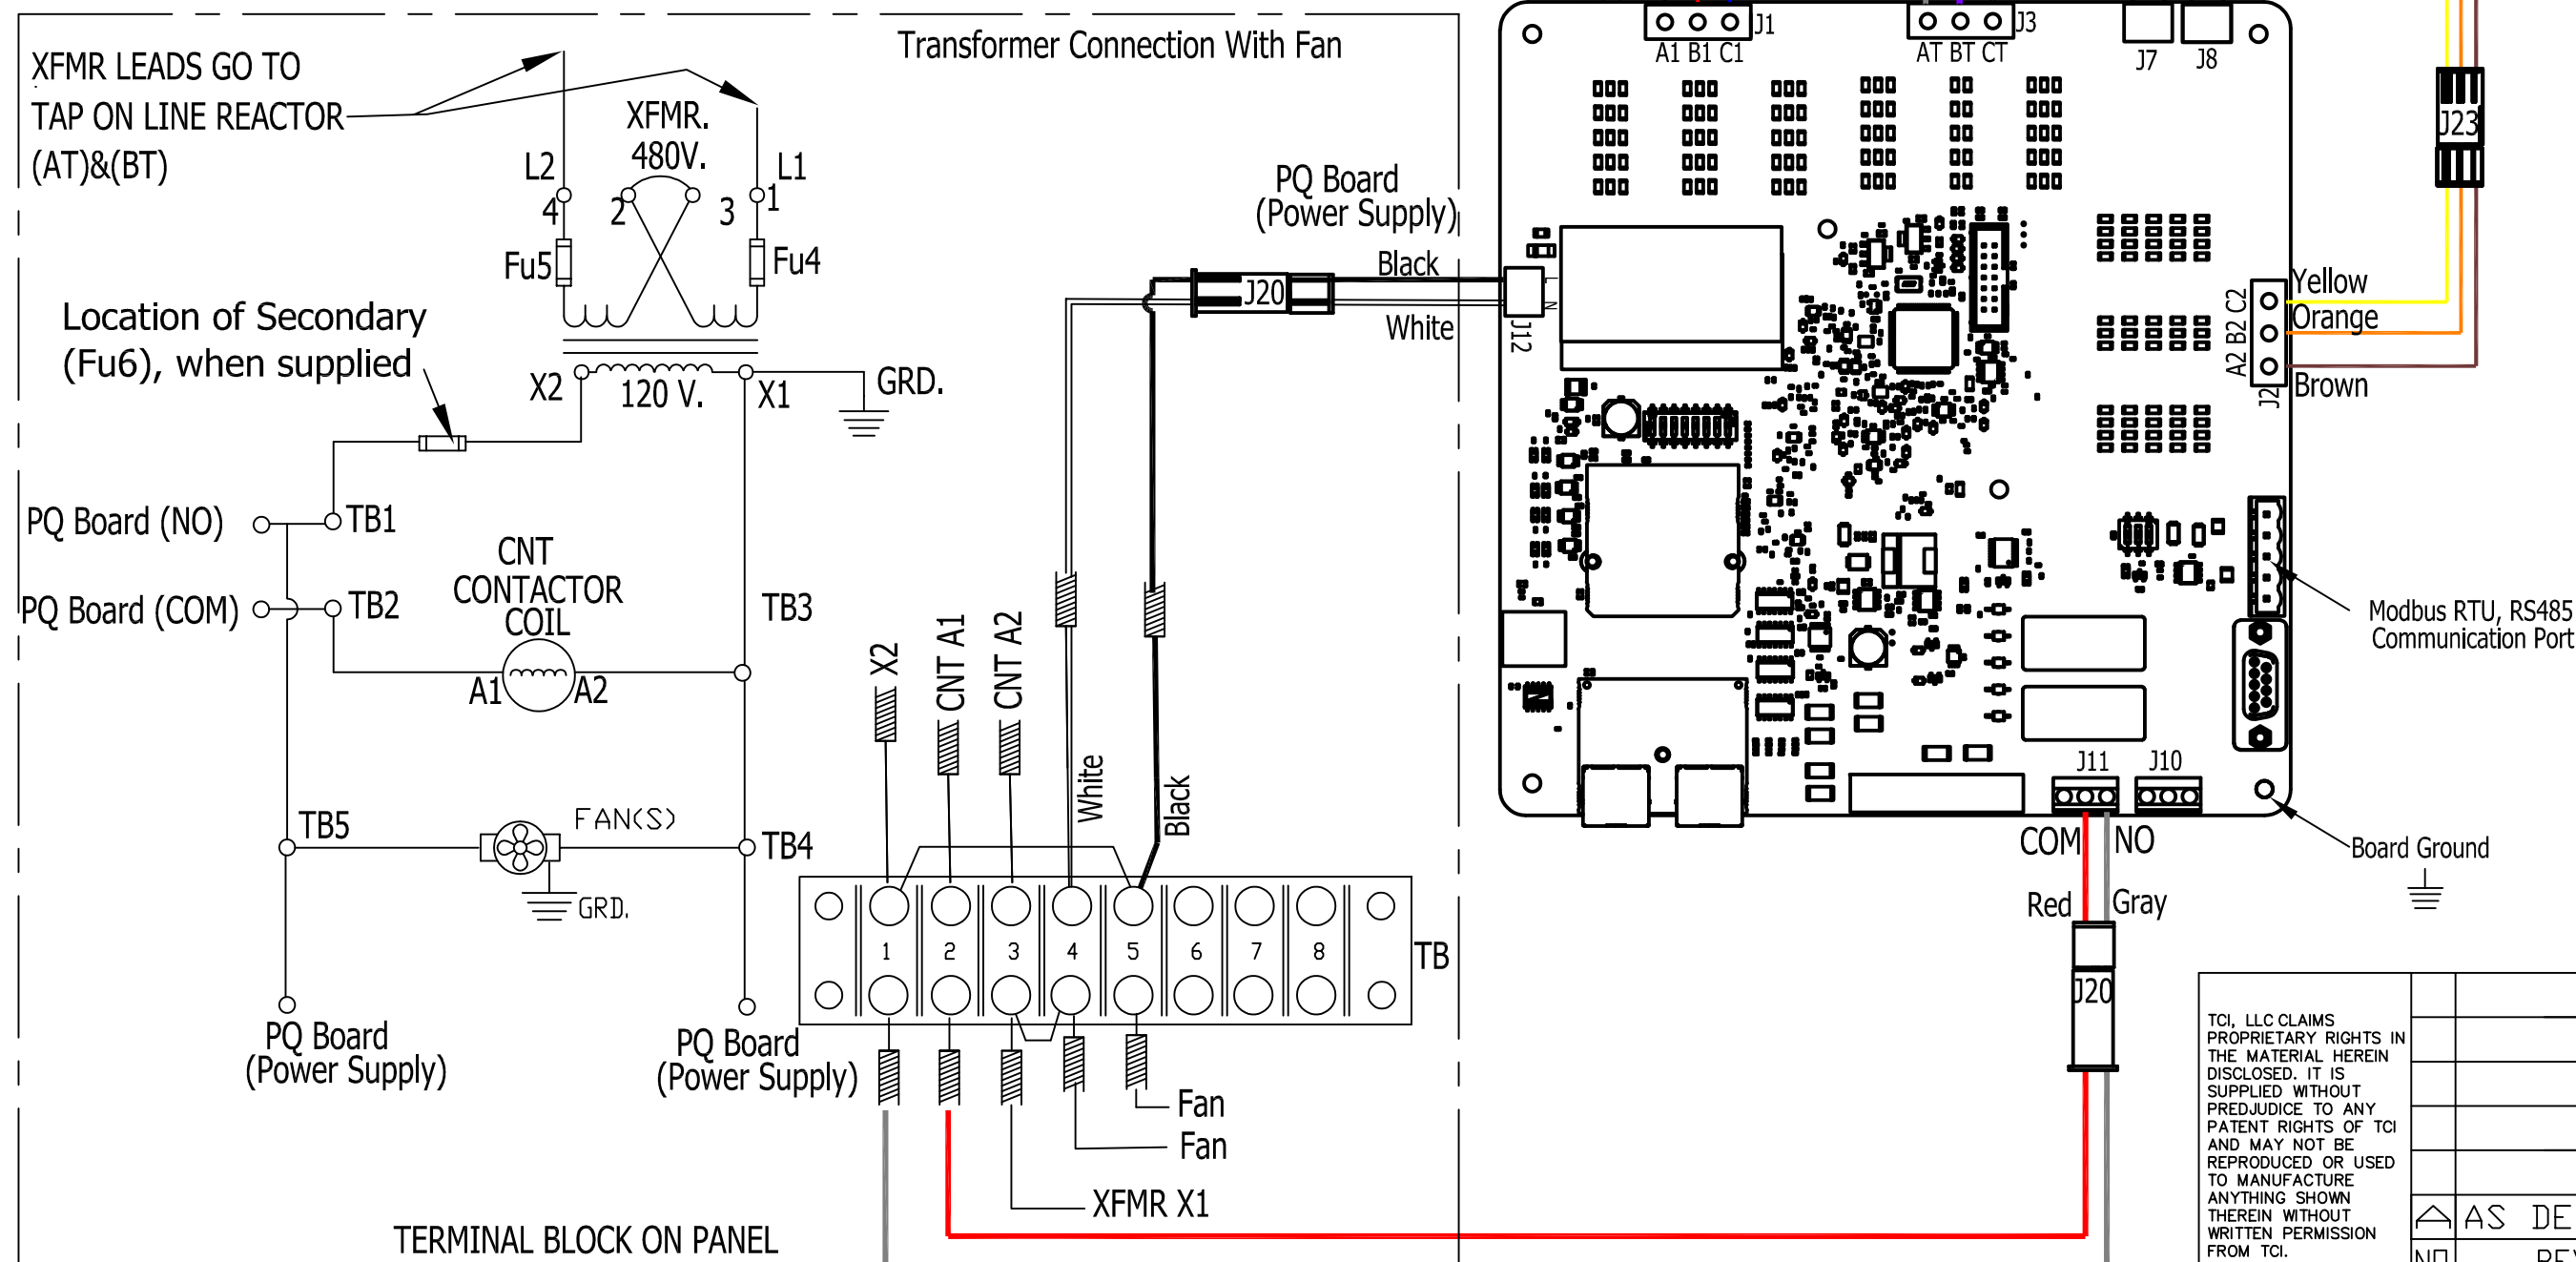

HGP/HGL Part Number	Input Amp Rating (A)	Chiller VFD Output Amp Rating (A)	Fused Disconnect Switch Size	Installed Fuse Size
108191-01	342	302	60	40
108197-03	715	655	60	60
108197-04	725	655	100	70

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

AS DESIGNED	04/06/22	JRN	TOLERANCES (EXCEPT AS NOTED) DECIMAL
REVISION	DATE	BY	.XX ± N/A
			.XXX ± N/A
			FRACTIONAL ± N/A
			ANGULAR ± N/A

TCL® W132 N10611 Grant Drive
 Germantown, WI 53022

HGP/HGL, 480V SCHEMATIC
 UNFILTERED FUSED DISCONNECT, CONTACTOR CONTROL

DRN BY JRN DATE 04/06/22 DWG. NO. 31462-L
 SCALE NONE SIZE C SHT. 1 OF 1