
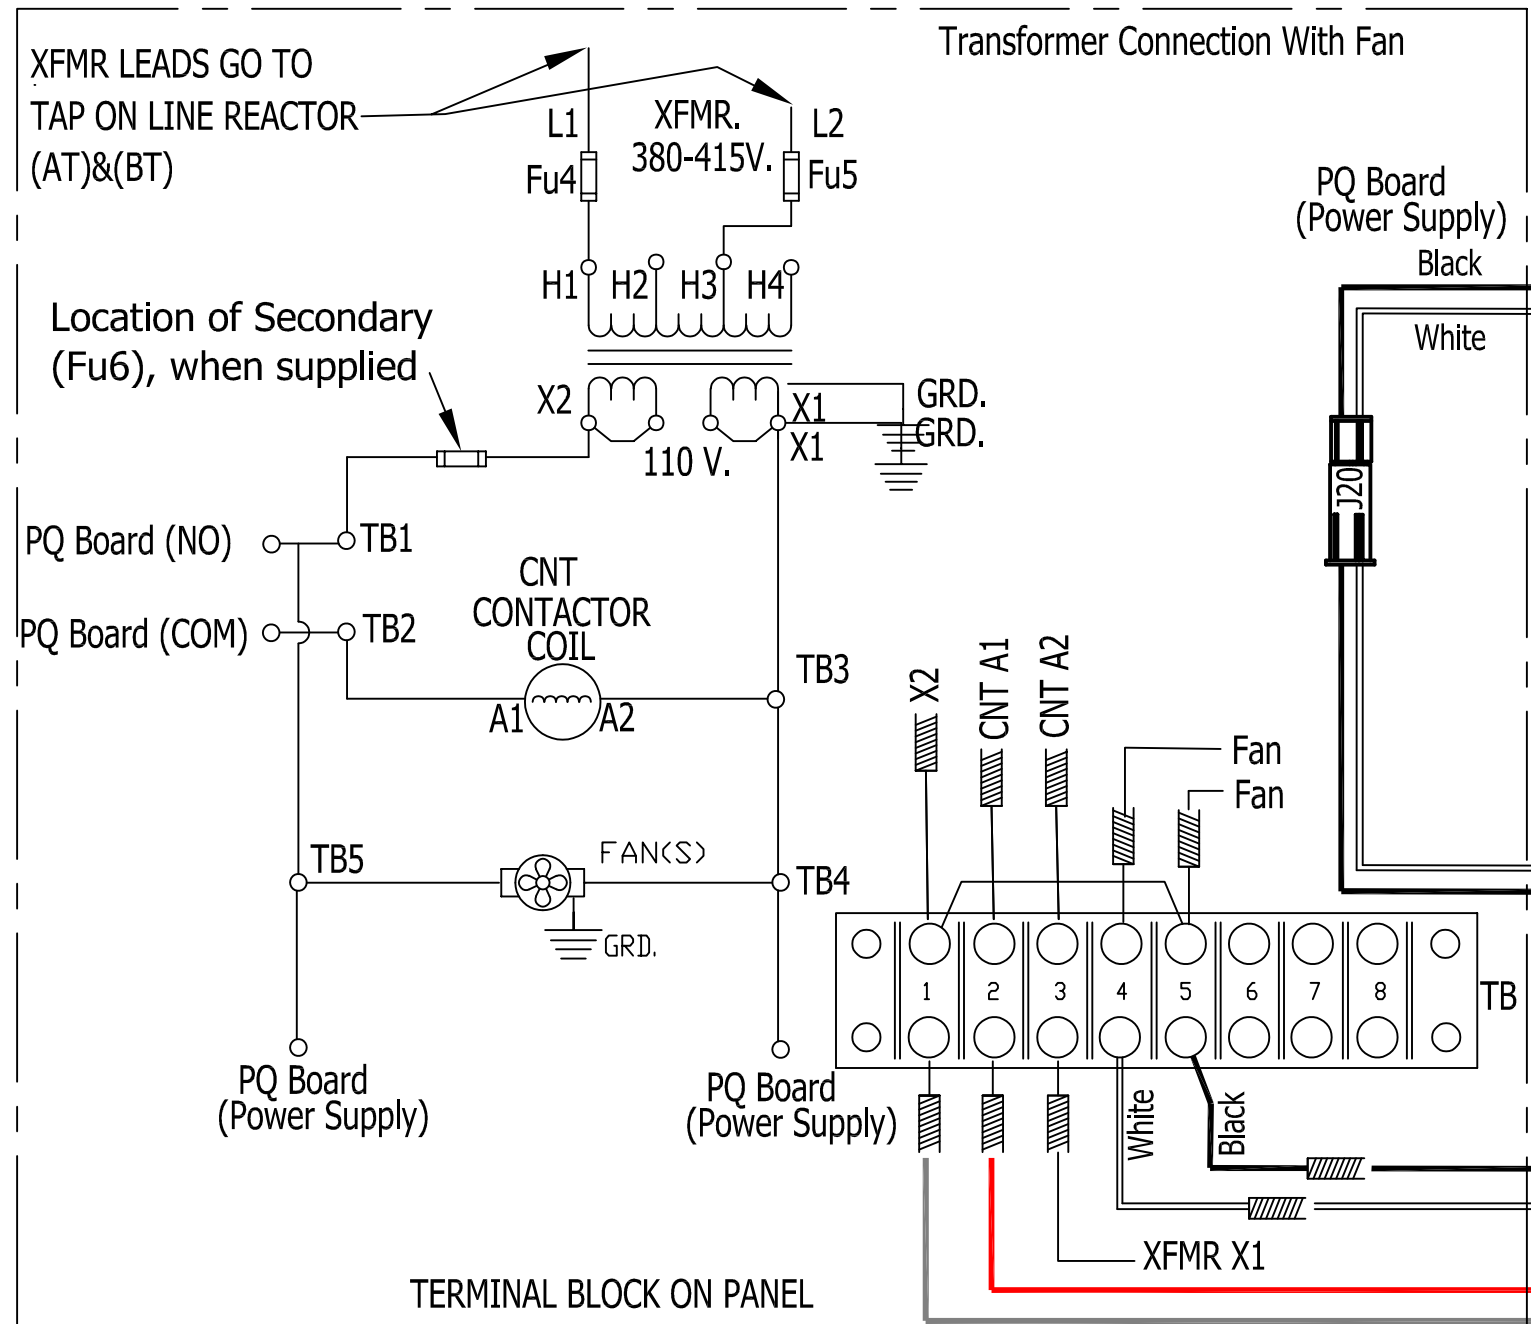


ALL CUSTOMER CONNECTIONS, 480V, 60HZ

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE

ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

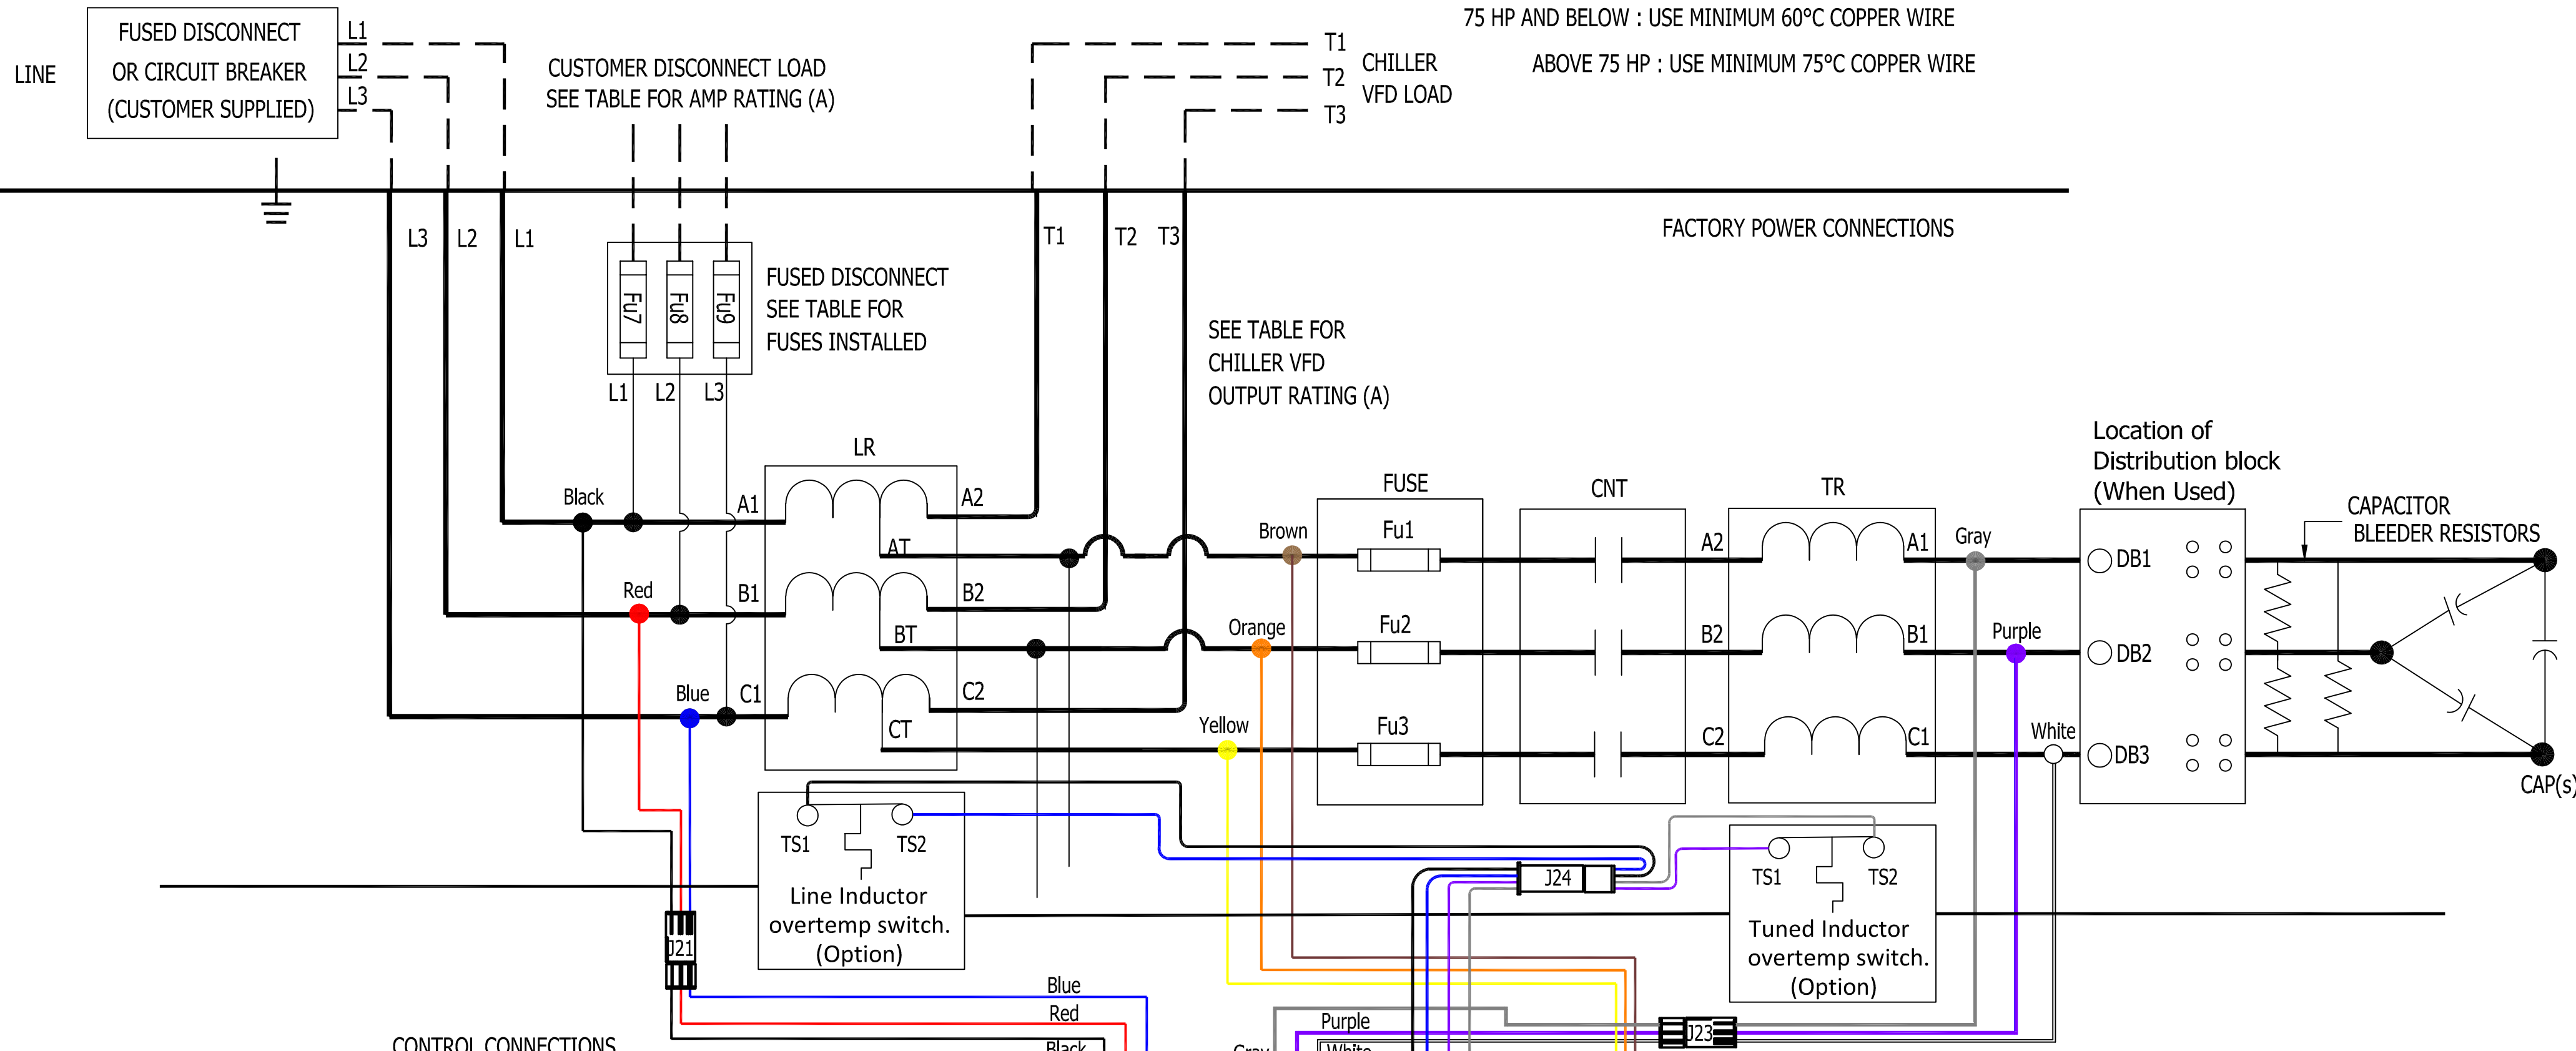

HGP/HGL Part Number	Panel Amp Rating (A)	Chiller VFD Amp Rating (A)	Fused Disconnect Switch Size	Installed Fuse Size	Customer Disconnect Amp Rating (A)
108202-01	430	370	60	60	60
108203-02	560	510	60	50	50
108204-04	725	625	100	100	100
108675-02	730	640	100	90	90
108792-01	810	710	100	100	100

DIMENSIONS IN INCHES (EXCEPT AS NOTED) TOLERANCES (EXCEPT AS NOTED): DECIMAL .XX ±.01 .XXX ±.005 FRACTIONAL ± 1/32 ANGULAR ± 1/2°	THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLENT INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLENT INC. AND ITS SUBSIDIARIES.	DRAWN BY: JRN DATE: 04/06/22		W132 N10611 Grant Drive Germantown, WI 53022 ©Allient Inc. 2025
		HGP/HGL 380-415V Schematic Unfiltered Fused Disconnect, Contactor Control		SCALE: NA DWG. NO: 31462-LXL SHT. 1 OF 1