

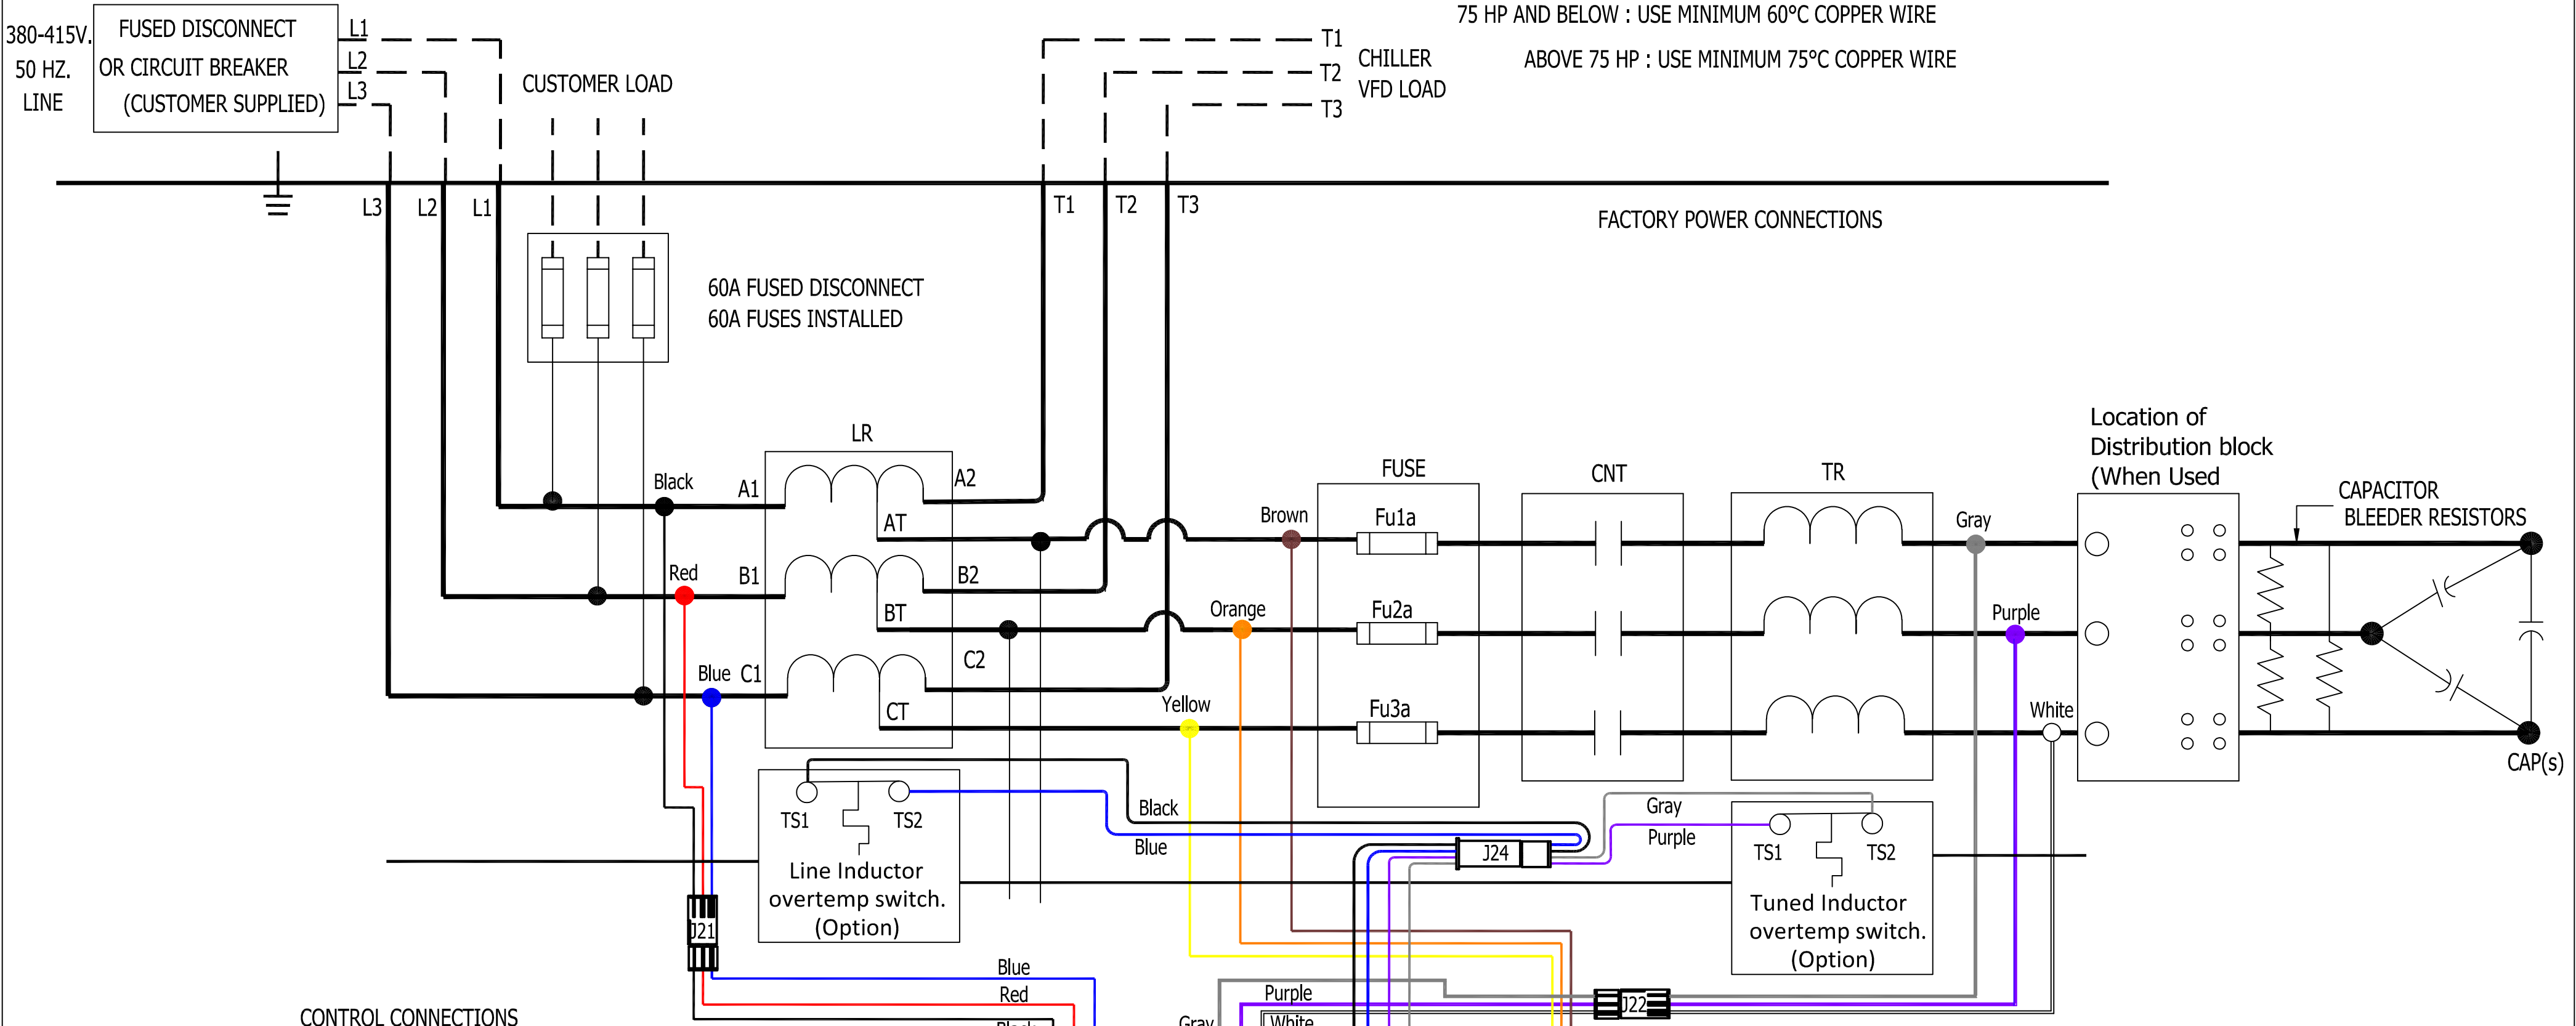



CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

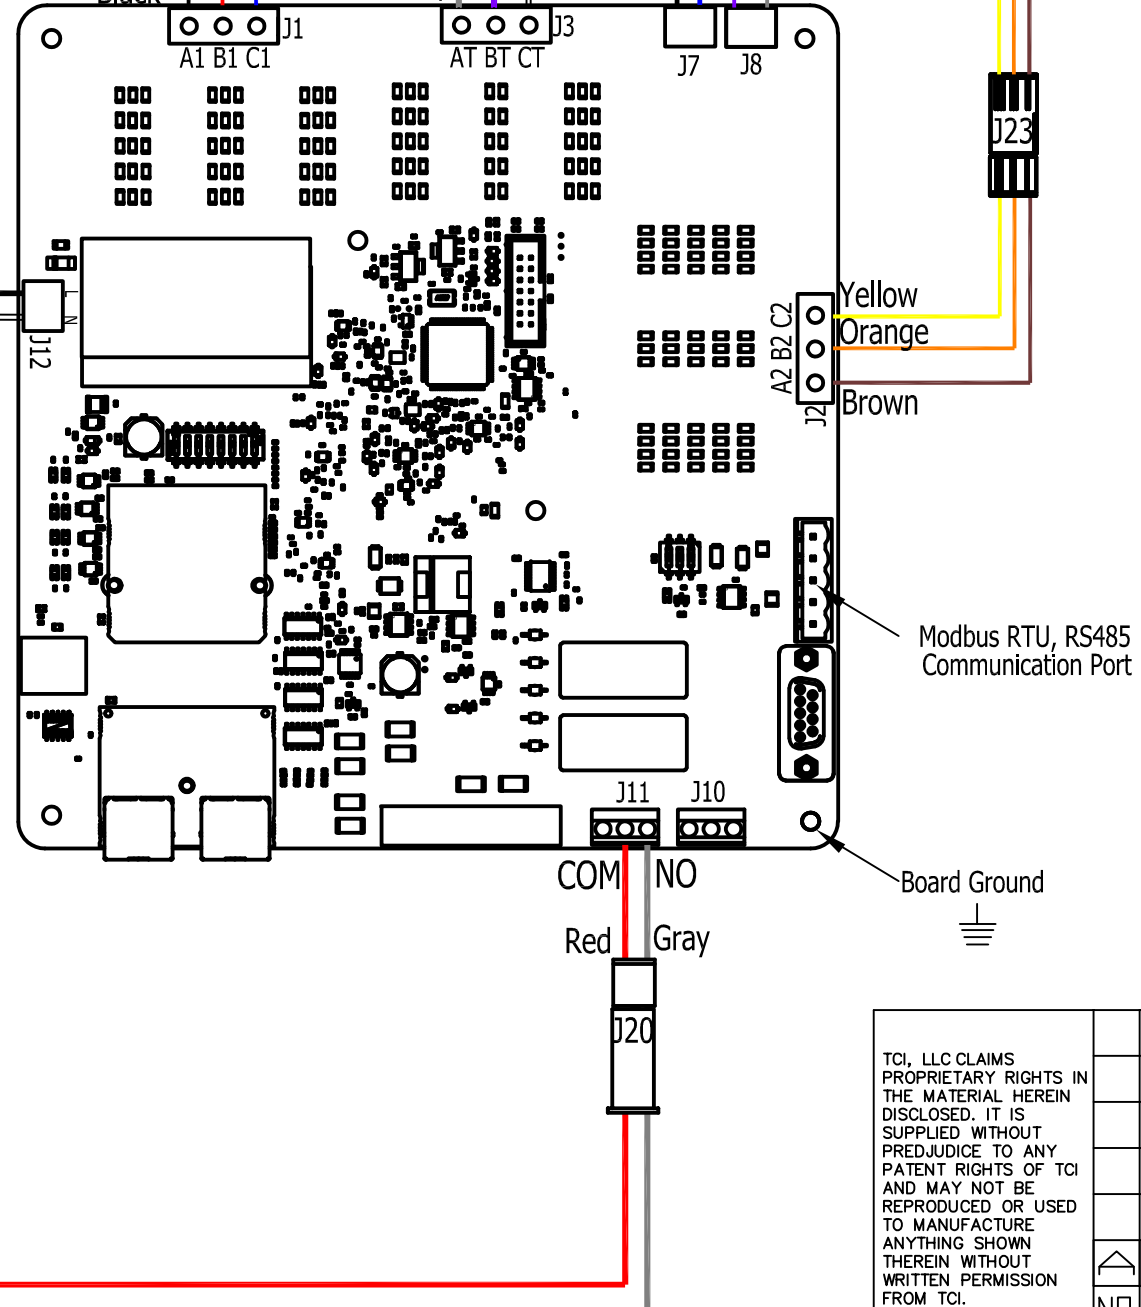

CONTROL CONNECTIONS

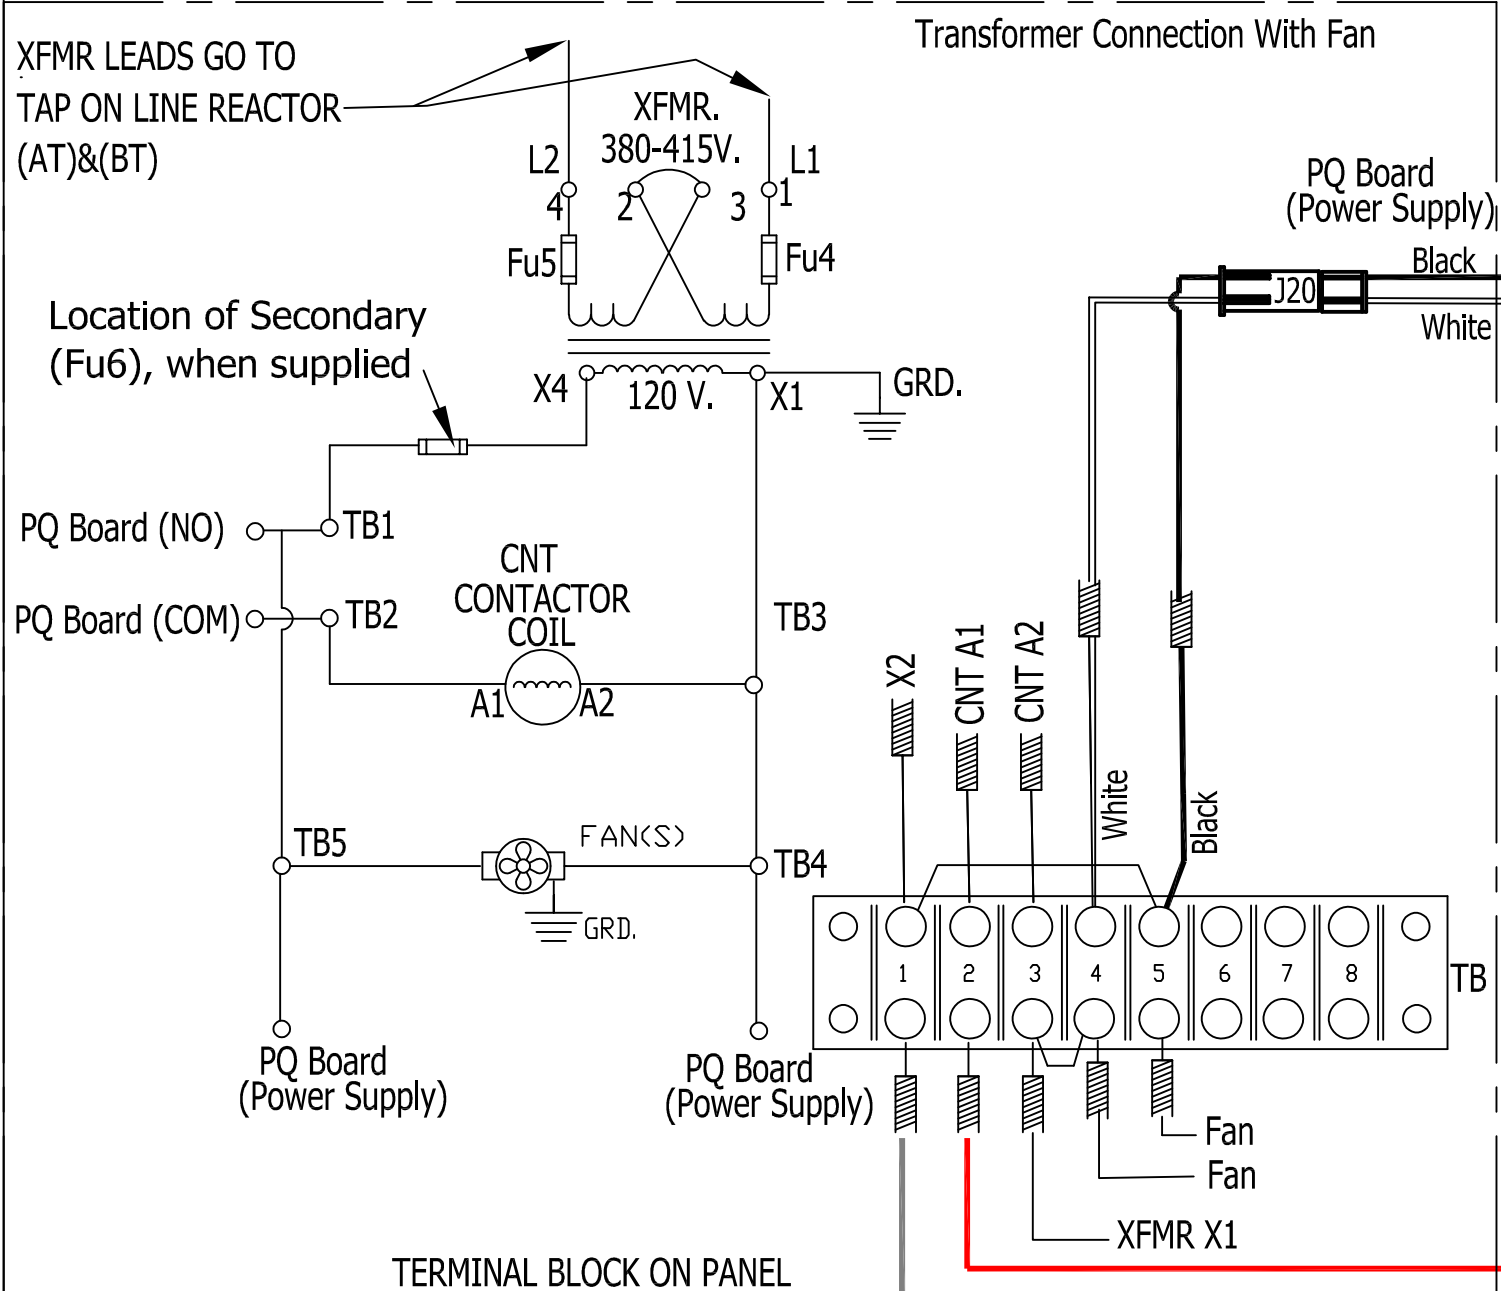

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED)	 W132 N10611 Grant Drive Germantown, WI 53022 © TCI, 2021
AS DESIGNED	05/04/21	JRN	DECIMAL	HARMONICGUARD LOW CAPACITANCE	
REVISION	DATE	BY	FRACTIONAL	380-415V SCHEMATIC	
			ANGULAR	FAN, FUSED DISCONNECT, CONTACTOR CONTROL VERSION	
			± N/A	DRN. BY JRN DATE 05/04/21	
			± N/A	SCALE NONE SIZE	
				DWG. NO. C 31582-60	
				SHT. 1 OF 1	