

CUSTOMER CONNECTIONS


75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE  
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS




Location of Distribution block (When Used)

CAPACITOR BLEEDER RESISTORS

CAP(s)

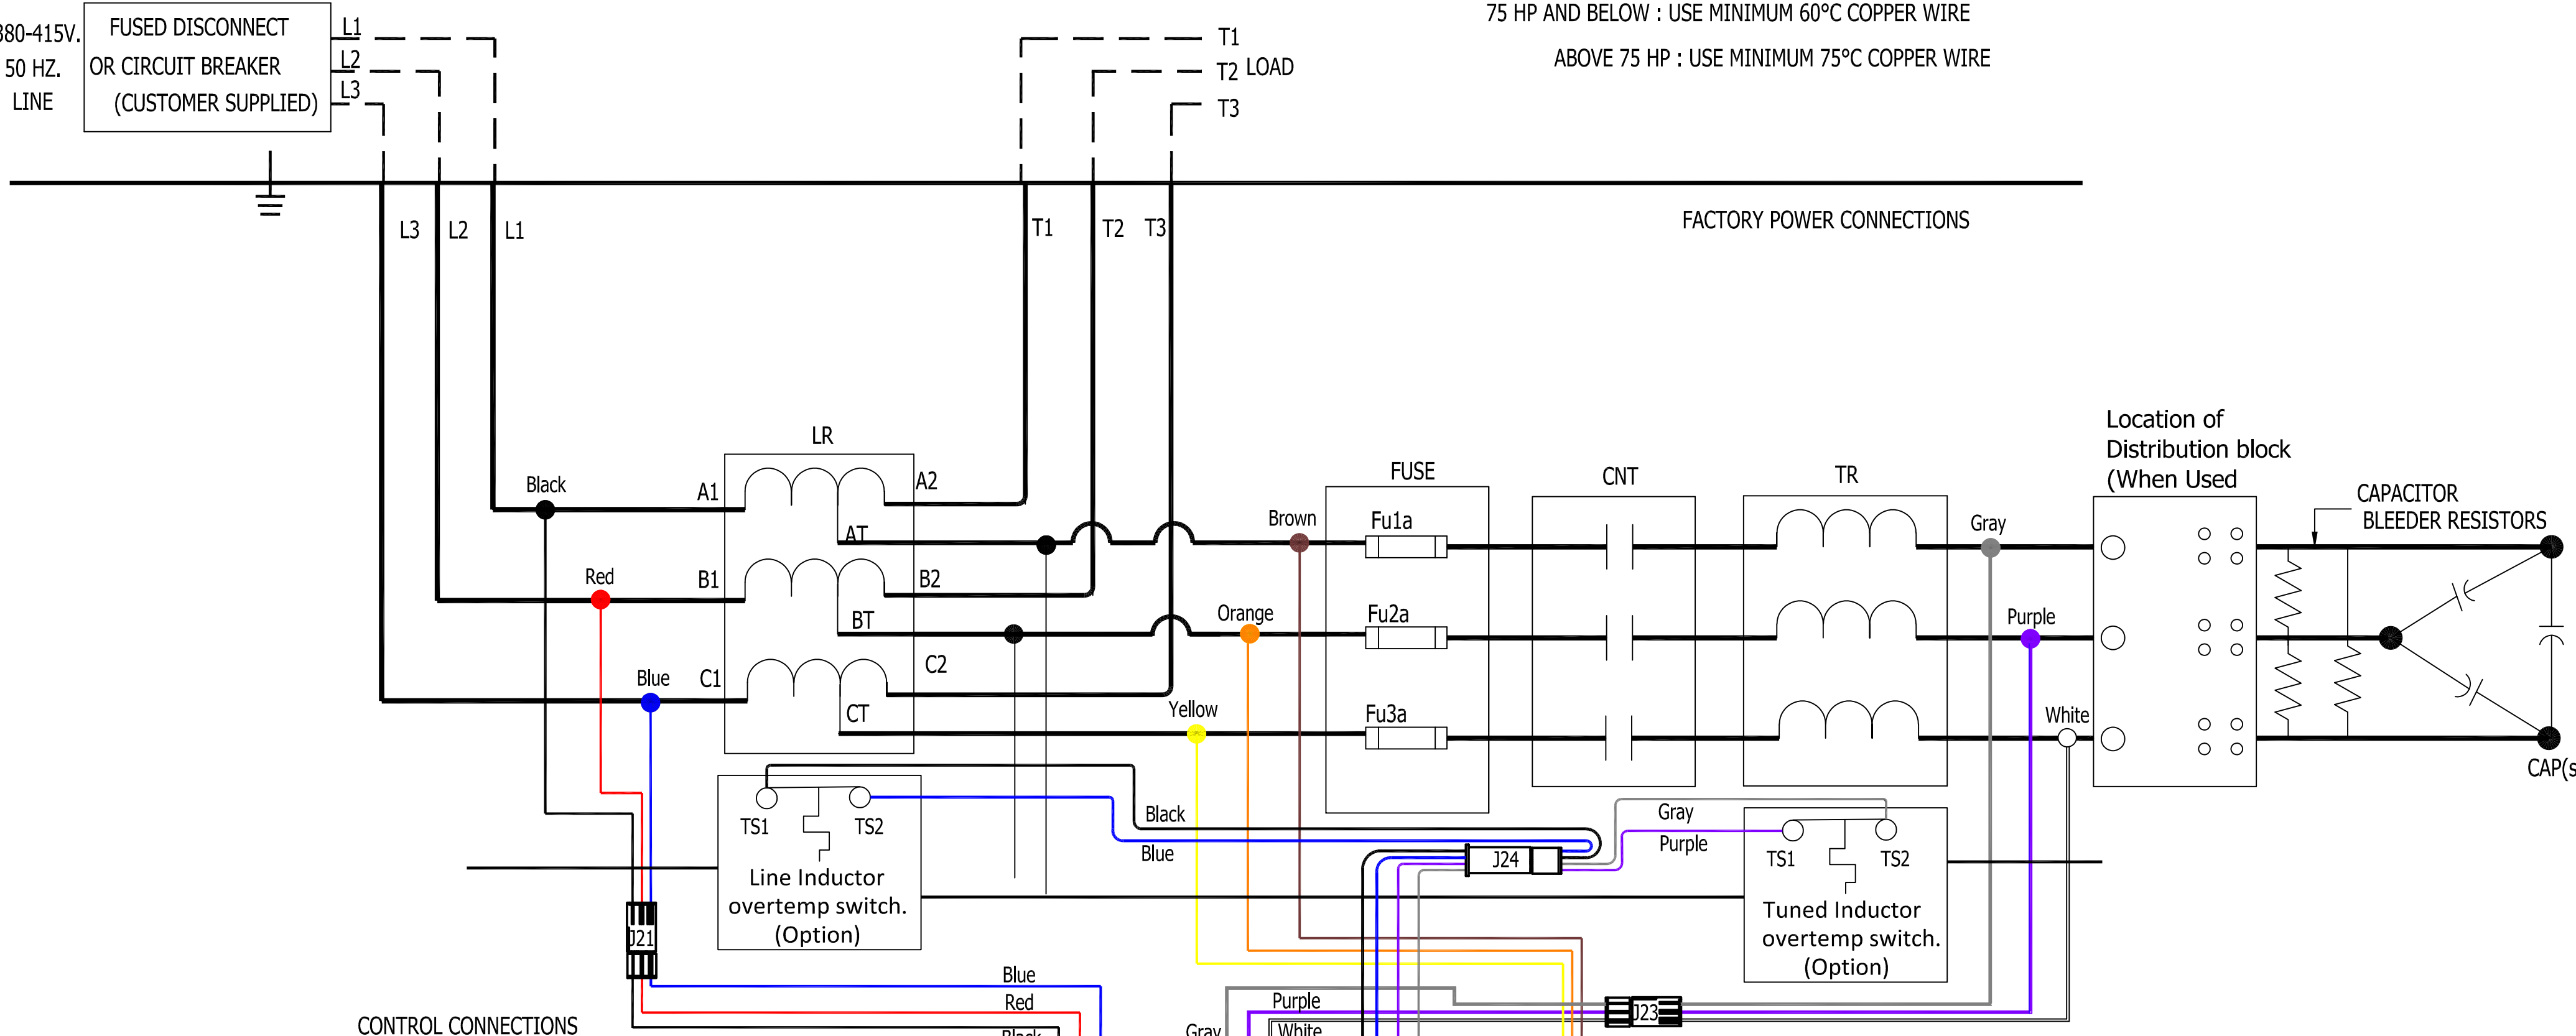

CONTROL CONNECTIONS

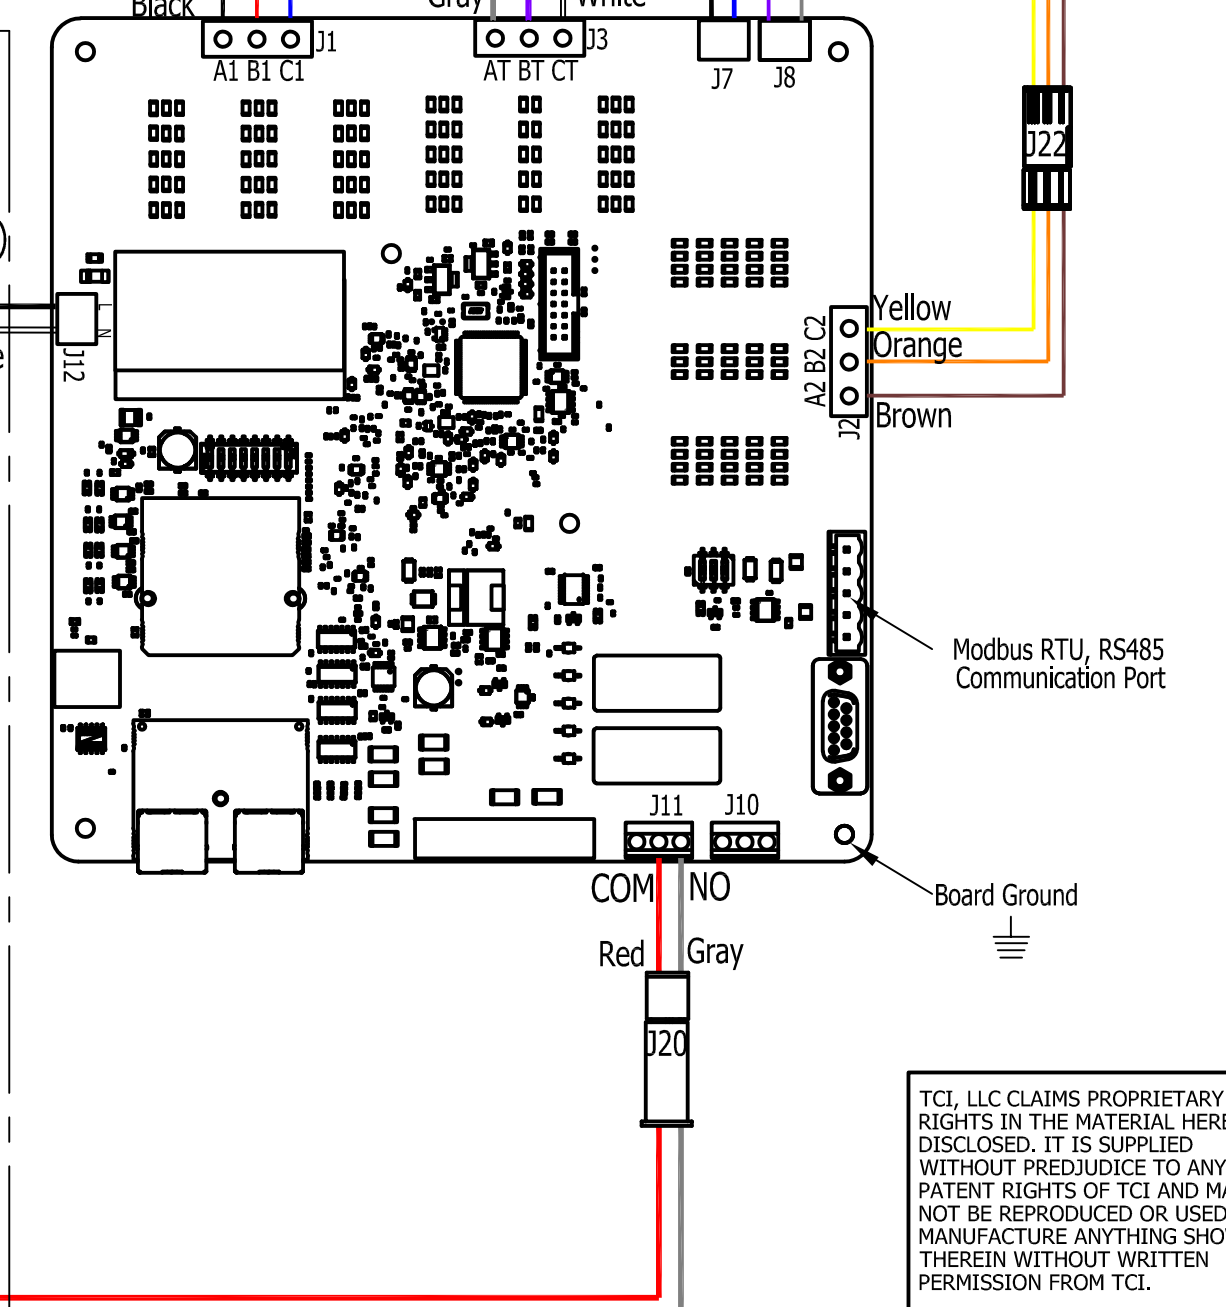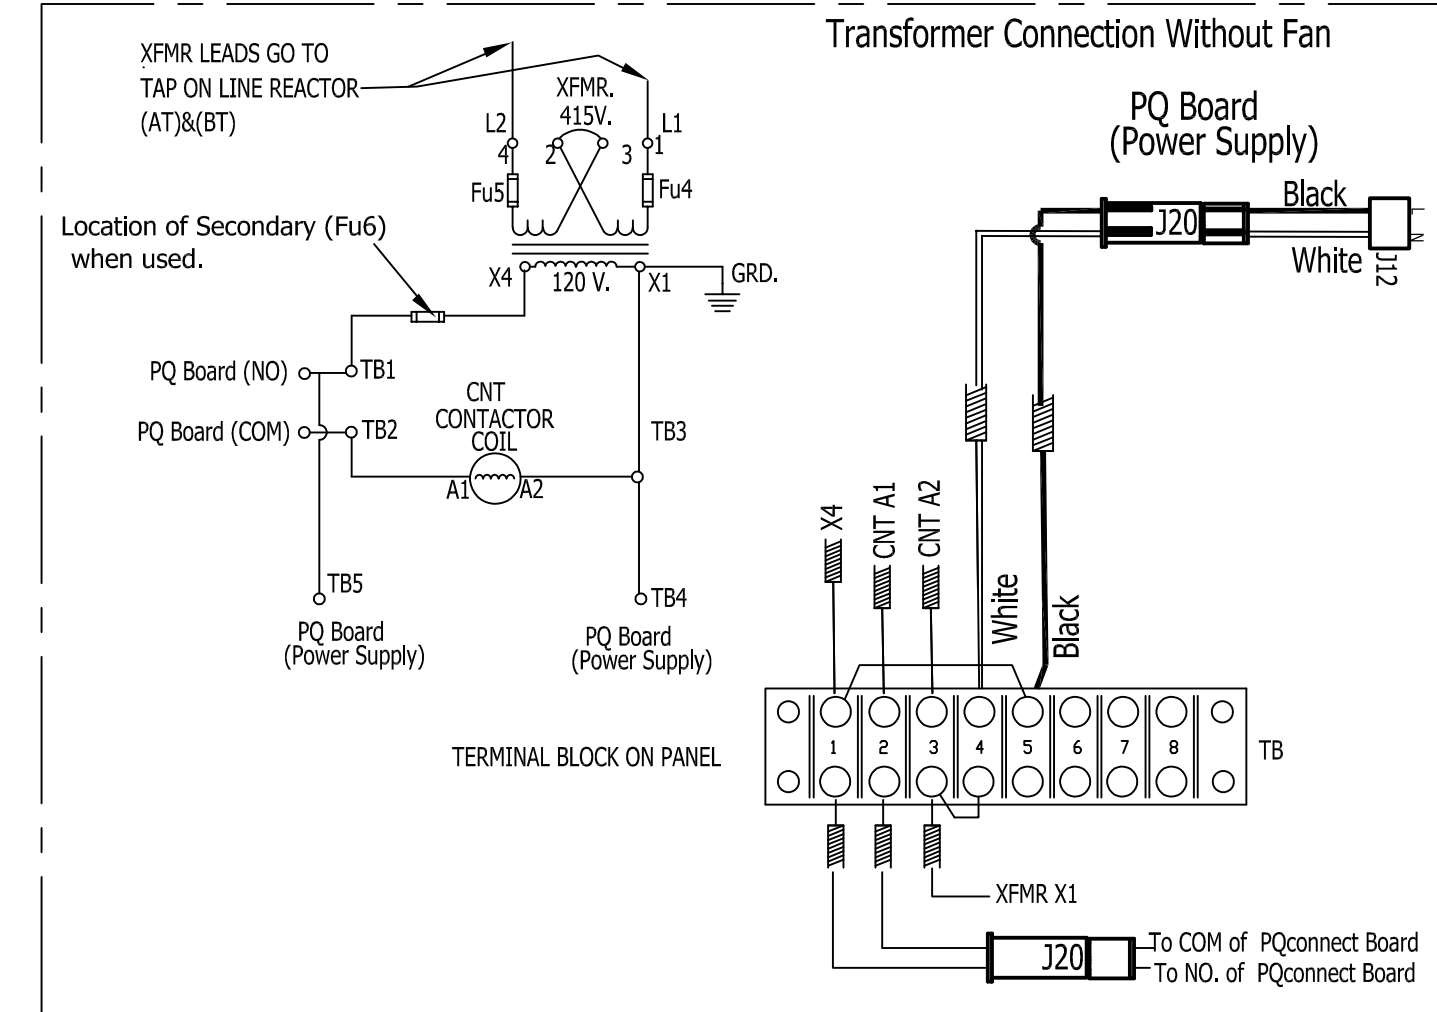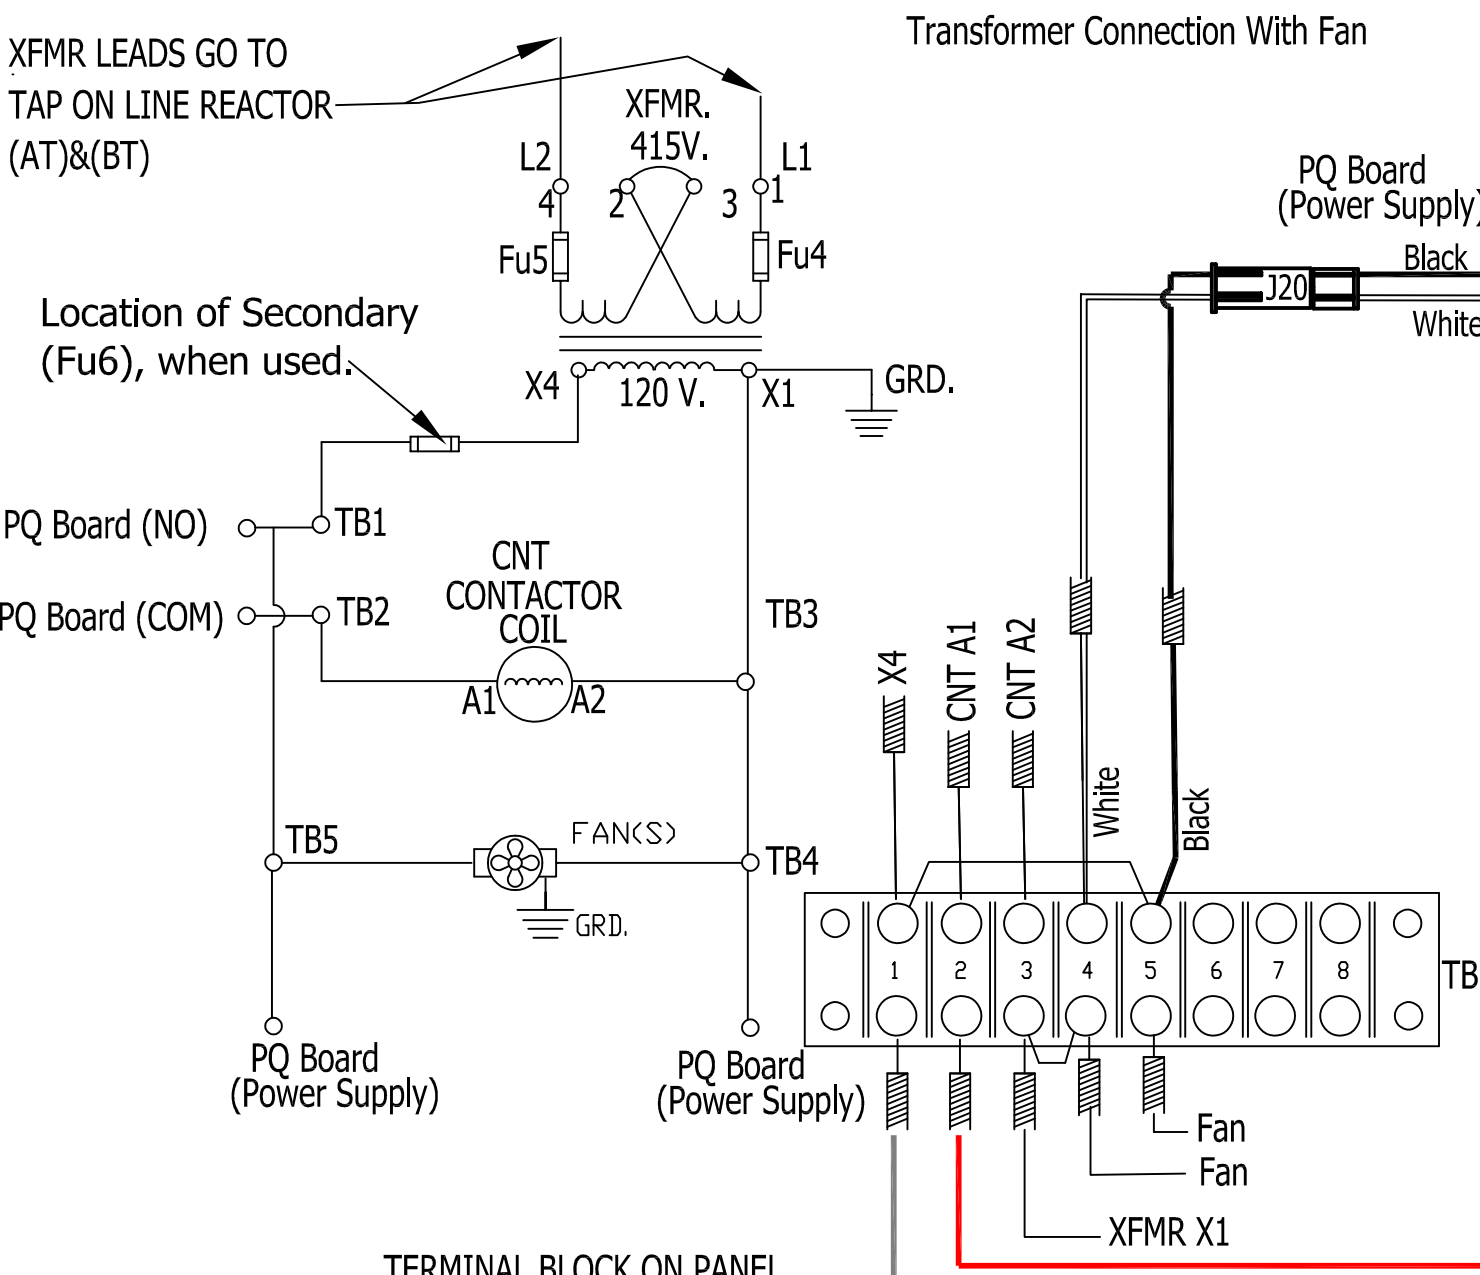

Material(s) Shall be RoHS Compliant

TCI, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCI AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCI.				TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± NA .XXX ± NA		W132 N10611 Grant Drive Germantown, WI 53022	
C	5333 X2 TO X4	07/31/20	JRN	FRACTIONAL NA		HarmonicGuard Passive 380-415V Contactor/PQconnect, Two Thermal Switches	
B	4996 Added TS Wiring Colors	12/10/19	JRN	ANGULAR NA		DRN BY JRN DATE: 05/03/19 31582	
A	As Designed	05/03/19	JRN	SCALE: NA		APRVD: SIZE C	
NO	REVISION	DATE	BY	SCALE: NA		APRVD: SIZE C	