

CUSTOMER CONNECTIONS

75 HP AND BELOW : USE MINIMUM 60°C COPPER WIRE
 ABOVE 75 HP : USE MINIMUM 75°C COPPER WIRE

FACTORY POWER CONNECTIONS

Location of Distribution block (When Used)

CAPACITOR BLEEDER RESISTORS




CAP(S)

CONTROL CONNECTIONS

Transformer Connection With Fan

Transformer Connection Without Fan

PQ Board (Power Supply)

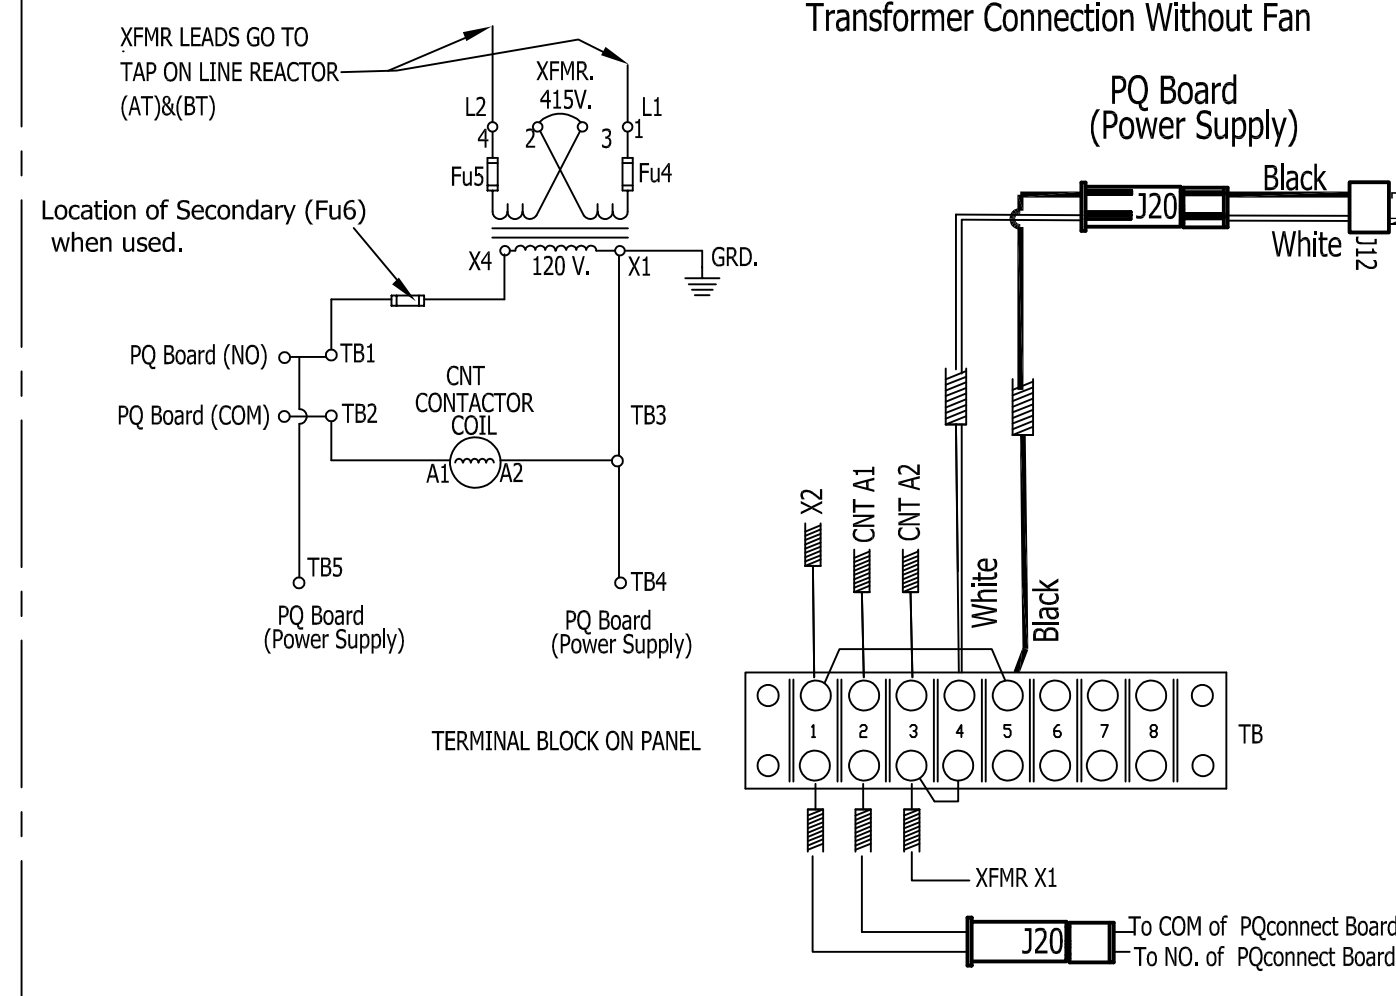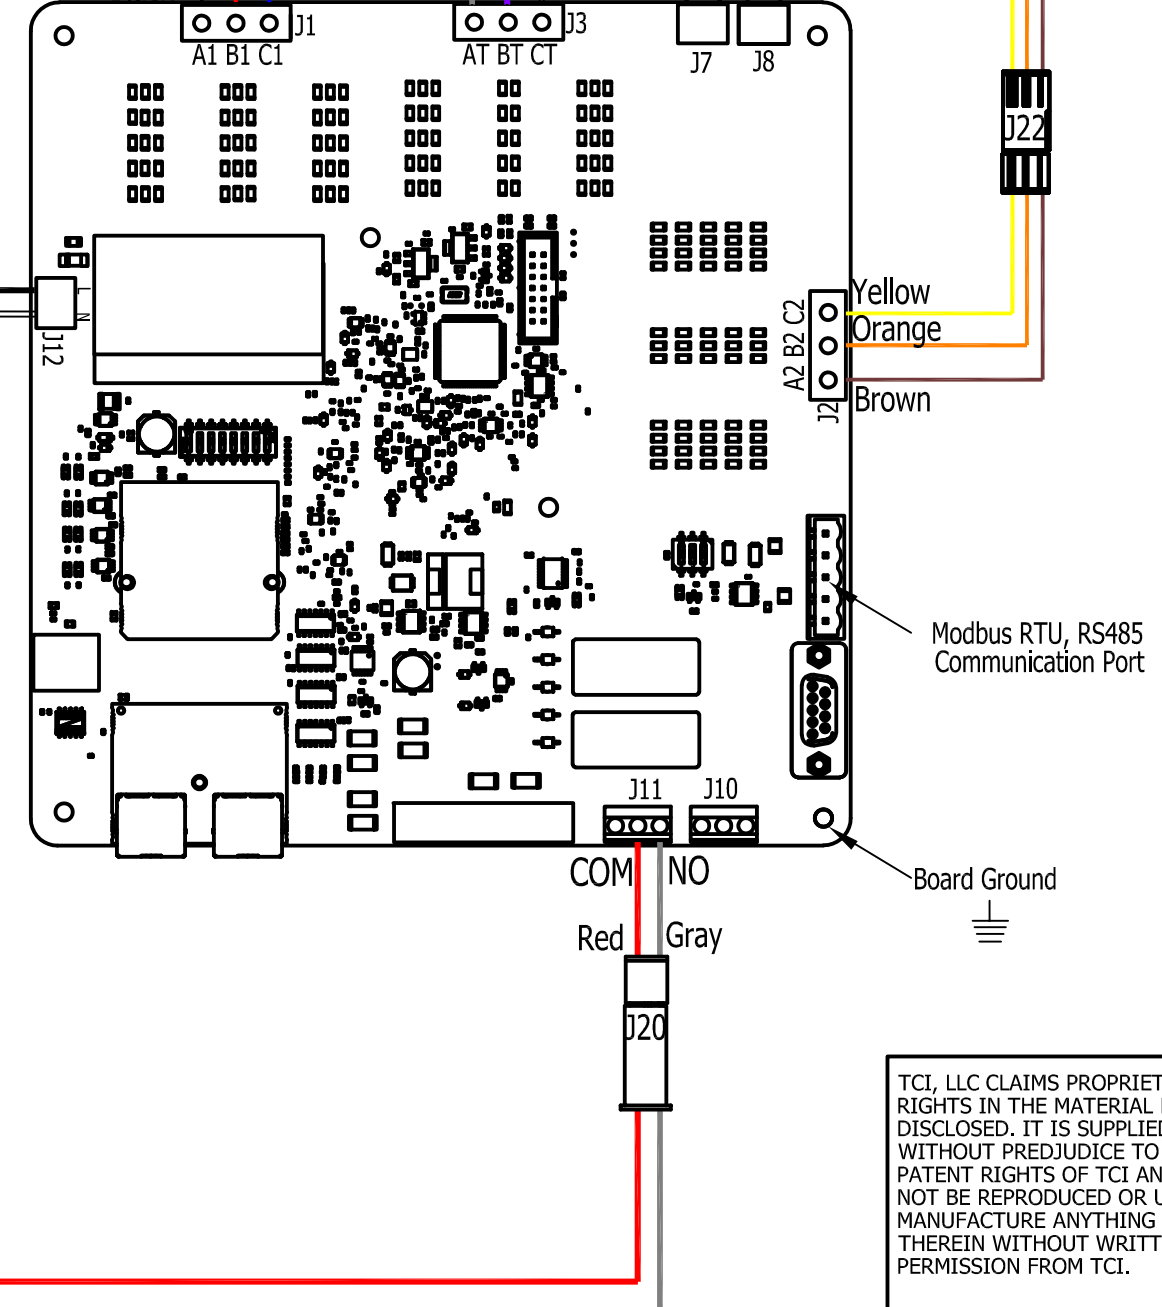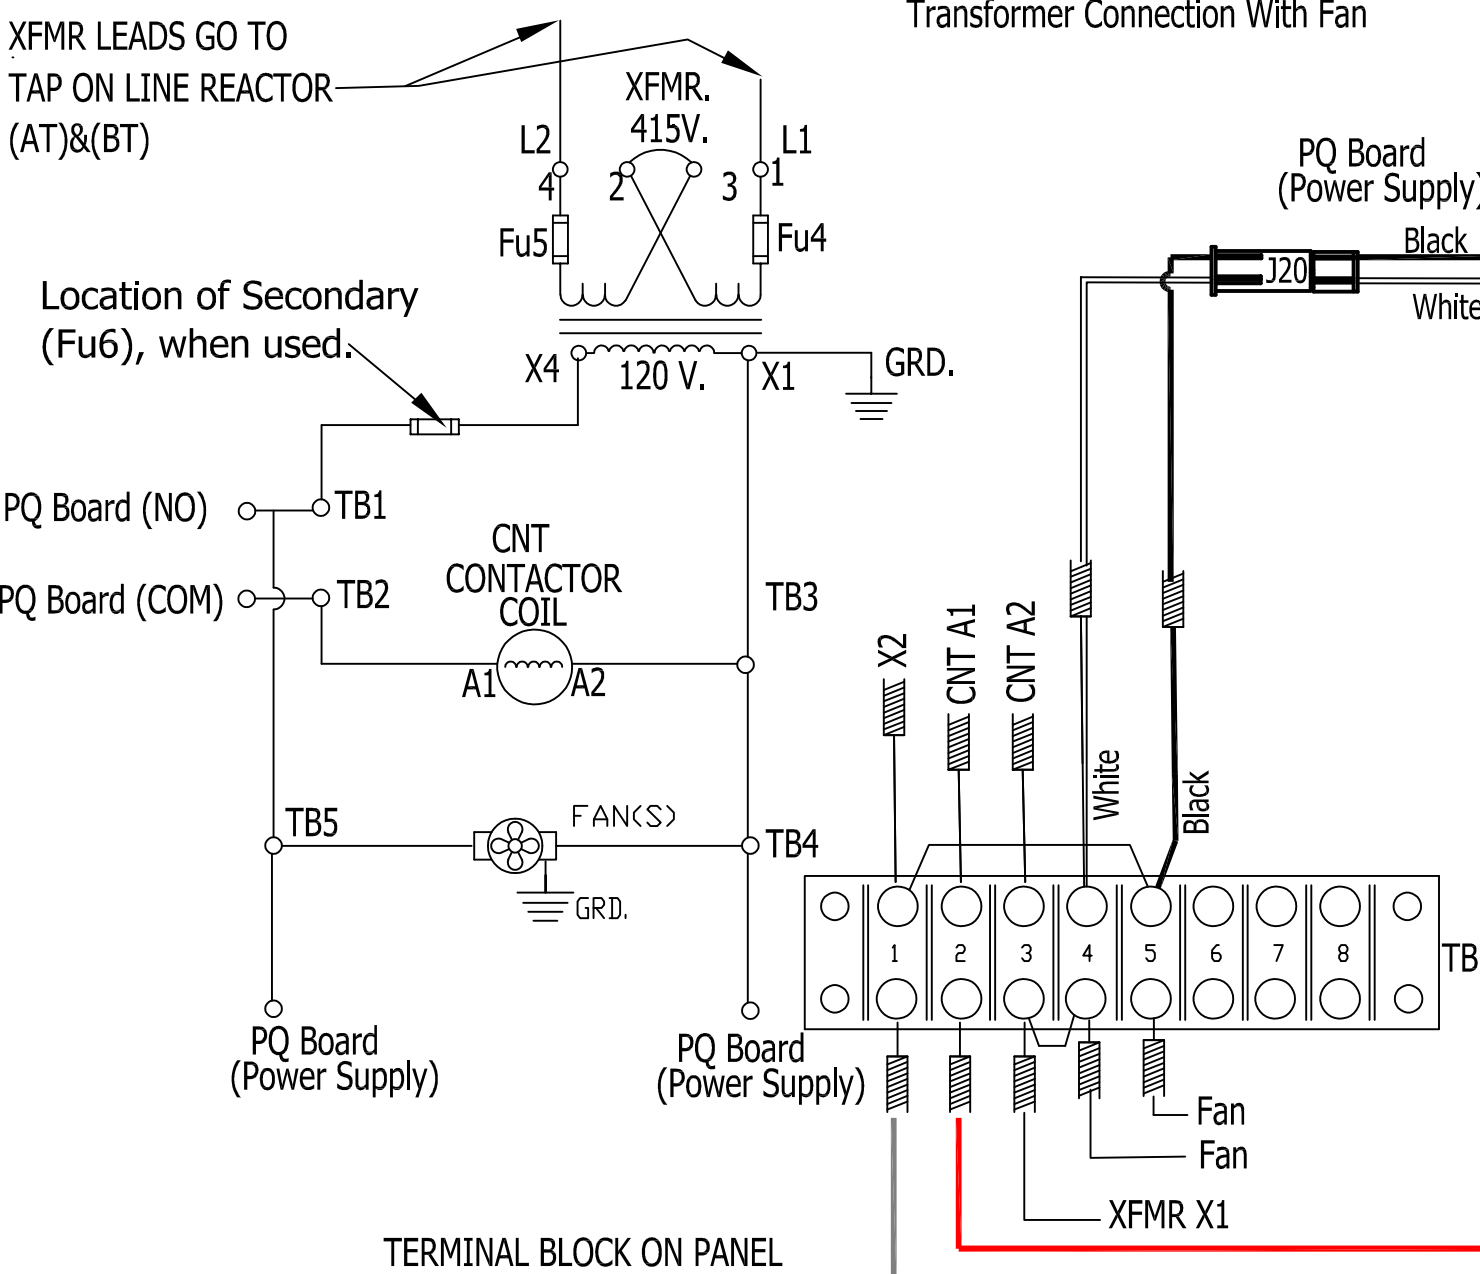

Material(s) Shall be RoHS Compliant

TCL, LLC CLAIMS PROPRIETARY RIGHTS IN THE MATERIAL HEREIN DISCLOSED. IT IS SUPPLIED WITHOUT PREJUDICE TO ANY PATENT RIGHTS OF TCL AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING SHOWN THEREIN WITHOUT WRITTEN PERMISSION FROM TCL.

TOLERANCES (EXCEPT AS NOTED)		TOLERANCES (EXCEPT AS NOTED)		TOLERANCES (EXCEPT AS NOTED)	
DECIMAL		DECIMAL		DECIMAL	
.XX ± NA		.XX ± NA		.XX ± NA	
.XXX ± NA		.XXX ± NA		.XXX ± NA	
FRACTIONAL		FRACTIONAL		FRACTIONAL	
NA		NA		NA	
ANGULAR		ANGULAR		ANGULAR	
NA		NA		NA	
A As Designed		05/03/19		JRN	
NO		REVISION		DATE	
BY		BY		BY	
APRVD:		APRVD:		APRVD:	
SCALE: NA		SCALE: NA		SCALE: NA	
DATE: 08/20/19		DATE: 08/20/19		DATE: 08/20/19	
SIZE: 31653		SIZE: 31653		SIZE: 31653	
SHT. 1 OF 1		SHT. 1 OF 1		SHT. 1 OF 1	

W132 N10611 Grant Drive
 Germantown, WI 53022

HarmonicGuard Low Capacitance
 380-415V Contactor/PQconnect, Two Thermal
 Switches

DRN: JRN
 DATE: 08/20/19
 SCALE: NA
 APRVD: [Signature]
 SIZE: 31653
 SHT. 1 OF 1