

Notes:

- 1) Refer to schematic #28283-1 on units with network gateways.
- 2) OT1 and OT2 are located in the exhaust area of the inductor tunnel on their respective side.




				TOLERANCES (EXCEPT AS NOTED)
				DECIMAL
				.XX ± .02
				.XXX ± .01
				FRACTIONAL
				± 1/32
A	new release	6/3/20	MJS	ANGULAR
NO	REVISION	DATE	BY	± 1/2°

TCL W132 N10611 Grant Drive
 Germantown, WI 53022

Schematic, 600A/700A
 Active Filter, Type 12, MM

DRN. BY	MJS	DATE	6/2/20	DWG. NO.	31736
SCALE	N/A	APRVD.		B	SHT. 1 OF 2

CT Wiring Detail

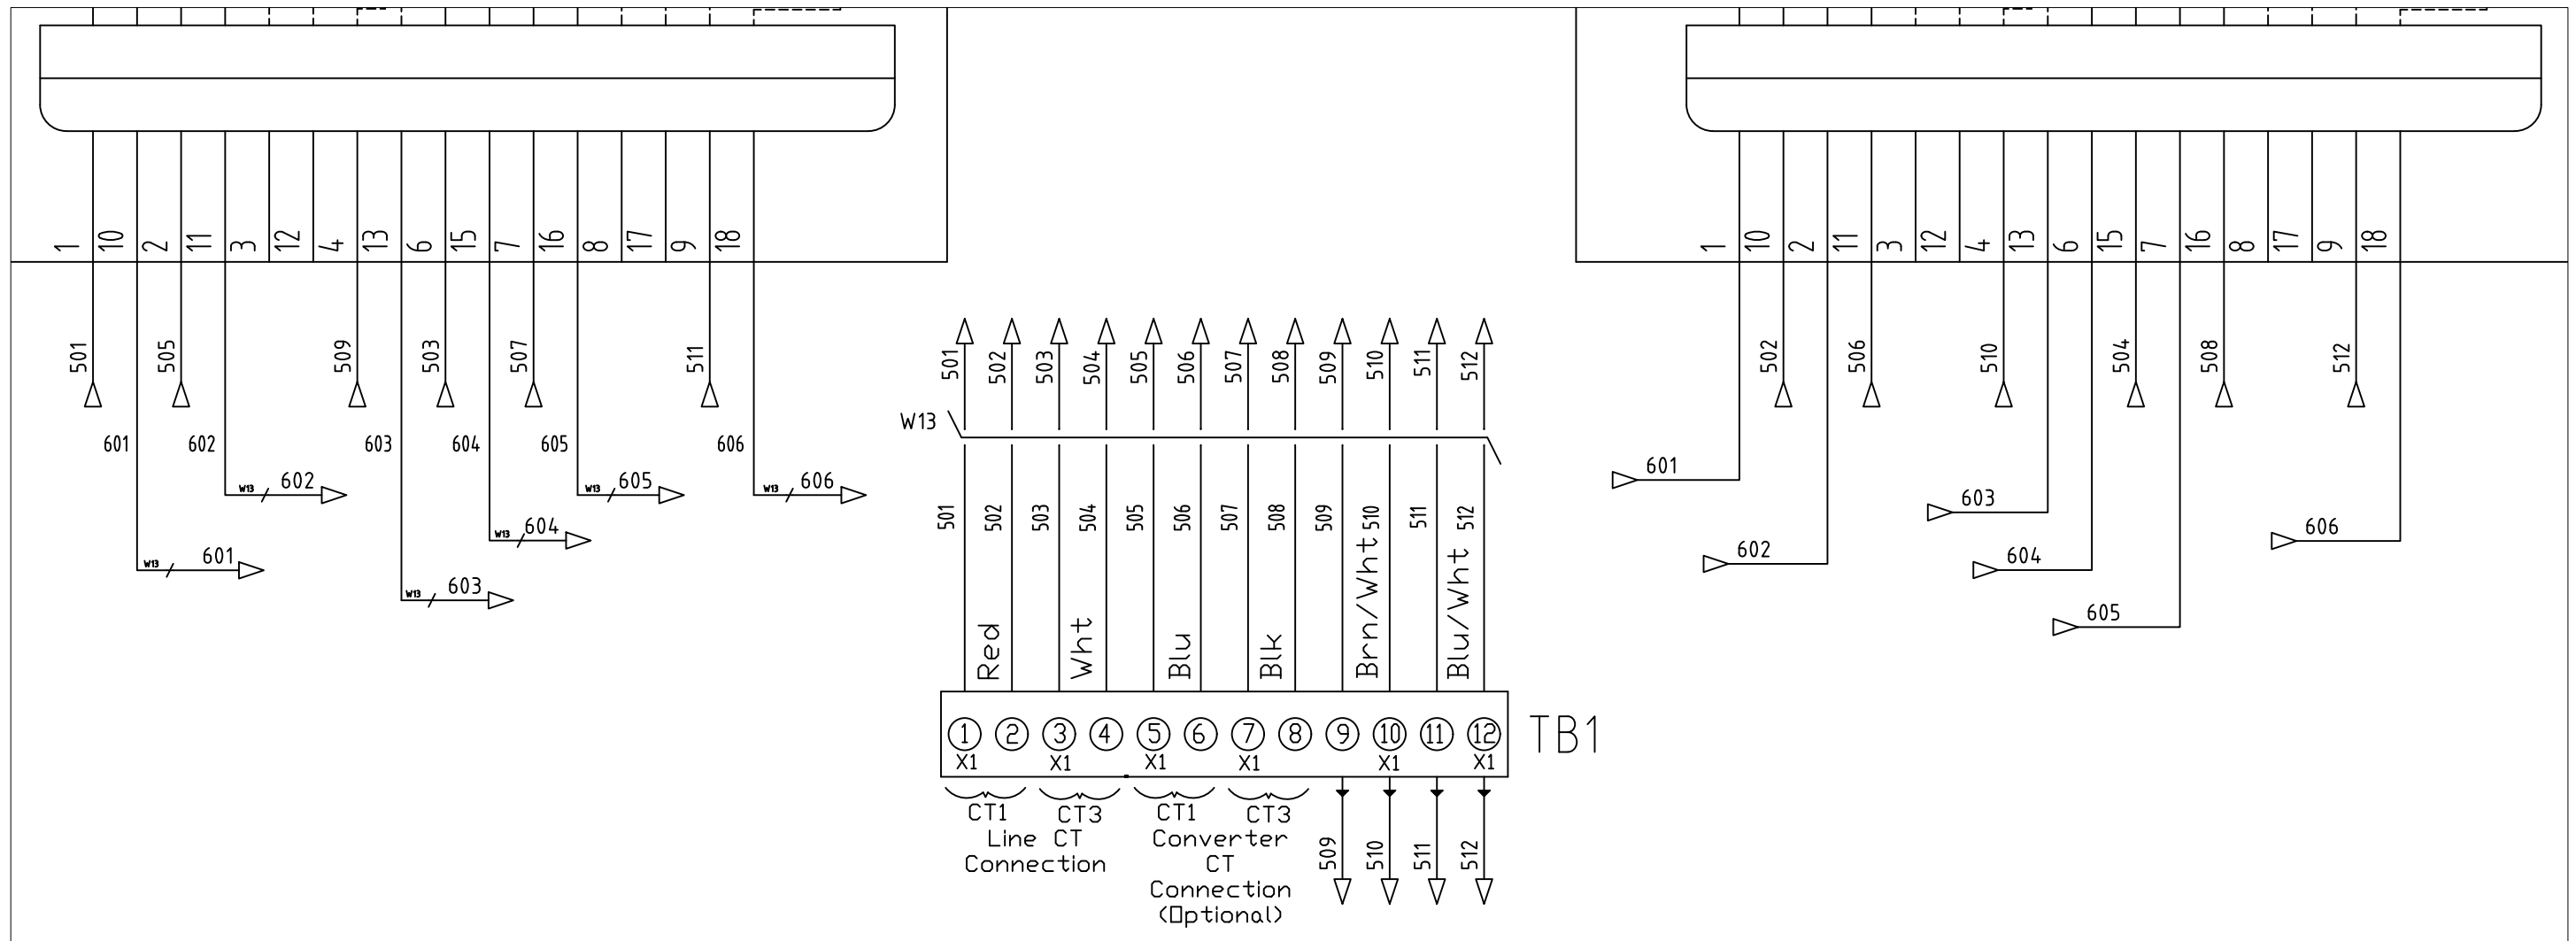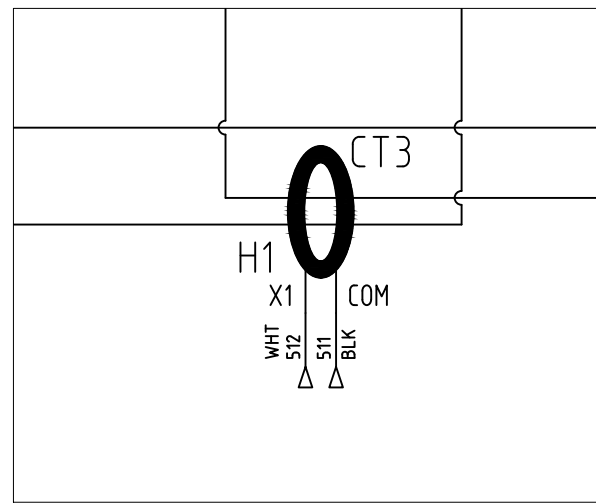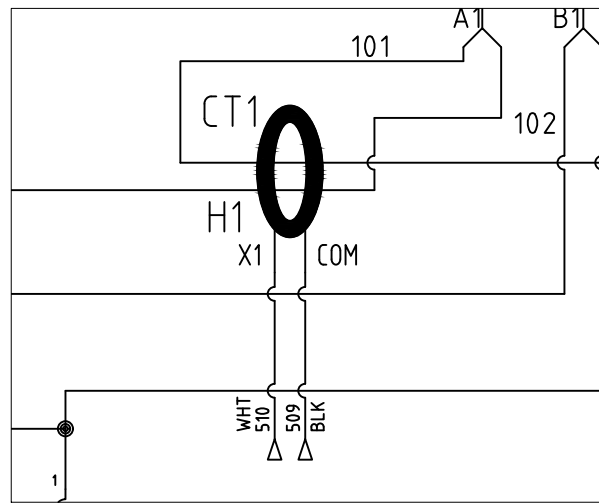

NO	REVISION	DATE	BY
	SEE SHT1		

TOLERANCES (EXCEPT AS NOTED) DECIMAL .XX ± .02 .XXX ± .01 FRACTIONAL ± 1/32 ANGULAR ± 1/2°		W132 N10611 Grant Drive Germantown, WI 53022			
Schematic, 600A/700A Active Filter, Type 12, MM					
DRN. BY	MJS	DATE	6/2/20	DWG. NO.	B 31736
SCALE	N/A	APRVD.			SHT. 2 OF 2